



This is a digital copy of a book that was preserved for generations on library shelves before it was carefully scanned by Google as part of a project to make the world's books discoverable online.

It has survived long enough for the copyright to expire and the book to enter the public domain. A public domain book is one that was never subject to copyright or whose legal copyright term has expired. Whether a book is in the public domain may vary country to country. Public domain books are our gateways to the past, representing a wealth of history, culture and knowledge that's often difficult to discover.

Marks, notations and other marginalia present in the original volume will appear in this file - a reminder of this book's long journey from the publisher to a library and finally to you.

Usage guidelines


Google is proud to partner with libraries to digitize public domain materials and make them widely accessible. Public domain books belong to the public and we are merely their custodians. Nevertheless, this work is expensive, so in order to keep providing this resource, we have taken steps to prevent abuse by commercial parties, including placing technical restrictions on automated querying.

We also ask that you:

- + *Make non-commercial use of the files* We designed Google Book Search for use by individuals, and we request that you use these files for personal, non-commercial purposes.
- + *Refrain from automated querying* Do not send automated queries of any sort to Google's system: If you are conducting research on machine translation, optical character recognition or other areas where access to a large amount of text is helpful, please contact us. We encourage the use of public domain materials for these purposes and may be able to help.
- + *Maintain attribution* The Google "watermark" you see on each file is essential for informing people about this project and helping them find additional materials through Google Book Search. Please do not remove it.
- + *Keep it legal* Whatever your use, remember that you are responsible for ensuring that what you are doing is legal. Do not assume that just because we believe a book is in the public domain for users in the United States, that the work is also in the public domain for users in other countries. Whether a book is still in copyright varies from country to country, and we can't offer guidance on whether any specific use of any specific book is allowed. Please do not assume that a book's appearance in Google Book Search means it can be used in any manner anywhere in the world. Copyright infringement liability can be quite severe.

About Google Book Search

Google's mission is to organize the world's information and to make it universally accessible and useful. Google Book Search helps readers discover the world's books while helping authors and publishers reach new audiences. You can search through the full text of this book on the web at <http://books.google.com/>

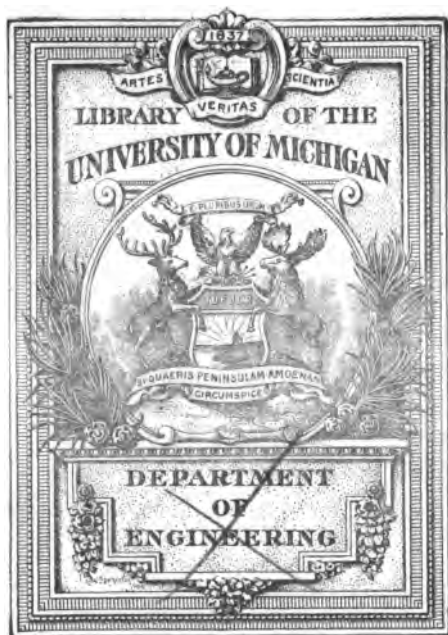

TH
228/
C56

CHIMNEY DESIGN AND THEORY

91537

A BOOK FOR
ENGINEERS AND ARCHITECTS

BY

WILLIAM WALLACE CHRISTIE

CONSULTING ENGINEER; MEMBER OF THE AMERICAN SOCIETY OF MECHANICAL
ENGINEERS; MEMBER OF THE FRANKLIN INSTITUTE



NEW YORK
D. VAN NOSTRAND COMPANY

LONDON
E. & F. N. SPON, LIMITED

125 STRAND

1899

**COPYRIGHT, 1899, BY
WILLIAM WALLACE CHRISTIE**

**TROW DIRECTORY
PRINTING AND BOOKBINDING COMPANY
NEW YORK**

Apr. 17 - 05 - 00.6

Rec/ass 12-22-39 mgz-2-

PREFACE

UP to the present time, there has been but one book on the subject of "Chimneys" printed in the United States, that of Armstrong's, revised by F. E. Idell, and published in the "Van Nostrand Science Series." It is a treatment of chimney-draft only. Other than this, the only book of any pretension is that of Bancroft's, an English book, published in 1885, and no longer obtainable. Thus it may be seen that there is no book which contains the latest practice in regard to the theory and designing of chimneys as built in the United States.

The Transactions of the engineering societies and volumes of technical periodicals do not give very much that is of value excepting, however, the "Engineering News" and "Engineering Record," to whom, with Mr. Henry C. Meyer, Jr., I am especially grateful for courtesies extended.

Whenever any extracts are made use of they are credited as far as possible to their source, and my thanks are tendered for the use of same, and to Mr. F. E. Idell for many valuable suggestions and criticisms.

The absence of data on this important subject has induced me to prepare this treatise, and if it meets with the same success that attended my pamphlet, "Chimney Formulæ and Tables," 1897, and will prove to be a source of information and assistance to designers, my object will be attained.

WILLIAM WALLACE CHRISTIE.

PATERSON, N. J., May, 1899.

CONTENTS

CHAPTER I.

	PAGE
INTRODUCTION AND HISTORY,	1

CHAPTER II.

THEORY OF CHIMNEY DRAFT,	6
------------------------------------	---

CHAPTER III.

CHIMNEY FORMULÆ,	15
----------------------------	----

CHAPTER IV.

CHIMNEY TABLES, WIND-PRESSURE, AIR-SPACE IN GRATES,	19
---	----

CHAPTER V.

FOUNDATION MATERIALS. BRICK CHIMNEY MATERIALS,	31
--	----

CHAPTER VI.

STEEL CHIMNEYS—THEORY PERTAINING TO SAME, AND EXAM- PLES FROM EXISTING STRUCTURES,	40
---	----

CHAPTER VII.

BRICK CHIMNEYS—THEORY PERTAINING TO SAME, AND EXAM- PLES FROM EXISTING STRUCTURES,	75
---	----

CHAPTER VIII.

	PAGE
CHIMNEY PERFORMANCES—SPECIAL TYPES—STRAIGHTENING	
CHIMNEYS—FLUES,	121

CHAPTER IX.

HOUSE CHIMNEYS,	136
---------------------------	-----

CHAPTER X.

LIGHTNING PROTECTION,	144
---------------------------------	-----

CHAPTER XI.

GENERAL INFORMATION,	150
--------------------------------	-----

INDEX,	155
------------------	-----

ILLUSTRATIONS

NO.	PAGE
1. SAVERY'S STEAM ENGINE AND BOILER	4
2. THREE BRICK CHIMNEYS	<i>opposite</i> 31
3. HARTFORD STREET RAILWAY COMPANY.....	<i>opposite</i> 48
4. RIDGEWOOD PUMPING-STATION CHIMNEY.....	58
5. WILMERDING, PA., 200-FOOT CHIMNEY	61
6. ANHEUSER-BUSCH BREWING Co., ST. LOUIS, MO	<i>opposite</i> 63
7. GUGGENHEIM SMELTING Co., PERTH AMBOY, N. J....	<i>opposite</i> 64
8. STEEL CHIMNEY USED IN AND ABOUT PHILADELPHIA, PA ..	65
9. MARYLAND STEEL COMPANY.....	67
10. GARFIELD PARK ELECTRIC LIGHT & POWER COMPANY, CHICAGO, ILL.....	68
11. SELF-SUSTAINING STEEL CHIMNEY (WOOLSON)	<i>opposite</i> 74
12. MANCHESTER PUMPING STATION, MANCHESTER, N. H. <i>opposite</i>	<i>opposite</i> 83
13. QUEEN LANE PUMPING STATION, CHIMNEY SECTIONS <i>opposite</i>	<i>opposite</i> 85
14. QUEEN LANE PUMPING STATION, PHILADELPHIA, PA.....	85
15. FREIBURG, SAXONY.....	87
16. TWEEDVALE, MANUFACTURING COMPANY.....	88
17. THREE BRICK CHIMNEYS	<i>opposite</i> 89
18. EDISON ELECTRIC ILLUMINATING COMPANY, PATERSON, N. J.	89
19. EDISON ELECTRIC ILLUMINATING COMPANY, PATERSON, N. J.....	<i>opposite</i> 90

NO.	PAGE
20. NARRAGANSETT ELECTRIC LIGHTING CO., PROVIDENCE, R. I.	96
21. NARRAGANSETT ELECTRIC LIGHTING CO., PROVIDENCE, R. I.	97
22. UNION DEPOT RAILWAY COMPANY, POWER HOUSE..	<i>opposite</i> 103
23. OMAHA & GRANT S. & R. WORKS, DENVER, COL...	<i>opposite</i> 104
24. CHENEY BROS., SOUTH MANCHESTER, CONN	105
25. STEINWAY ELECTRIC COMPANY, ASTORIA, L. I.....	<i>opposite</i> 108
26. IVORYDALE, OHIO, DETAILS.....	109
27. CAMBRIA IRON COMPANY	111
28. METROPOLITAN STREET RAILWAY COMPANY, N. Y. CITY....	113
29. BARBOUR FLAX SPINNING CO., PATERSON, N. J... ..	<i>opposite</i> 116
30. BELLEVILLE, N. J., OLD COPPER WORKS.....	<i>opposite</i> 121
31. PACIFIC COAST BORAX COMPANY, CONSTABLE HOOK, N. J.	126
32. IRON FURNACES, STOCKHOLM, N. J.....	<i>opposite</i> 127
33. WATER TANK SUPPORTED UPON A BRICK CHIMNEY.....	127
34. CARNEGIE GAS COMPANY'S BAGDAD PLANT.....	<i>opposite</i> 129
35. ORMSBY TEXTILE COMPANY, WATERFORD, N. Y....	<i>opposite</i> 131
36. ORMSBY TEXTILE COMPANY, WATERFORD, N. Y....	<i>opposite</i> 132
37. FLUE FOR VERTICAL BOILERS.....	133
38. HORIZONTAL BOILER FLUE CONNECTION	<i>opposite</i> 134
39. FLUE FOR HORIZONTAL RETURN TUBULAR BOILERS.....	135
40. CHIMNEY STRUCK BY LIGHTNING	<i>opposite</i> 144

CHIMNEY DESIGN AND THEORY

CHAPTER I

INTRODUCTION AND HISTORY

INTRODUCTORY

THE most prominent feature to the world at large, of every steam or power plant, and that by which the manufacturing character of a village or city is most easily distinguished, is the chimney.

It is an engineering work which is often given but little thought, so far as the proper size and proportions for the best results are concerned, by those for whom it is to be built.

Nothing in a steam plant is so conducive to great waste of fuel as a badly designed chimney; and it may be made the means of assisting or increasing a high efficiency in the plant, if properly proportioned for the quantity of gases which is to be passed through it.

Chimneys are built of brick, or steel, or stone; steel chimneys being sometimes stayed or guyed with iron rods or wire rope, and sometimes built self-sustaining; in all cases chimneys are set on heavy masonry foundations.

In the following pages the adjuncts and various types of chimneys will be treated separately.

HISTORICAL NOTES.

According to Tomlinson, chimneys were probably in use in England before those of Padua, of which the earliest record is the year 1368, when Carrara, Lord of Padua, introduced them in Rome.

The use of the curfew-bell in preceding centuries indicates their absence, as the ringing of the bell was the signal to cover the fires (*couvre-feu*), which were made in pits, for the night.

In Venice, chimneys were common in the fourteenth century, a number being overthrown by the earthquake of January 25, 1347.

Of the nations of antiquity little in this direction is known.

No traces of chimneys have been found in the ruins of Pompeii or Herculaneum.

Charcoal has been found, it being used, no doubt, in the portable furnaces discovered in the rooms.

Roman houses were frequently heated by means of hot air, which was brought in pipes from a furnace below.

In the dwellings of the Greeks there were no chimneys, the smoke escaping through a hole in the roof.

The Persians still retain their ancient custom of making fires in a hole in their earthen floors, in an iron vessel, and thus heat their apartments, which plan is said to give very satisfactory results. A low table is placed over the heater, with a thick quilted cloth reaching to the floor, and no provision is made for the escape of the products of combustion.

There is no evidence of chimney-shafts in England earlier than the twelfth century.

Leland, speaking of Bolton Castle, says, " . . . was fyniched or Kynge Richard the 2 dyed . . . one thyng I much notyed in the hawle of Bolton, how chimneys were conveyed by tunnells made in the syds of the walls betwixt the lights in the hawle, and by this means, and by no covers, is the smoke of the harthe in the hawle wonder strangely conveyed."

For centuries afterward chimneys remained luxuries for the houses of the great.

At the beginning of the sixteenth century, chimneys were almost unknown; the fire was kindled against a hob of clay called the *rere dosse*, in the back or centre of the room, which was filled with smoke, from the wood (which was the only fuel used), that found its way out by an opening or lantern in the roof.

The houses built at Amboy, N. J., in 1683 are described usually thirty feet long, sixteen feet wide, ten feet between joints, with double chimneys of timber and clay, "as the manner of this country is to build," and cost about fifty pounds each (\$250).

The chimney in its present sense of a funnel from the hearth or fireplace to the roof of the house, is a modern invention.

In 1785, Mr. Watt procured a patent for obviating the smoke of steam-engines by placing the coal in an upright conical tube or hopper fixed in the brickwork of the boiler, immediately behind the furnace door, and causing a stream of air to rush through the furnace door for maintaining combustion.

In Mr. John Bourne's "Treatise on the Steam-engine," p. 51, he shows a boiler and furnace designed by John Smith, of Kingston near Dublin, which has a vertical chimney, designed probably about 1825.

Rev. D. Lardner, "The Steam-engine," p. 128, speaks of the gases passing about the boiler and in immediate contact with it, and finally issuing into the chimney; but he says nothing about the design of the chimney.

In the same book, in an illustration of Savery's steam-engine, 1702, a brick chimney is shown. This is also the first illustration in Dr. R. H. Thurston's "Growth of the Steam-engine," of a chimney-shaft in connection with a steam-boiler.

The following is abstracted from Bishop's "History of American Manufactures":

Gawen Lawrie, settler of East New Jersey in 1684, says "the country farm-houses they build very cheap, . . . the chimneys are stone." Bricks were used by some.—Volume I., page 226.

"Stone and bricks, of which last ten thousand were sent from London to Massachusetts in 1629, were first used in the construction of the fireplaces, which were usually of the most ample dimensions."—Volume II., page 219.

"In 1789 the first steam-engine for cotton spinning was

erected at Manchester, England." It must have been used with a boiler and chimney.—Volume II., page 19.

"Rooseveltdt, in connection with James Sullivan, took out a U. S. Patent, May 31, 1798, for a double steam-engine, and soon after constructed probably the first effective steam-engine, after those of Fitch, ever built in America."—Volume II., page 80.

"He completed one in 1800, with a wooden boiler, through which long cylindrical flues, or heaters, wound several times before entering the chimney." It was for the use of the Philadelphia, Pa., Water-works.

CHAPTER II

THEORY OF CHIMNEY-DRAFT

FURNACE or chimney-draft is produced by one of the following methods:

I. By a natural draft due to the unbalanced pressure of a column of heated gases against a heavier column of outside air.

II. By the use of a steam-jet in the chimney, inducing draft, using either live or exhaust steam from the engine.

III. By a forced draft from a steam blower in the furnace of a boiler setting or a fan feeding through pipes to the furnace.

IV. By induced draft from blowers placed between boiler setting and chimney flue, blowers being usually placed at the base of the chimney.

What follows is abstracted from a paper by Professor Devolson Wood, in the Transactions of the American Society of Mechanical Engineers, Vol. XI.

Peclet's and Rankine's hypotheses are :

1. A certain amount of air must pass through the grate and the body of the coal on the grate to secure combustion.

2. Since the openings for the admission of air are fixed mechanically the requisite amount of air must be supplied at a definite velocity.

3. The required velocity may be produced by the pressure of a column of atmospheric air, which pressure will be the difference of the pressure of the external air and that within the furnace. The height of such a column is called a "head."

4. That, to the head described in the preceding condition, a head must be added sufficient to overcome the resistance offered by the coal to the passage of the air through it; and

another head for the resistance offered by the flues and chimney to the passage of the gases produced by combustion.

The law representing these conditions is given in the form of an equation by Peclet thus:

$$(1) \quad h = \frac{u^2}{2g} \left(1 + G + \frac{f l}{m} \right),$$

in which

u is the required velocity of gases *in the chimney*,

G , a constant to represent the resistance to the passage of air through the coal,

l , the length of the flues and chimney,

m , the mean hydraulic depth or the area of a cross-section divided by the perimeter,

f , a constant depending upon the nature of the surfaces over which the gases pass, whether smooth, or sooty and rough.

If now

A , be the section of the chimney in square feet,

H , the height of the chimney in feet,

$\tau_0 = 461^\circ$ Fahr., absolute (temperature of melting ice),

τ_1 , the temperature of the gases in the chimney,

V_0 , the volume of air at the temperature 32° Fahr., supplied per pound of fuel burned on the grate,

w , the pounds of fuel burned *per second*,

n , the ratio of grate area to that of the chimney area,

S , the area of the grate;

then

$$(2) \quad w V_0 \frac{\tau_1}{\tau_0} = u A = n u S.$$

The pounds of coal or fuel burned per square foot of grate per hour will be

$$(3) \quad 3600 \frac{w}{S} = 3600 \frac{n u}{V_0} \frac{\tau_0}{\tau_1}.$$

Peclet found that when 20 to 24 pounds of coal is burned per hour, the value of G is about 12, and f , for sooty surfaces, equals 0.012.

Professor Wood has assumed 12 for G , except when 16 pounds is burned, when 11 is used.

Neglecting the length of the flue, let $f = 0.015$. Then for

square or round chimneys, in which b is the breadth or diameter, we have

$$(4) \quad h = \frac{V_s^2 \left(\frac{w}{A}\right)^2 \left(\frac{\tau_1}{\tau_s}\right)^2 \left(13 + \frac{0.060bH}{A}\right)}{2g}$$

Rankine's determination of the height was for the purpose of deducing the head h . His hypotheses are:

1. The gases in the chimney are uniformly hot ;
2. The gases move in parallel sections through the chimney ;
3. The density of the gases in the chimney is uniform, and does not differ sensibly from that of air at the same temperature and pressure ; in other words, it is assumed that the density varies with the temperature only, the variation of pressure being neglected in determining the density.

4. "The head producing the draft in the chimney is equivalent to the excess of the weight of a vertical column of cool air outside the chimney, and of the same height, above that of a vertical column of equal base of the hot gases within the chimney."

5. That the draft is a maximum when the *weight* of gases discharged is the greatest.

The fourth hypothesis is improperly defined, since the head is defined as a weight, whereas it is a height in feet. Professor Wood defines it as such a height of hot gases as, if added to the column of gases in the chimney, would produce the same pressure at the furnace as a column of outside air, of the same area of base, and a height equal to that of the chimney.

If 24 pounds of air be supplied per pound of fuel the volume of the gaseous product will be $24 \times 12\frac{1}{2} = 300$ cubic feet (nearly), and one cubic foot will weigh $\frac{1}{310} = 0.0033$ of a pound at 32° Fahr., which, added to the weight of a cubic foot of air at 32° Fahr., gives $0.0807 + 0.0033 = 0.084$ of a pound ; and if τ_s be the temperature of the external air, we have at once from the fourth principle as amended,

$$(5) \quad h = \frac{\frac{\tau_s}{\tau_1} (0.0807)}{\frac{\tau_s}{\tau_1} (0.084)} H - H = \left(0.96 \frac{\tau_s}{\tau_1} - 1\right) H;$$

which is the formula given by Rankine. From this we find

$$(6) \quad H = \frac{13 \frac{V_o^2 \left(\frac{w}{n\delta}\right)^2 \left(\frac{\tau_1}{\tau_o}\right)^2}{2g}}{0.96 \frac{\tau_1}{\tau_o} - 1 - \frac{0.06b}{2gA} \left(\frac{V_o^2 w \tau_1}{n\delta \tau_o}\right)^2}.$$

This gives the height of chimney for burning w pounds of coal per second.

If δ be the weight of a cubic foot of the gases in the chimney, and

N , the number of pounds of air required per pound of coal (about 24 pounds), then will the weight of gases passed up the chimney be

$$(7) \quad \begin{aligned} 2\delta V_o \frac{\tau_1}{\tau_o} \delta &= 0.0807 Nw \text{ nearly;} \\ \therefore \delta &= \frac{0.0807 N \tau_o}{V_o \tau_1} \end{aligned}$$

The weight per second will also be δ times the volume, or $Au\delta$; hence

$$(8) \quad Au\delta = \frac{0.0807 N \tau_o A \sqrt{2gH} \sqrt{0.96 \frac{\tau_1}{\tau_o} - 1}}{V_o \tau_1 \left(1 + G + \frac{0.06bH}{A}\right)}.$$

Observing that $N \div V_o$ will be constant, this expression will be a maximum for a given chimney when the function

$$(9) \quad \frac{\sqrt{0.96 \frac{\tau}{\tau_o} - 1}}{\tau \left(1 + G + \frac{0.06bH}{A}\right)}$$

is a maximum. If G be a variable, the maximum cannot be found unless it be a known function of the temperature. Little, however, is known of its value in special cases, and the law of variation cannot be assigned. If it be considered constant, as in the assumptions of Peclet and Rankine, the function for a maximum reduces to

$$\frac{0.96 \tau - \tau_o}{\tau_o},$$

which is the function considered by Rankine, and gives

$\tau = 2\frac{1}{3} \tau_2$, a maximum ; and if the temperature of the external air be 60° , then will the temperature of the gases be 622° .

From the foregoing rules Professor Wood has calculated the following table :

TABLE No. 1.

SHOWING THE HEIGHTS OF CHIMNEY AND CORRESPONDING HEADS FOR BURNING GIVEN AMOUNTS OF COAL.

τ_2	τ_1 Absolute.	24 lbs. coal per sq. ft. grate area.		20 lbs. coal per sq. ft. grate area.		16 lbs. coal per sq. ft. grate area.	
		Head, h ft.	Height, H ft.	Head, h ft.	Height, H ft.	Head, h ft.	Height, H ft.
520° Absolute or 59° Fahr.	600	128.001	1207.57	52.76	497.73	14.02	132.88
	700	72.75	250.87	45.70	157.61	19.65	67.76
	800	82.76	172.42	55.58	115.80	26.71	55.66
	1000	125.22	149.08	83.97	99.97	40.89	48.68
	1100	153.22	148.76	101.87	98.91	49.61	48.17
	1200	182.34	151.97	121.03	100.86	58.87	49.06
	1400	252.51	159.86	161.92	105.65	80.89	51.20
	1600	334.38	168.83	219.68	110.95	105.96	53.52
	2000	555.53	206.52	355.61	132.20	169.47	63.007

It will be seen that the required heads equal the height of the chimney when the temperature in the chimney-flue is about 620° Fahr., the external air being assumed to be 60° Fahr.

The many different conditions found in the United States, and the complexity of the above equations, prevent their use to any great extent.

Those who wish to investigate more thoroughly the theory of chimney-draft will find material in the Trans. A. S. M. E., Vol. XI.

D. K. Clark deduces the following formula for force of draft in inches of water :

$$(10) \quad w = H \left(.0146 - \frac{7.66}{T'} \right).$$

w = force of draft in inches of water.

H = height of chimney in feet.

T' = absolute temperature, Fahr., of hot gases in chimney.

If $H = 135$ feet, and $T' = 550^\circ + 461^\circ = 1011^\circ$ then,

$$(11) \quad w = 135 \left(.0146 - \frac{7.66}{1011} \right) = 0.945 \text{ inch.}$$

Force of Intensity of Draft.—In this particular case 0.88 inch draft has been observed. The force of the draft is equal to the difference between the weight of the column of hot gases inside of the chimney and the weight of a column of the external air of the same height. It is measured by a draft-gauge, usually a U-tube partly filled with water, one leg connected by a pipe to the interior of the flue, and the other open to the external air.

If D is the density of air outside, d the density of the hot gas inside, in pounds per cubic foot, H the height of the chimney in feet, and .192 the factor for converting pressure in pounds per square foot into inches of water column, then the formula for the force of draft expressed in inches of water is

$$(12) \quad F = .192H(D - d).$$

The density varies with the absolute temperature (see Rankine),

$$(13) \quad d = \frac{\tau_0}{\tau_1} 0.084;$$

$$(14) \quad D = 0.0807 \frac{\tau_0}{\tau_2};$$

where τ_0 is the absolute temperature at 32° Fahr., = 493°, τ_1 the absolute temperature of the chimney gases, and τ_2 that of the external air. Substituting these values, the formula for force of draft becomes

$$(15) \quad F = .192H \left(\frac{39.79}{\tau_2} - \frac{41.41}{\tau_1} \right) = H \left(\frac{7.64}{\tau_2} - \frac{7.95}{\tau_1} \right).$$

To find the maximum intensity of draft for any given chimney, the heated column being at 600° Fahr., and the external air at 60° Fahr., multiply the height above grate in feet by .0073, and the product is the draft in inches of water. —Kent.

The readings of all draft-gauges will vary somewhat from the figures in Table No. 2, as the same condition of affairs exists to a greater or less extent in all chimneys.

For any other height of chimney than 100 feet, the height of water-column is found by simple proportion, the height of the water-column being directly proportional to the height of the chimney.

The calculations have been made for a chimney 100 feet

high, with various temperatures outside and inside of the flue, and on the supposition that the temperature of the chimney is uniform from top to bottom.

TABLE No. 2.

HEIGHT OF WATER-COLUMN DUE TO UNBALANCED PRESSURE IN CHIMNEY
100 FEET HIGH. (*Locomotive, 1884.*)

Temperature in the chimney.	Temperature of external air.—Barometer 14.7.									
	0	10°	20°	30°	40°	50°	60°	70°	80°	100°
200	.453	.419	.384	.353	.321	.292	.263	.234	.209	.182
210	.470	.436	.401	.371	.338	.309	.280	.251	.227	.200
220	.488	.453	.419	.388	.355	.326	.296	.269	.244	.217
230	.505	.470	.436	.405	.373	.344	.315	.286	.261	.234
240	.520	.488	.451	.421	.388	.359	.330	.301	.276	.250
250	.537	.503	.468	.438	.405	.376	.347	.319	.294	.267
260	.555	.523	.484	.453	.420	.392	.363	.334	.309	.282
270	.568	.534	.499	.468	.436	.407	.378	.349	.324	.297
280	.584	.549	.515	.482	.451	.422	.394	.365	.340	.313
290	.597	.562	.528	.497	.465	.436	.407	.379	.353	.326
300	.611	.576	.541	.511	.478	.449	.420	.392	.367	.340
310	.624	.589	.555	.524	.492	.463	.434	.405	.380	.353
320	.637	.603	.568	.538	.505	.476	.447	.419	.394	.367
330	.651	.616	.582	.551	.518	.489	.461	.432	.407	.380
340	.662	.628	.593	.563	.530	.501	.472	.443	.419	.392
350	.676	.641	.607	.576	.543	.514	.486	.457	.432	.405
360	.687	.653	.618	.588	.555	.526	.497	.468	.444	.417
370	.699	.664	.630	.599	.566	.536	.509	.480	.455	.428
380	.710	.676	.641	.611	.578	.549	.520	.492	.467	.440
390	.722	.687	.653	.622	.589	.561	.532	.503	.478	.451
400	.732	.697	.662	.632	.598	.570	.541	.513	.488	.461
410	.743	.708	.674	.643	.610	.582	.553	.524	.499	.472
420	.753	.718	.684	.653	.620	.591	.563	.534	.509	.482
430	.764	.729	.695	.664	.632	.602	.574	.545	.520	.493
440	.774	.739	.705	.674	.641	.612	.584	.555	.530	.503
450	.785	.749	.714	.684	.651	.622	.593	.564	.540	.513
460	.796	.759	.724	.694	.660	.632	.603	.574	.549	.522
470	.802	.768	.733	.703	.670	.641	.612	.584	.559	.532
480	.810	.776	.741	.710	.678	.649	.620	.591	.566	.540
490	.820	.786	.751	.720	.687	.659	.630	.601	.576	.549
500	.829	.791	.760	.729	.697	.669	.639	.610	.586	.559

This is the basis on which all calculations respecting the draft-power of chimneys have been made by Rankine and others, but it is very far from the truth in most cases.

The difference will be shown by comparing the reading of the draft-gauge with the table given. In one case a chimney 122 feet high showed a flue temperature at the base of 320° Fahr., and at the top 230° Fahr., while the table considers the temperature uniform.

Box gives this table: internal air at 552° Fahr., external air at 62° Fahr.; damper nearly closed. •

TABLE No. 3.
DRAFT-POWERS OF CHIMNEYS.

Height of chimney— feet.	Draft in inches of water.	Theoretical velocity—feet per second.	
		Cold air entering.	Hot air at exit.
10	.073	17.8	35.6
20	.146	25.3	50.6
30	.219	31.0	62.0
40	.292	35.7	71.4
50	.365	40.0	80.0
60	.438	43.8	87.6
70	.511	47.3	94.6
80	.585	50.6	101.2
90	.657	53.7	107.4
100	.730	56.5	113.0
120	.876	62.0	124.0
150	1.095	69.3	138.6
175	1.277	74.3	148.6
200	1.460	80.0	160.0

TABLE No. 4.
VOLUME, DENSITY, AND PRESSURE OF AIR AT VARIOUS TEMPERATURES.

Fahr.	Volume at atmos. pressure.		Density lbs. per cubic foot at atmos. pressure.	Pressure at constant volume.	
	Cubic ft. in 1 lb.	Comparative volume.		Lbs. per sq. in.	Comparative pressure.
0	11.583	.881	.086331	12.96	.881
32	12.387	.943	.080728	13.86	.943
40	12.586	.958	.079439	14.08	.958
50	12.840	.977	.077884	14.36	.977
62	13.141	1.000	.076097	14.70	1.000
70	13.342	1.015	.074950	14.92	1.015
80	13.593	1.034	.073565	15.21	1.034
90	13.845	1.054	.072230	15.49	1.054
100	14.096	1.073	.070942	15.77	1.073
110	14.344	1.092	.069721	16.05	1.092
120	14.592	1.111	.068500	16.33	1.111
130	14.846	1.130	.067361	16.61	1.130
140	15.100	1.149	.066221	16.89	1.149
150	15.351	1.168	.065155	17.19	1.168
160	15.603	1.187	.064088	17.50	1.187
170	15.854	1.206	.063089	17.76	1.206
180	16.106	1.226	.062090	18.02	1.226
200	16.606	1.264	.060210	18.58	1.264
210	16.860	1.283	.059313	18.86	1.283
212	16.910	1.287	.059135	18.92	1.287

Pyrometers.—The high temperatures and peculiar currents of gases in the chimney make it very difficult to ascertain definitely what the temperature is. The clock-face pyrometers made for general use, and whose indications depend on the unequal expansions of metals in their stem, are not considered very reliable, particularly as the zero point is subject to change during the handling of the instrument.

The most satisfactory type of pyrometer is that in which a thermo-electric couple is made use of, but this type has not come into general use; the metal pyrometers just described being considered sufficiently accurate for commercial purposes.

CHAPTER III

CHIMNEY FORMULÆ

PROFESSOR H. B. GALE gives this handy rule, that the sectional area of the chimney in square feet should be equal to the number of pounds of fuel to be burned per minute. This would make the velocity of chimney gases between 7 and 11 feet per second.

Mr. Gale also suggests the following rules:

$$(17) \text{ Flue area in square feet} = A = .07 F^{\frac{2}{3}}$$

$$(18) \text{ Height of chimney in feet} = H = 100 \frac{K}{t} \left(\frac{F}{A} \right)^2$$

where a may be considered $\frac{1}{3}$ of grate area in square feet.

K may be approximately taken as 0.2.

F = pounds of fuel burned per hour.

G = grate area in square feet = $3a$.

t = temperature of chimney gases.

$$(19) \quad H = \frac{180}{t} \left(\frac{F}{G} \right)^2;$$

$$(20) \quad F = \frac{a}{10} \sqrt{\frac{Ht}{K}},$$

$$(21) \quad a = 10F \sqrt{\frac{K}{Ht}};$$

which enables us to calculate the openings in the grate for the admission of air.

Professor Gale has calculated Table No. 5, the temperature of gases in a chimney being taken as 500° Fahr. The heights obtained by calculation are said to agree fairly well with American practice.

TABLE No. 5.

GALE'S CHIMNEY TABLE.

H. P.	Coal per hour, <i>F</i> .	Coal per sq. ft. grate, <i>R</i> .	Area grate, <i>G</i> . $\left(=\frac{F}{R}\right)$	Area opening, <i>a</i> . $\left(=0.4\ G.\right)$	Height, <i>H</i> = $100\ \frac{K}{L}\left(\frac{F}{a}\right)^{\frac{1}{2}}$
	lbs.	lbs.	sq. ft.	sq. ft.	ft.
20	100	13	7.7	3	44
60	300	15	20	8	56
100	500	17	30	12	70
200	1000	19	53	21	90
400	2000	21	95	38	111
600	3000	23	130	52	133
1000	5000	25	200	80	156

CHIMNEY RULES.

Adams gives:

Chimney for one boiler: area = $\frac{1}{3}$ of fire-grate.

Chimney under 150 feet high for more than one boiler:
area = $\frac{1}{10}$ fire-grate area.

Chimney over 150 feet high for more than one boiler:
area = $\frac{1}{15}$ fire-grate area.

Rankine gives, "Rules and Tables," p. 29:

Area of grate = .10 to .04 square feet per pound of fuel
burned per hour.

Area of grate in furnaces with forced draft by blast-pipe
from .04 to .01 square foot per pound of fuel burned per
hour.

Area of chimney = .10 area of grate.

D. K. Clark, "Thurston's Manual of Steam-engineering,"
Vol. II., p. 201:

Sectional area of tubes, inside = $\frac{1}{3}$ grate surface.

Sectional area of chimney = $\frac{1}{15}$ grate surface.

Sectional area blast orifices = $\frac{1}{8}$ grate surface.

Height of chimney in feet = its diameter in inches multi-
plied by 4.

Transactions of the "American Society of Mechanical Engineers," Vol. XV., p. 607, gives:

$$A = \frac{C}{12 \sqrt{H}} \div 1.076.$$

1.076 is constant for a horizontal flue 50 feet long.

Nystrom gives:

$$H = \frac{C^2}{4G^2} - 2 \quad A = \frac{HP}{1.45 \sqrt{H}}$$

$$H = \frac{(HP)^2}{2.1A} \quad G = \frac{C}{2\sqrt{H+2}}$$

$$C = 2G\sqrt{H+2}$$

G = square feet of grate surface.

S = square yards of heating surface.

C = pounds coal per hour.

H = height of chimney in feet.

A = area of chimney-flue in square feet.

HP = horse-power of boilers.

Jones and Laughlin give:

$$A = \frac{C}{10 \sqrt{H}} \quad A = \frac{1.04HP}{\sqrt{H}}$$

Another formula is

$$HP = \sqrt{S \times G}$$

$$S = \frac{(HP)^2}{G} \quad G = \frac{(HP)^2}{S}$$

Molesworth gives:

$$A = \frac{HP}{1.28H} \quad A = \frac{C}{12 \sqrt{H}}$$

Adams, p. 155, "Hand-book for Mechanical Engineers," gives:

$$A = \frac{C}{14 \sqrt{H}} \quad H = \left(\frac{C}{14A} \right)^2$$

$$C = 14A \sqrt{H}.$$

William Kent gives the following, assuming a commercial horse-power to demand the consumption of 5 pounds of coal per hour:

Let A = actual section of chimney-flue in square feet.

Let HP = boiler horse-power.

$$(22) \quad E = \frac{0.3HP}{\sqrt{H}} = A - 0.6\sqrt{A} = \text{effective section in square feet.}$$

$$(23) \quad HP = 3.33E\sqrt{H} = \text{horse-power.}$$

$$(24) \quad d = 13.54\sqrt{E} + 4'' = \text{diameter of round flue in inches.}$$

$$(25) \quad S = 12\sqrt{E} + 4'' = \text{side of square flue in inches.}$$

$$(26) \quad H = \left(\frac{0.3HP}{E^2} \right) = \text{height of chimney in feet.}$$

After numerous examples and discussion, D. K. Clark, in Vol. I. of "The Steam-engine," constructs the following formulæ:

Working maximum consumption of coal per hour, for a chimney of a given height: diameter at the top, one-thirtieth of the height; temperature in the flue, 600° Fahr.

$$(27) \quad C = .014H^2\sqrt{H}.$$

C = coal consumed per hour in pounds.


H = height of chimney in feet.

G = area of grate in square feet.

Taking as an average rate of combustion 15 pounds of coal per square foot of grate per hour, we have: Total grate area for a chimney of a given height; conditions as above:

$$(28) \quad G = \frac{H^2\sqrt{H}}{1071} \text{ or: } H = 16.3\sqrt[2.5]{G}.$$



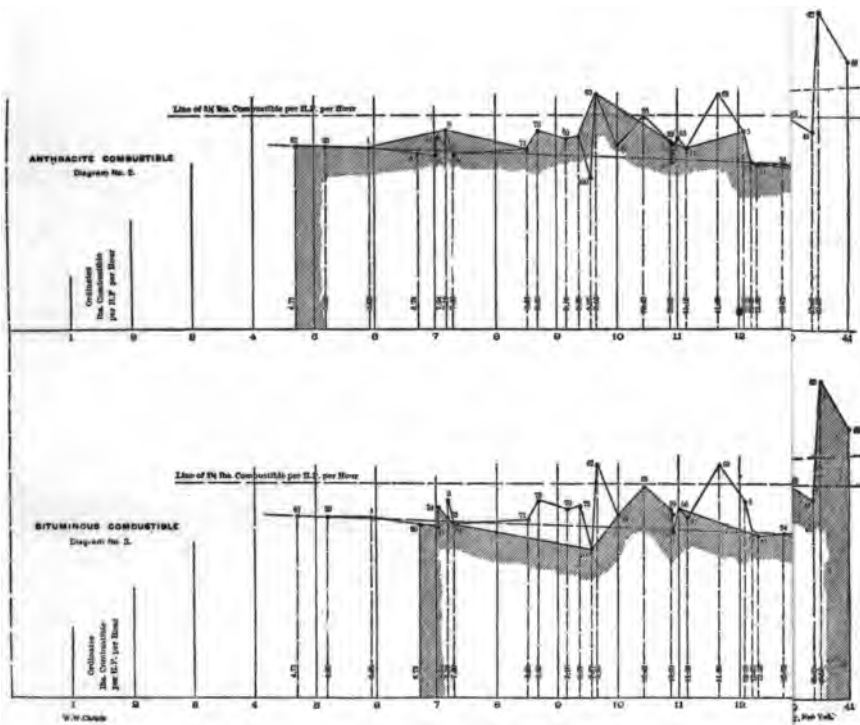

CHAPTER IV

CHIMNEY TABLES, WIND-PRESSURE, AIR-SPACE IN GRATES

RATE OF COMBUSTION

THE results of 45 tests of boilers with anthracite and Welsh steam coal give only 5 instances where the rate of combustion was greater than 13 pounds of coal per square foot of grate per hour, and all of the tests showed the rate of evaporation from and at 212° Fahr. per pound of combustible to be 8.11 pounds to 14.23 pounds.

The same quantity of coal as used in the above tests, burned on a smaller grate, evaporated more water per pound.

Averages of 15 tests by Isherwood give the following data :

	Coal per sq. ft. of grate per hour.	Evaporation from and at 212° F. per lb. coal.
Anthracite coal	12.75	8.90
Semi-bituminous coal	10.95	10.14
Bituminous coal ..	12.43	9.31

Another case—Average of 15 boilers tested gives 13.87 pounds of coal to square foot of grate per hour, while only 7 tests exceed 13 pounds (capacity trials).

For economy trials we have the average of 15 tests, giving 9.77 pounds of coal per square foot of grate per hour; none being over 13 pounds.—Clark, Volume I.

Thurston—"Steam Engine and Boiler Trials," p. 17, says the "efficiency of fuel falls off at 50 to 60 pounds of fuel burned per square foot of grate" (per hour).

In the plotted tests of the writer, PLATE I, all regularity ceases after 37 pounds of coal, burned per square foot of grate is reached.

The following averages are from over 100 tests collated by the writer:

Pounds of coal per horse-power developed per hour.....	3.64
Pounds of combustible per horse-power developed per hour	3.04
Pounds of coal burned per square foot of grate per hour..	18.16

Professor Rankine says: "The rate of combustion in factory boilers is 12 to 16 pounds of coal to the square foot of grate."

Dr. Thurston says, in "Steam Engine and Boiler Trials": "In land boilers it is customary to keep the rate of combustion per square foot of grate down to about 8 pounds per hour, although it frequently rises to 10 or 12 pounds."

The preceding diagram shows that 13 pounds of coal burned per square foot of grate per hour of either anthracite or bituminous coal gives the greatest economy in evaporation.

The greatest amount of anthracite coal found to have been burned per square foot of grate per hour was 33.70 pounds; the least, 4.70 pounds.

The greatest amount of bituminous coal found to have been burned per square foot of grate per hour was 57 pounds; the least, 6.70 pounds.

Land stationary boilers are the only ones considered in these statements.

A noticeable feature of the plotted data is that the most economical boiler performances are obtained when a mixture of one part soft coal to two parts anthracite dust is burned at quite a high rate of combustion, forced draught being used.

The writer's object in giving "combustible" per square foot of grate is that the rating by combustible is the best way of comparing the tests of a number of boilers under which different coals are burned, and is a more reasonable criterion than that of coal only.

It will be readily seen from the averages that less than 4 pounds of coal in the majority of cases is that which is required to be burned per hour to produce one horse-power; and as 13 pounds of coal burned per square foot of grate is a most economical rate of combustion, 13 divided by 4, or 3.25 horse-power per square foot of grate per hour, is most economically attainable.

The above is for anthracite coal. For bituminous coal, as 23.8 pounds burned per square foot of grate is an economical rate of combustion, 23.8 divided by 4, or 5.95 horse-power per square foot of grate per hour, is economically attainable.

The average of 13 and 23.8 is 18.4, which is very nearly 18.16, the average of all the 108 tests; which confirms the correctness of common practice.

CHIMNEYS.

The writer has found that a relation exists between the coal burned per square foot of grate, with efficient chimney draft, for anthracite and bituminous coal, and by assuming that

coefficient $\times A \sqrt{H}$ = coal per hour in pounds,
 then coefficient $\times A \sqrt{H} = G \times$ coal per square foot of grate per hour, we find that for anthracite coal the coefficient equals the coal burned per square foot of grate, and that for bituminous coal the coefficient equals the coal burned per square foot of grate divided by 1.83.

The following tables, figured by formulæ given, will give satisfactory results to any who may use them; should any special modification be needed, the user must use his own judgment with regard to them.

Table No. 6. Grate area for a rate of combustion of 13 pounds per square foot of grate per hour.

Table No. 7. Grate area for a rate of combustion of 23.8 pounds per square foot of grate per hour.

Table No. 8. Coal capacity of chimney.

Table No. 9. Horse-power of boilers.

Table No. 10. Horse-power of chimneys, when two pounds of coal per hour burned furnishes one indicated horse-power at engine. Should the engine horse-power be known, and the chimney size wanted, great care should be exercised in determining it.

The last table is intended only for the one case. The writer has put himself on record as being decidedly in favor of rating chimneys at their coal capacity and not by horse-power.

The 23.8 is a derived constant obtained by multiplying 13×1.83 ; 1.83 confirms Mr. Harris's rule for grate area for bituminous coal burned with natural draft, 23.8 is an economical rate of combustion for bituminous coal.

A horse-power is understood throughout these tables to be the American Society of Mechanical Engineers' standard of $34\frac{1}{2}$ pounds of water evaporated per hour from and at 212° Fahr.

TABLE No. 6.

DIAM. Inches.	AREA (A) Sq. Ft.	HEIGHT OF CHIMNEY															EQUIV. Sq. Chim. Side of Sq.
		Grate Area (G) = A/G for a rate of combustion of 13 lbs.															
		50'	60'	70'	80'	90'	100'	110'	125'	150'	175'	200'	225'	250'	300'		
18	1.72	13	14	15	16										16"		
21	2.41	17	19	20	21										19		
24	3.14	22	24	26	28	30									22		
27	3.98	28	31	33	35	38									24		
30	4.91	35	38	41	44	47	49								27		
33	5.94		46	50	53	56	59	62							30		
36	7.07		55	59	63	67	70	74	79						32		
39	8.30			69	74	79	83	87	93						35		
42	9.62			81	86	91	96	102	108	120					38		
48	12.57				112	119	126	132	141	157					43		
54	15.90					151	159	167	178	199	210				49		
60	19.64					186	196	206	220	246	260				54		
66	23.76						238	249	266	297	314	336			59		
72	28.27						283	296	317	353	374	400	424		64		
78	33.18							348	371	415	440	469	498	525	70		
84	38.48							403	431	481	503	544	577	608	666	75	
90	44.18								495	552	584	625	663	699	765	80	
96	50.27								563	628	665	711	754	795	871	86	
102	56.75								636	709	749	802	851	897	983	91	
108	63.62								712	785	841	900	954	1006	1101	96	
114	70.82									866	937	1002	1063	1121	1228	101	
120	78.54									962	1038	1111	1178	1242	1360	107	
132	95.03									1188	1256	1344	1425	1502	1645	117	
144	113.10									1414	1495	1620	1697	1768	1959	128	

TABLE No. 7.

23

DIAM Inches.	AREA (A) Sq. Ft.	HEIGHT OF CHIMNEY.														EQUIV. Sq. Chim. Side of Sq.
		50'	60'	70'	80	90'	100'	110'	125'	150'	175'	200'	225'	250'	300'	
Grate Area (G) = AVH ÷ 1.83 for a rate of combustion of 23.8 lbs.																
18	1.77	7	7.6	8.1	8.7											16"
21	2.41	9	10	11	12											19
24	3.14	12	13	14	15	16										22
27	3.98	15	17	18	19	21										24
30	4.91	19	21	23	24	26	27									27
33	5.94		25	27	29	30	32	34								30
36	7.07		30	32	34	36	38	40	43							32
39	8.30			38	40	43	45	47	51							35
42	9.62			44	47	50	53	56	59	66						38
48	12.57				60	65	69	72	77	86						43
54	15.90					83	87	91	97	109	115					43
60	19.64					102	107	113	120	134	142					54
66	23.76						130	136	145	162	172	184				59
72	28.27						165	162	173	193	204	219	232			64
78	33.18							190	203	227	245	258	272	297		70
84	38.48							220	236	263	278	297	315	332	364	75
90	44.18								270	302	319	341	362	381	472	80
96	50.27								308	343	363	389	412	434	476	86
102	56.75								347	388	410	439	465	490	537	91
108	63.62								389	434	459	492	521	550	602	96
114	70.88									484	512	548	581	612	671	101
120	78.54									536	567	607	647	679	743	107
132	95.03									650	686	735	778	831	899	117
144	113.10									772	817	874	927	977	1070	128

TABLE No. 8.

DIAM. Inches.	AREA (A) Sq. Ft.	HEIGHT OF CHIMNEY.														EQUIV. Sq. Chim. Side of Sq.
		50'	60'	70'	80'	90'	100'	110'	125'	150'	176'	200'	228'	250'	300'	
Horse Power = 3.25 AVH; 4 lbs. of coal burned considered 1 H. P.																
18	1.77	42	46	49	52											16"
21	2.41	55	62	65	68											19
24	3.14	72	78	85	91	98										22
27	3.98	91	101	107	114	124										24
30	4.91	114	124	133	143	153	159									27
33	5.94		149	163	172	182	192	202								30
36	7.07		179	192	206	218	228	241	257							32
39	8.30			224	241	257	270	283	302							35
42	9.62			263	282	296	312	332	351	390						38
48	12.57				364	387	410	429	458	510						43
54	15.90					491	517	543	579	647	683					48
60	19.64					606	637	669	715	787	845					54
66	23.76						774	809	865	965	1021	1092				59
72	28.27						920	962	1051	1147	1215	1300	1378			64
78	33.18							1131	1206	1349	1459	1524	1619	1706		70
84	38.48							1310	1401	1563	1654	1768	1875	1976	2165	75
90	44.18								1609	1794	1898	2031	2155	2269	2486	80
96	50.27								1830	2041	2161	2311	2451	2584	2831	86
102	56.75								2067	2304	2434	2607	2766	2915	3195	91
108	63.62								2314	2584	2734	2925	3101	3269	3578	96
114	70.88									2879	3045	3257	3455	3643	3991	101
120	78.54									3191	3374	3611	3829	4037	4420	107
132	95.03									3661	4082	4368	4631	4882	5350	117
144	113.10									4596	4859	5200	5515	5811	6367	128

TABLE No. 9.

DIAM. Inches.	AREA (A) Sq. Ft.	HEIGHT OF CHIMNEY.															EQUIV. Sq. Chim. Side of Sq.
		50'	60'	70'	80'	90'	100'	110'	125'	150'	175'	200'	225'	250'	300'		
		Horse Power = 6.5 A/H. When 2 lbs. coal burned per hour = 1 H. P.															
18	1.77	94	92	98	104											18"	
21	2.41	110	124	130	136											19	
24	3.14	144	156	170	182	196										22	
27	3.98	182	202	214	228	248										24	
30	4.91	228	248	266	286	306	318									27	
33	5.94		298	326	344	364	384	404								30	
36	7.07		358	384	410	438	466	482	514							32	
39	8.30			448	482	514	540	566	604							35	
42	9.62			526	564	592	624	662	702	780						38	
48	12.57				728	774	820	858	916	1020						43	
54	15.90					982	1034	1086	1158	1294	1386					48	
60	19.64					1210	1274	1338	1430	1594	1690					54	
66	23.76						1548	1618	1730	1930	2042	2184				59	
72	28.27						1840	1924	2102	2294	2430	2600	2756			64	
78	33.18							2262	2412	2698	2918	3048	3298	3412		70	
84	38.48							2620	2802	3126	3306	3536	3750	3952	4330	76	
90	44.18								3218	3538	3796	4062	4310	4638	4972	80	
96	50.27								3680	4082	4322	4622	4902	5168	5682	86	
102	56.75								4134	4608	4868	5214	5532	5830	6390	91	
108	63.62								4628	5168	5468	5850	6202	6538	7158	96	
114	70.88									5758	6080	6514	6910	7286	7982	101	
120	78.54									6382	6748	7222	7658	8074	8840	107	
132	95.03									7722	8164	8736	9262	9764	10700	117	
144	113.10									9192	9718	10400	11030	11622	12734	128	

TABLE No. 10.

DIAM. Inches.	AREA (A) Sq. Ft.	HEIGHT OF CHIMNEY.															EQUIV. Sq. Chim. Side of Sq.
		50'	60'	70'	80'	90'	100'	110'	125'	150'	175'	200'	225'	250'	300'		
		Pounds of coal burned per Hour. = 13 x G.															
18	1.77	169	182	195	208											16"	
21	2.41	221	247	260	273											19	
24	3.14	286	312	338	364	390										22	
27	3.98	364	403	429	455	494										24	
30	4.91	455	494	533	572	611	637									27	
33	5.94		598	650	689	728	767	806								30	
36	7.07		715	767	819	871	910	962	1027							32	
39	8.30			897	962	1027	1079	1131	1209							35	
42	9.62			1053	1128	1183	1248	1326	1404	1560						38	
48	12.57				1453	1547	1638	1716	1833	2041						43	
54	15.90					1963	2067	2171	2314	2587	2730					48	
60	19.64					2418	2548	2678	2860	3198	3380					54	
66	23.76						3094	3237	3458	3861	4082	4368				59	
72	28.27						3679	3848	4121	4589	4859	5200	5512			64	
78	33.18							4524	4823	5395	5637	6097	6474	6825		70	
84	38.48							5239	5603	6253	6617	7072	7501	7904	8658	76	
90	44.18								6435	7178	7592	8125	8619	9074	9945	80	
96	50.27								7319	8164	8645	9243	9802	10335	11323	86	
102	56.75								8238	9217	9737	10426	11063	11661	12779	91	
108	63.62								9256	10335	10933	11700	12402	13078	14313	96	
114	70.88									11518	12181	13026	13819	14573	15964	101	
120	78.54									12766	13494	14443	15314	16146	17680	107	
132	95.03									15444	16328	17472	18525	19526	21398	117	
144	113.10									18382	19435	20300	22061	23244	25467	128	

TABLE No. 11.

Diameter	Area (A) square feet.	HEIGHT OF CHIMNEY.															Equivalent square chimney side of square. Inches.
		WATER-HEATING SURFACE IN BOILERS.															
		50'	60'	70'	80'	90'	100'	110'	125'	150'	175'	200'	225'	250'	300'		
Inches.		(0.8 lb. of coal per square foot of W. H. S. per hour.)															
18	1.77	563	607	650	693	737	787	823	867	910	953	1040	1127	1213	1300	16	
21	2.41	737	823	910	1040	1127	1213	1300	1430	1517	1647	1777	1907	2037	2123	19	
24	3.14	953	1040	1127	1213	1300	1430	1517	1647	1777	1907	2037	2123	2297	2427	22	
27	3.98	1213	1343	1430	1517	1647	1777	1907	2037	2123	2297	2427	2557	2730	2903	24	
30	4.91	1517	1647	1777	1907	2037	2123	2297	2427	2557	2730	2903	3033	3207	3397	27	
33	5.94	1903	2037	2123	2297	2427	2557	2730	2903	3033	3207	3397	3527	3770	4080	30	
36	7.07	2383	2557	2730	2903	3033	3207	3397	3527	3770	4080	4490	4680	4860	5200	32	
39	8.30	2990	3207	3397	3527	3770	4080	4490	4680	4860	5200	5460	5720	5983	6300	35	
42	9.62	3510	3760	3943	4160	4420	4680	4940	5200	5460	5720	6110	6300	6483	6823	38	
48	12.57	4853	5157	5460	5720	6110	6300	6483	6823	7113	7413	7623	7963	8163	8483	43	
54	15.90	6543	6890	7237	7543	7853	8163	8473	8783	9093	9403	9713	10023	10333	10643	48	
60	19.64	8060	8493	8927	9353	9660	10060	10460	10860	11267	11667	12067	12467	12867	13267	54	
66	23.76	10313	10790	11267	11743	12220	12697	13173	13650	14127	14603	15080	15557	16033	16510	59	
72	28.27	12263	12827	13390	13953	14517	15080	15643	16207	16770	17333	17897	18460	19023	19587	64	
78	33.18	15063	15680	16297	16913	17530	18147	18763	19380	20000	20617	21233	21850	22467	23083	70	
84	38.48	17463	18173	18883	19593	20303	21013	21723	22433	23143	23853	24563	25273	25983	26693	75	
90	44.18	20163	20973	21783	22593	23403	24213	25023	25833	26643	27453	28263	29073	29883	30693	80	
96	50.27	23063	23973	24883	25793	26703	27613	28523	29433	30343	31253	32163	33073	33983	34893	86	
102	56.75	26063	27073	28083	29093	30103	31113	32123	33133	34143	35153	36163	37173	38183	39193	91	
108	63.62	29263	30273	31283	32293	33303	34313	35323	36333	37343	38353	39363	40373	41383	42393	96	
114	70.88	32663	33673	34683	35693	36703	37713	38723	39733	40743	41753	42763	43773	44783	45793	101	
120	78.54	36263	37273	38283	39293	40303	41313	42323	43333	44343	45353	46363	47373	48383	49393	107	
132	95.03	42863	43873	44883	45893	46903	47913	48923	49933	50943	51953	52963	53973	54983	55993	117	
144	113.10	50663	51673	52683	53693	54703	55713	56723	57733	58743	59753	60763	61773	62783	63793	128	

2.5
1.5
5

3.0
2.0
1.0
5.0
4.0

2.5
1.5
2.0
4.0
5.0

2.5
1.5
2.0
4.0
5.0

This table has been calculated by D. K. Clark's rules.

TABLE No. 12.

Height. Feet.	Diameter of Flue. Inches.	Top sectional area of flue in feet.		Coal per hour. Pounds.	Area of grate. Square feet.
		Area.	Per lb. coal per hour.		
40	16	1.39	1.41	142	9.5
45	18	1.77	1.34	190	12.7
50	20	2.19	1.27	248	16.5
55	22	2.63	1.21	314	20.9
60	24	3.14	1.16	390	26.0
65	26	3.69	1.11	477	31.7
70	28	4.26	1.07	574	38.3
75	30	4.91	1.04	682	45.5
80	32	5.60	1.00	801	53.4
85	34	6.29	.97	932	62.1
90	36	7.09	.95	1076	71.7
95	38	7.89	.92	1231	82.1
100	40	8.71	.90	1394	93.0
105	42	9.62	.88	1582	105.5
110	44	10.57	.86	1777	118.4
115	46	11.53	.84	1985	132.3
120	48	12.66	.83	2208	147.2
125	50	13.65	.80	2446	163.1
130	52	14.73	.79	2698	179.8
135	54	15.90	.77	2964	197.6
140	56	17.12	.76	3247	216.4
145	58	18.32	.74	3544	236.2
150	60	19.63	.73	3858	257.2
155	62	20.99	.72	4187	279.1
160	64	22.31	.71	4533	302.3
165	66	23.76	.70	4896	326.4
170	68	25.24	.69	5275	351.6
175	70	26.69	.68	5672	378.1
180	72	28.27	.67	6086	405.7
185	74	29.90	.66	6517	434.5
190	76	31.47	.65	6967	464.5
195	78	33.18	.64	7434	495.6
200	80	34.94	.63	7920	526.6

RATE OF COMBUSTION DUE TO HEIGHT OF CHIMNEY.

Trowbridge's "Heat and Heat Engines" gives the following table showing the heights of chimneys for producing certain rates of combustion per square foot of section of the chimney-flue. It is best adapted to chimneys where a good grade of large-sized anthracite coal is used.

TABLE No. 13.

Height of chimney in feet.	Lbs. of coal burned per hour per square foot of section of chimney flue.	Lbs. of coal burned per square foot of grate, the ratio of grate area to chimney flue area being 8 to 1.	Height of chimney in feet.	Lbs. of coal burned per hour per square foot of section of chimney flue.	Lbs. of coal burned per square foot of grate, the ratio of grate area to chimney flue area being 8 to 1.
20	60	7.5	70	126	15.8
25	68	8.5	75	131	16.4
30	76	9.5	80	135	16.9
35	84	10.5	85	139	17.4
40	93	11.6	90	144	18.0
45	99	12.4	95	148	18.5
50	105	13.1	100	152	19.0
55	111	13.8	105	156	19.5
60	116	14.5	110	160	20.0
65	121	15.1

Dr. R. H. Thurston's rule for the rate of combustion for a given height of chimney (Trans. A. S. M. E., vol. xi., p. 991) is: Subtract one from twice the square root of the height, and the result is the rate of combustion in pounds per square foot of grate per hour, for anthracite coal; or rate = $2\sqrt{H} - 1$, in which H is the height of chimney in feet.

This rule gives the following table:

$H =$	50	60	70	80	90	100	110	125	150	175	200
$2\sqrt{H} - 1 =$	13.14	14.49	15.73	16.89	17.97	19	19.97	21.36	23.49	25.45	27.23

The results agree closely with Trowbridge's table given above. In practice, however, the high rates of combustion for high chimneys given by the formulæ are seldom obtained, for the reason that with high chimneys there are long horizontal flues, serving many boilers, and the friction and interference of the currents of gases from the different boilers diminish the intensity of the draft at the boiler from what it was at the chimney.

In a battery of several boilers connected to a chimney 150 feet in height there has been found $\frac{1}{4}$ inch of water draft at the boiler nearest the chimney, and only $\frac{1}{4}$ inch at the boiler farthest from it.

The first boiler was wasting fuel from an excessive temperature of the chimney gases, 900° Fahr., having too large a

grate surface for the draft, and the last boiler was working below its capacity, and with poor economy, on account of poor draft.

Theron Skeel gives the following relative amounts of coal that can be burned in the same time with chimneys of various heights :

Height in feet	120	100	80	60	40	20
Relative amount of fuel..	100	90	80	70	57	40

J. DeKinder finds the best results to be obtained by using chimneys of the following heights :

75 feet for free-burning bituminous coal.

100 feet for free-burning bituminous slack.

115 feet for slow-burning bituminous coal.

125 feet for anthracite pea coal.

150 feet for anthracite buckwheat coal.

with a draft for anthracite coal of 0.75 to 0.88 inch of water.

This agrees with the conclusions of Emery and Hague.

AIR-SPACE IN GRATES.

The successful performance of a chimney depends upon very many local conditions, among which, and very important, is the amount of air supplied to the burning fuel and allowed to pass through it.

The following list gives the proper size of air-space and thickness of metal in the bar for different fuels.

$\frac{1}{4}$ -inch opening and $\frac{3}{8}$ -inch iron for screenings.

$\frac{3}{8}$ -inch opening and $\frac{3}{8}$ -inch iron for buckwheat coal.

$\frac{1}{2}$ -inch opening and $\frac{1}{2}$ -inch iron for nut or pea coal.

$\frac{5}{8}$ -inch opening and $\frac{1}{2}$ -inch iron for stove coal.

$\frac{3}{4}$ -inch opening and $\frac{1}{2}$ -inch iron for egg coal.

$\frac{7}{8}$ -inch opening and $\frac{1}{2}$ -inch iron for broken coal.

1-inch opening and $\frac{1}{2}$ -inch iron for lump coal.

$\frac{1}{4}$ -inch opening and $\frac{3}{8}$ -inch iron for sawdust.

$\frac{3}{8}$ -inch opening and $\frac{3}{8}$ -inch iron for sawdust.

$\frac{1}{2}$ -inch opening and $\frac{1}{2}$ -inch iron for shavings.

$\frac{5}{8}$ -inch opening and $\frac{1}{2}$ -inch iron for shavings.

For bituminous coal, $\frac{5}{8}$ or $\frac{3}{4}$ -inch opening and $\frac{1}{2}$ -inch iron.

VOLUME OF AIR PASSING THROUGH CHIMNEY.

According to Professor H. B. Gale, the velocity for maximum draft in chimneys is between six and fourteen feet per second, depending on the height of the chimney and temperature of the escaping gases; in brick-stacks it sometimes is as low a rate as three feet per second. The exact rate at which the best draft is produced depends on so many variables, such as flue temperatures, grate air-space, kind of conditions of fuel, etc., that it is probably not the same in any two chimneys or power plants.

WIND-PRESSURE.

The scale of the Smithsonian Institution at Washington for the estimation and description of the velocity and pressure of the wind, calculated by Smeaton's Rule, is as follows:

Divide the square of the velocity in miles per hour by 200; the quotient is the pressure in pounds per square foot.


TABLE No. 14.

Grade.	Velocity in miles per hour.	Pressure per square foot in lbs.	Name.
0	0	0.0	Calm.
1	2	0.02	Very light breeze.
2	4	0.08	Gentle breeze.
3	12	0.75	Fresh wind.
4	25	3.00	Strong wind.
	30	4.50	
5	35	6.00	High wind.
	40	8.00	
6	45	10.00	Gale.
	50	12.5	
7	60	18.00	Strong gale.
8	75	28.2	Violent gale.
	80	32.00	
9	90	40.5	Hurricane.
10	100	50.00	Most violent hurricane.

In the United States the general practice is to assume fifty pounds wind-pressure per square foot as the highest to be considered.

No record of such a high pressure has been heard of, or is likely to be, except in the extreme hurricane, with cyclonic conditions present, as in the East St. Louis, Mo., tornado of 1896, when the brick chimney of the Electric Light Station was partially destroyed and blown down.

From calculations made since the occurrence, the force of the wind must have been about ninety pounds per square foot.

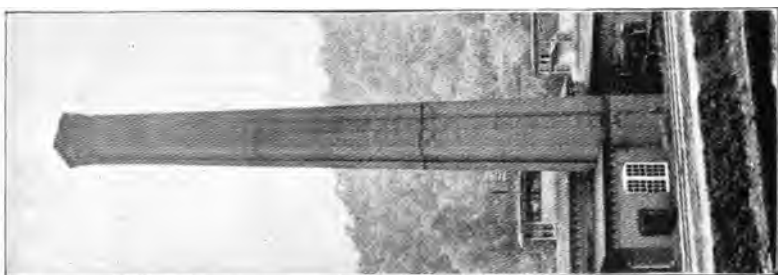

ILLUS. NO. 2.
THREE BRICK CHIMNEYS.

CHAPTER V

FOUNDATION MATERIALS. BRICK CHIMNEY MATERIALS

LOGICALLY and from an engineering stand-point, the first detail of chimney construction is the foundation.

Before considering this topic, a brief statement of the qualities and strengths of various soils, with reference to their ability to support foundations, is requisite.

BEARING POWER OF SOILS.

The building laws of New York City allow 4 tons per square foot as a safe load for "good solid natural earth."

The laws of Chicago specify $1\frac{1}{2}$ tons for pure clay, fifteen feet or more thick; 2 tons for pure dry sand, fifteen feet or more thick; and $1\frac{1}{2}$ tons for a mixture of clay and sand of the same depth.

Ordinary practice gives the following:

200 tons per square foot for solid bed rock.

5 to 25 tons per square foot for rock broken, but well compacted.

4 tons per square foot for pure clay fifteen feet or more thick.

1 ton per square foot for soft wet clay.

8 tons per square foot for gravel well packed and confined.

4 tons per square foot for pure dry sand well packed and confined.

2 tons per square foot for pure dry sand in its natural bed.

$\frac{1}{2}$ ton per square foot for quicksands and marshy soils.

PILING.

Piling must be resorted to when the soil is very sandy or loose.

Piles should be of spruce, not less than six inches in diameter at the smaller end, and should be driven by a drop-hammer weighing not less than 2,000 pounds.

The broom and splinters should be removed from the head of the pile for the last blow.

The heads of the piles should be sawed off level and capped with an oak grillage, or filled around with concrete.

There has been no satisfactory determination made of the safe load on piles, and each engineer is obliged to use his own judgment.

A test reported in *Engineering News*, July, 1893, says: four piles, 13 inches in diameter, 80 square inches area, held up 50.7 tons each without settling.

We give the following formulæ, for the benefit of those who care to use them :

Let R = weight of ram in pounds.

h = fall of ram in feet.

s = depression at last blow in feet.

P = weight of pile in pounds.

L = carrying capacity of driven pile in pounds.

$$(29) \text{ Safe load in pounds} = \frac{R^2 h}{(P + R)s} \quad (\text{Haswell.})$$

$$(30) \text{ Safe load in pounds} = \frac{1}{6} \left(\frac{Rh}{\frac{1}{12} + s} \right). \quad (\text{Eng. News, Feb., 1891.})$$

$$(31) \quad L = \frac{1}{6} \left(\frac{Rh}{s} \right). \quad (\text{I. P. Church in } \textit{Mechanics}.)$$

$$(32) \quad L = 32R \sqrt{h} - c. \quad (\text{Haswell, 1894};$$

where c is a constant having a value of from three to six according to the nature of the soil.

$$(33) \quad L = \frac{2Rh}{12s + 1}. \quad (\text{Wellington.})$$

$$(34) \quad L = \frac{\sqrt[3]{h} \times R \times .026}{12s + 1}. \quad (\text{Trautwine.})$$

As a factor, Trautwine recommends that for piles thoroughly driven in firm soils, one-half of the above load be taken; in river, mud, or marsh (piles not driven to rock bottom), the safe load be restricted to one-sixth of L .

$$(35) \quad L = \frac{\text{fall of hammer in inches} \times \text{weight of ram in net tons}}{\text{depression at last blow in inches} \times 8}.$$

(Sanders.)

This formula applies to piles driven until penetration is small and nearly equal for successive blows.

Building laws of these cities give the following :

Philadelphia, small end 5 inches, head 12 inches, spaced not over 30 inches centre to centre, 20 net tons per pile.

New York, small end 5 inches, spaced not over 30 inches centre to centre, 20 net tons per pile.

Chicago, 25 net tons per pile.

Buffalo, small end 6 inches, spaced not over 36 inches centre to centre, 25 net tons per pile.

CONCRETE.

Concrete is largely used as a subsidiary foundation.

The Metropolitan Water Board's specifications for this material are as follows : " Concrete shall be composed of one part by measure of American natural hydraulic cement, two parts of clean, sharp sand, and five parts of clean screened broken stone, or clean screened gravel.

" The stone for the concrete shall be free from clay, dirt, or other objectionable material ; no stone shall be greater than two and one-half inches, and but very few less than one-quarter inch in their greatest dimensions.

" The mixing shall be done in proper boxes, in a manner satisfactory to the engineer.

" After the materials are wet, the work must proceed rapidly until the concrete is in place, and is so thoroughly rammed that water flushes to the surface, and all the interstices between the stones are entirely filled with mortar.

" It shall be allowed to set a sufficient time, to be determined by the engineer, before walking over, or working upon it shall be permitted.

" All trenches or foundations must be kept free of water while concrete is being placed therein.

" All cement used in the work shall be of the best quality of American natural hydraulic cement, and equal in quality to the best Rosendale cement ; it must be made by manufacturers

of established reputation, and must be fresh, very fine ground, and put up in well-made casks.

"For exposed stone masonry, Portland cement, mixed in the same proportions as the American cement concrete, shall be used; all other stone masonry should be laid in American cement concrete of second quality, mixed in proportion, by measure, of one part of cement to two parts of sand for both mortars."

The building laws of Chicago will not allow more than four tons per square foot on concrete foundations.

Boston and New York specify a minimum thickness of twelve inches.

Using a factor of safety of five, the safe load per square foot, for concrete one month old, is three tons; for concrete six months old, is twelve tons; for concrete one year old, is sixteen to twenty tons.

Chimney foundations are sometimes made of large stones laid on a bed of concrete, and in any case, whether of concrete, stone, or both, they should be large enough to prevent unequal settling; the pressure on the foundation being largely concentrated on the leeward side, and the prevailing winds therefore are apt to have the effect of canting the chimney to one side, unless a broad foundation is furnished.

For dimensions of foundations, and descriptions of several in particular, see pages 36 to 116.

Walls laid in lime and cement mortar: New York, 23,000 pounds per square foot, 160 pounds per square inch.

PIERS.

Building laws of Boston allow 6 to 20 times least diameter for the height, also laid in 1 part cement, 2 parts sand, 26,000 pounds per square foot; laid in 1 part cement, 4 parts sand, 20,000 pounds per square foot; laid in lime mortar, 14,000 pounds per square foot; for "light hard" brick, two-thirds of the above loads are allowable.

Professor Ira O. Baker* says, "safe loads for good brick, in lime mortar, 40,000 pounds per square foot; in cement, 60,000 pounds per square foot."

* Expanded Metal and its Uses in Fire-proof Construction.

In United States Government tests, piers built in lime mortar have cracked at a load of 1,200 pounds per square inch, or 172,800 pounds per square foot.

TABLE No. 15.

UNITED STATES GOVERNMENT TESTS, WATERTOWN ARSENAL.

Breaking load on common brick piers, laid in a mortar composed of one part cement to two parts clean sharp sand.

Height (feet).	Size of pier (inches).	Area (square inches).	Breaking load (pounds per square inch).
10	8 × 8	57.38	1500
8	12 × 12	130.53	1461
10	12 × 12	132.25	1347
10	12 × 12	108.03	1457
10	16 × 16	238.70	964
10	16 × 16	244.92	1010
12½	12 × 12	134.56	1622
12½	12 × 12	131.67	1468
Laid in lime one part, sand three parts.			
10	12 × 12	132.25	1511
10	12 × 12	115.44	1807
10	12 × 16	192.00	773 *

* Face brick ; showed cracks at a load of 516 pounds per square inch.

STONE AND BRICK-WORK.

Sizes of fire-brick: 9-inch straight, $9 \times 4\frac{1}{2} \times 2\frac{1}{2}$ inches.

Soap, $9 \times 2\frac{1}{2} \times 2\frac{1}{2}$ inches.

Checker, $9 \times 3 \times 3$ inches.

2-inch, $9 \times 4\frac{1}{2} \times 2$ inches.

Split, $9 \times 4\frac{1}{2} \times 1\frac{1}{4}$ inches.

A 9-inch straight brick weighs 7 pounds, and contains 100 cubic inches.

One cubic foot of wall requires 17 9-inch straight bricks, and weighs 120 pounds. One cubic yard requires 460 9-inch bricks.

One ton of fire-clay will lay 3,300 ordinary bricks.

Fire-bricks should be used where a temperature greater than 600° Fahr. is to be withstood.

Ordinary red bricks measure $8\frac{1}{4} \times 4 \times 2$ inches, or 26 bricks to the cubic foot. The average weight is $4\frac{1}{2}$ pounds.

An 8½-inch wall requires 14 bricks per superficial foot.

A 12½-inch wall requires 21 bricks per superficial foot.

A 17-inch wall requires 28 bricks per superficial foot.

A 21½-inch wall requires 35 bricks per superficial foot.

SAFE LOADS.—*Red brick.*—*Summary of some municipal building laws. New York, Chicago, and Boston.*

Walls: Hard-burned red brick, laid up in a mortar composed of one part of cement to two parts clean sharp sand:

Boston.....30,000 lbs. per sq. ft., 207 lbs. per sq. in.

New York....30,000 lbs. per sq. ft., 207 lbs. per sq. in.

Chicago.....25,000 lbs. per sq. ft., 173 lbs. per sq. in.

Walls laid in a mortar composed of one part of cement to four parts of clean sharp sand:

Boston.....24,000 lbs. per sq. ft., 166 lbs. per sq. in.

Chicago.....18,000 lbs. per sq. ft., 125 lbs. per sq. in.

Walls laid in lime mortar:

Chicago.....13,000 lbs. per sq. ft., 90 lbs. per sq. in.

Boston.....16,000 lbs. per sq. ft., 111 lbs. per sq. in.

New York....16,000 lbs. per sq. ft., 111 lbs. per sq. in.

Expansion of Fire-brick in Chimney.—*Eng. Rec.*, vol. xxix., p. 400, H. N. Brinckerhoff says: It varies from nothing to 2 to 3 inches in 75 feet in height, also that in lined steel chimneys 4 inches in 200 feet is not likely to occur.

FOUNDATIONS.

The foundation of masonry for the brick-lined steel chimney for the Maryland Steel Works was large-dimensioned stone, quarry faced, with dressed arrises set in a mortar of one part Portland cement and three parts of sand by measure.

The foundation of a brick chimney erected in 1859 for the Chicago Refining Company, 151 feet high, 12 feet square at the base, is as follows: The base, two courses of heavy-dimensioned stone, is bedded upon the surface gravel near the mouth of the river, there recently deposited by the lake. The mortar employed in the joint between the stones was roofing gravel and cement. The area of the base is 256 square feet, the weight of the chimney, inclusive of the base, is 625 tons, giving a pressure of 34 pounds to the square inch, 2.45 tons per square foot.


TABLE No. 16.
TABULATION OF COEFFICIENTS OF EXPANSION OF STONES, AS DETERMINED IN WATER BATHS.

Description of Stones.			Temperature of baths, F.			Gauged lengths.			Coefficient of Expansion.
Name.	Quarry.	Location.	Hot.	Cold.	Difference.	Hot.	Cold.	Difference.	
			Degree.	Degree.	Degree.	Inches.	Inches.	Inch.	
Hoosier Buff Oolitic limestone.....		Indiana	178	33.5	144.5	20.0183	20.0059	.0109	.00000375
Limestone.....		Indiana	177	33.5	143.5	20.0223	20.0115	.0108	.00000376
Marble.....		Vermont.....	203	34	169	20.0239	20.0117	.0122	.00000381
Marble.....	Lee.....	Massachusetts.....	189.5	33.5	156	20.0236	20.0061	.0175	.00000362
Red sandstone.....	Potomac Red Sandstone Co.....	Maryland	183	-33.5	149.5	20.0187	20.0035	.0152	.00000501
Red sandstone.....	Brainerd Quarry Co., Portland	Connecticut	180	33.5	146.5	20.0105	19.9951	.0154	.00000526
Sandstone.....	Ohio	183	33.5	149.5	20.0187	20.0001	.0186	.00000522
Slate.....	Maine.....	194	34	160	20.0108	19.9950	.0158	.00000500
Bluestone.....	New York	192	33.5	158.5	20.0340	20.0151	.0189	.00000596
Granite.....	Worcester Quarry, Milford	Massachusetts.....	183	33.5	149.5	20.0166	20.0044	.0122	.00000408
Granite *.....	Quincy.....	Massachusetts.....	199	33.5	165.5	20.0079	19.9953	.0126	.00000381
Granite.....	Rockport Granite Co., Cape Ann.....	Massachusetts.....	181	33.5	147.5	19.9401	19.9310	.0091	.00000311
Red brick, No. 1.....	Manufactured		184	34	150	6.0874	6.0842	.0032	.00000351
Red brick, No. 2.....	Manufactured		184	34	150	6.0129	6.0106	.0023	.00000255
Red brick, No. 3.....	Manufactured		184	34	150	5.9417	5.9394	.0023	.00000258
Red brick, No. 4.....	Manufactured		184	34	150	6.0224	6.0195	.0029	.00000321
Fire brick, No. 1.....	Manufactured		184	34	150	5.9994	5.9968	.0026	.00000289
Fire brick, No. 2.....	Manufactured		184	34	150	6.0010	5.9988	.0022	.00000244
Ashlar brick E,.....	Manufactured		185	34	151	10.0245	10.0217	.0028	.00000185
Hollow fire proof building brick.....	Manufactured		185	34	151	10.0076	10.0032	.0044	.00000291

* Quarried about the year 1840. Specimens taken from the old post-office building, State Street, Boston, Mass.
United States Government Tests at Watertown Arsenal.

COMPRESSION TESTS OF NATURAL STONES.

(U. S. GOVERNMENT TESTS.)

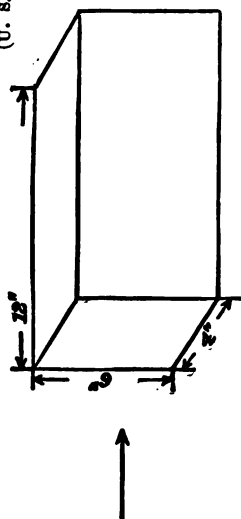

Specimens tested on bed, except the bluestone
and the slate, which were tested on edge.

The ends were faced with plaster of Paris, to
secure even bearings in testing machine.

TABLE No. 17.

No. of test.	Kind of stone.	Dimensions.			Sectional area.	First crack.	Ultimate strength.		Remarks
		Height.	Compressed surface.				Total.	Per square inch.	
		<i>Inches.</i>	<i>Inches.</i>	<i>Inches.</i>	<i>Sq. in.</i>	<i>Pounds.</i>	<i>Pounds.</i>	<i>Pounds.</i>	
5089	Hoosier bluff limestone...	12.00	6.01	4.01	24.1	164,000	171,200	7,104	The tests of these specimens were characterized by a succession of pieces flaking off after the first cracks were observed to appear.
5090	Indiana limestone.....	12.00	6.00	4.02	24.1	166,700	179,300	7,440	
5091	Vermont marble.....	12.02	5.99	4.00	24.0	257,700	267,700	11,167	
5092	Lee marble.....	11.96	5.88	3.86	23.4	423,300	432,300	18,047	
5093	Potomac red sandstone..	11.97	6.00	4.01	24.1	468,600	468,700	19,033	
5094	Portland red sandstone..	12.02	6.00	3.97	23.8	239,800	253,600	10,655	
5095	Ohio sandstone.....	12.00	5.99	3.95	23.8	293,900	306,100	8,660	
5096	Monson slate.....	12.00	6.06	4.05	24.5	160,000	478,000	19,510	
5097	North River bluestone...	12.08	6.02	3.93	23.7	608,000	608,000	25,654	
5098	Worcester granite.....	12.02	6.01	4.01	24.1	608,100	608,100	25,232	
5099	Quincy granite.....	12.03	6.00	4.00	24.0	134,000	462,800	19,283	
5100	Cape Ann granite.....	11.93	6.00	4.00	24.0	173,000	487,100	20,296	

The foundation of a brick chimney erected in 1872 for the McCormack reaper works, 160 feet high, 14 feet square at the base, with a flue 6 feet 8 inches in diameter, is as follows: The base is 25 feet square; area, 625 square feet; the weight of the chimney and the base is approximately 1,100 tons; the pressure on the soil is 24.33 pounds per square inch, 1.75 tons per square foot. Soil was dry, hard clay. This loading is very light.

A Chimney on Loose Soil.—An interesting description is given in *Dingler's Polytechnisches Journal* vol. cclxvii., p. 194, of a chimney built on loose soil; thus rendering a light structure necessary, says the *London Builder*. From the foundations four upright, and somewhat tapering, lattice-girders were carried up, and connected together by cross bracing. On the inner edge of the frame thus formed the chimney proper was built of tiles, about five inches in thickness, and having lap joints. Angle-iron bands were introduced at intervals to bind the whole firmly together. The total height of the chimney is 140 feet, and the inside diameter 8 feet 6 inches. The total weight is 543 tons, which gives a pressure of 17 pounds per square inch on the foundation, 2.2 tons per square foot. This would be about equal to half the weight and pressure per square inch of an ordinary chimney. The whole chimney was erected in thirty-nine days, the iron-work occupying thirty-one days of the time. The cost is set down at 19,200 francs, and it is estimated that a brick chimney of the same height and size would have cost 14,300 francs.

Foundations for self-sustaining steel chimneys are of necessity of greater bearing surface than for brick chimneys, and will be treated under steel chimneys.

CHAPTER VI

STEEL CHIMNEYS—THEORY PERTAINING TO SAME, AND EXAMPLES FROM EXISTING STRUCTURES

STEEL CHIMNEYS.

THE cheapest chimney that can be erected if ground-space is plenty, is a straight steel tube, held up by one or two sets of guy-rods or wires, four or six in a set. These guys should be fastened to an angle-iron or band at two-thirds the height, and if two sets are used, also at one-third the height. They should be anchored at a distance from the base equal to the height of the band above the ground. Boiler blank flue-heads, 16 to 24 inches larger in diameter than the chimney, and $\frac{3}{8}$ to $\frac{1}{2}$ -inch in thickness, make good bed-plates. If cast-iron bed-plates are used, they should be at least one inch thick. The foundation should extend at least 12 inches above the ground level, and should be sunk 4 feet below ground level, and spread out on the bottom to about twice the diameter of the chimney. An iron or steel casing is superior to a brick one, in that it does not leak and draw in cold air, thus impairing the draft. Moreover, when the ordinary chimney is working at its full capacity the velocity of the ascending column of gases is so great that very little heat is lost by radiation through the shell, even though the latter be without any lining, which is quite common.

It is scarcely necessary to say that steel chimneys are always round. For guy-rods, $\frac{1}{2}$ -inch or $\frac{3}{4}$ -inch iron is a common size. For guy-wires, not over 1 inch in diameter should be used. The following table will give some useful data. Whether rods or wires are used, a turnbuckle is necessary for adjusting the tautness of the connection.

TABLE No. 18.

STANDARD HOISTING ROPE—CRUCIBLE STEEL, NINETEEN WIRES TO THE STRAND.

Circumference. Inches.	Diameter. Inches.	Weight per foot of rope with hemp centre Lbs.	Breaking strain in tons of 2,000 lbs.	Safe working load in tons of 2,000 lbs.
3½	1½	2.00	40	6
3½	1	1.58	32	5
2½	¾	1.20	24	4
2½	¾	0.88	18	3
2	¾	0.60	14	2
1½	¾	0.44	9½	1½
1½	¾	0.35	7½	1
1½	¾	0.28	6	¾
1½	¾	0.26	5	¾

GUYED STEEL CHIMNEYS.

"Rule of Thumb" for Finding Diameter of Guy Wires for Steel Chimneys. (Engineering Mechanics, October, 1893.)

Multiply the height of chimney in feet by its diameter in inches, and take the square root of the product. Divide this by 100, and the quotient is the least allowable diameter in inches for each of four guys.

TABLE OF THICKNESS BY GAUGE OF STEEL FOR GUYED CHIMNEYS.

Diameter—Inches...	18	20	24	26	28	30	32	32	34	36
Height—feet.....	40	45	50	50	55	60	65	70	70	75
Thickness—gauge..	16	16	14 & 16	14	14	12 & 14	12 & 14	12 & 14	10 & 12	10 & 12

E. P. ALLIS & Co.

WEIGHT PER FOOT OF STEEL-RIVETED TUBES FOR GUYED CHIMNEYS.

Diameter—Inches.....	10	12	14	16	20	22	24	26	28	30
No. 16 W. G., Wt. per foot.	7.20	8.66	9.58	11.68	13.75	15.00	16.25	17.5	18.75	20.00
No. 14 W. G., Wt. per foot.	9.40	11.11	13.69	15.00	18.33	20.00	21.66	23.33	25.00	26.66

Circular boiler heads make good bases for guyed steel chimneys. The table on pages 42 and 43 applies to such cases.

SELF-SUSTAINING STEEL CHIMNEYS.

The self-sustaining steel chimney is a feature of a great many modern power plants, because of its many advantages over a brick chimney.

Among these advantages are: less floor or ground-space occupied, that is above the ground; ease and rapidity of construction and erection; because it weighs less than a brick

TABLE No. 19.
WEIGHTS OF CIRCULAR BOILER HEADS.

Diameter in Inches.	THICKNESS IN INCHES.										
	1/8	3/16	1/4	5/16	3/8	7/16	1/2	9/16	5/8	11/16	3/4
16	7	11	14	18	22	26	29				
17	8	12	16	20	24	28	33				
18	9	13	18	22	27	32	38				
19	10	15	20	25	30	36	42				
20	11	17	22	28	34	39	45				
21	12	19	25	31	37	43	50				
22	13	20	27	34	41	48	55				
23	14	22	30	37	45	52	60				
24	15	23	32	40	48	56	64				
25	16	24	34	42	50	58	67				
26	18	26	36	44	53	62	70				
27	19	29	38	47	57	66	75				
28	21	31	41	51	62	72	83				
29	22	33	44	55	66	77	88				
30	24	36	47	59	71	83	96				
31	27	41	54	68	81	95	108				
32	29	43	58	72	86	101	115				
33	31	46	61	76	92	108	123				
34	33	49	65	81	98	114	130				
35	35	52	69	86	103	121	138	163	178	194	210
36	37	55	73	91	109	128	146	173	190	207	225
37	39	58	77	96	116	136	154	183	201	220	239
38	41	61	81	102	123	142	163	193	213	233	254
39	43	64	86	107	128	150	171	203	225	247	269
40	45	68	90	113	135	158	180	213	237	259	283
41	47	71	95	118	142	166	189	222	246	273	297
42	50	75	99	124	149	174	199	232	258	286	313
43	52	78	104	130	156	182	208	245	273	301	329
44	55	83	109	136	164	191	218	255	285	315	344
45	57	86	114	143	171	200	228	267	299	328	358
46	60	89	119	149	179	209	239	280	311	342	374
47	62	92	124	156	187	218	250	292	324	357	390
48	65	97	130	163	195	227	260	302	334	367	405
49	68	101	135	169	203	237	270	304	338	373	408
50		106	141	176	211	246	281	317	353	387	422
51		110	147	183	220	256	293	330	366	403	439
52		114	153	190	228	266	304	343	381	419	457
53		119	158	198	237	277	316	356	395	435	474
54		123	164	205	246	288	328	369	410	451	492
55		128	170	213	255	298	341	383	426	468	511
56		132	177	221	265	309	353	397	441	485	530
57		137	183	229	274	320	366	413	457	503	549
58		142	189	237	284	331	379	426	473	521	568
59		147	196	245	294	343	392	441	490	539	588
60			204	254	305	356	408	457	510	561	612
61			212	264	317	370	423	476	529	582	635
62			219	273	328	382	437	492	546	601	656
63			226	282	338	395	451	506	564	620	677
64			233	291	349	407	466	524	582	640	699
65			240	300	360	420	480	540	600	661	721

66	948	310	371	433	495	557	619	681	743	805	867	929	991	1053	1115	1177	1239	1301	1363	1425	1487	1549	1611	1673	1735	1797	1859	1921	1983	2045	2107	2169	2231	2293	2355	2417	2479	2541	2603	2665	2727	2789	2851	2913	2975	3037	3099	3161	3223	3285	3347	3409	3471	3533	3595	3657	3719	3781	3843	3905	3967	4029	4091	4153	4215	4277	4339	4401	4463	4525	4587	4649	4711	4773	4835	4897	4959	5021	5083	5145	5207	5269	5331	5393	5455	5517	5579	5641	5703	5765	5827	5889	5951	6013	6075	6137	6199	6261	6323	6385	6447	6509	6571	6633	6695	6757	6819	6881	6943	7005	7067	7129	7191	7253	7315	7377	7439	7501	7563	7625	7687	7749	7811	7873	7935	7997	8059	8121	8183	8245	8307	8369	8431	8493	8555	8617	8679	8741	8803	8865	8927	8989	9051	9113	9175	9237	9299	9361	9423	9485	9547	9609	9671	9733	9795	9857	9919	9981	10043	10105	10167	10229	10291	10353	10415	10477	10539	10601	10663	10725	10787	10849	10911	10973	11035	11097	11159	11221	11283	11345	11407	11469	11531	11593	11655	11717	11779	11841	11903	11965	12027	12089	12151	12213	12275	12337	12399	12461	12523	12585	12647	12709	12771	12833	12895	12957	13019	13081	13143	13205	13267	13329	13391	13453	13515	13577	13639	13701	13763	13825	13887	13949	14011	14073	14135	14197	14259	14321	14383	14445	14507	14569	14631	14693	14755	14817	14879	14941	14999	15059	15119	15179	15239	15299	15359	15419	15479	15539	15599	15659	15719	15779	15839	15899	15959	16019	16079	16139	16199	16259	16319	16379	16439	16499	16559	16619	16679	16739	16799	16859	16919	16979	17039	17099	17159	17219	17279	17339	17399	17459	17519	17579	17639	17699	17759	17819	17879	17939	17999	18059	18119	18179	18239	18299	18359	18419	18479	18539	18599	18659	18719	18779	18839	18899	18959	19019	19079	19139	19199	19259	19319	19379	19439	19499	19559	19619	19679	19739	19799	19859	19919	19979	20039	20099	20159	20219	20279	20339	20399	20459	20519	20579	20639	20699	20759	20819	20879	20939	20999	21059	21119	21179	21239	21299	21359	21419	21479	21539	21599	21659	21719	21779	21839	21899	21959	22019	22079	22139	22199	22259	22319	22379	22439	22499	22559	22619	22679	22739	22799	22859	22919	22979	23039	23099	23159	23219	23279	23339	23399	23459	23519	23579	23639	23699	23759	23819	23879	23939	23999	24059	24119	24179	24239	24299	24359	24419	24479	24539	24599	24659	24719	24779	24839	24899	24959	25019	25079	25139	25199	25259	25319	25379	25439	25499	25559	25619	25679	25739	25799	25859	25919	25979	26039	26099	26159	26219	26279	26339	26399	26459	26519	26579	26639	26699	26759	26819	26879	26939	26999	27059	27119	27179	27239	27299	27359	27419	27479	27539	27599	27659	27719	27779	27839	27899	27959	28019	28079	28139	28199	28259	28319	28379	28439	28499	28559	28619	28679	28739	28799	28859	28919	28979	29039	29099	29159	29219	29279	29339	29399	29459	29519	29579	29639	29699	29759	29819	29879	29939	29999	30059	30119	30179	30239	30299	30359	30419	30479	30539	30599	30659	30719	30779	30839	30899	30959	31019	31079	31139	31199	31259	31319	31379	31439	31499	31559	31619	31679	31739	31799	31859	31919	31979	32039	32099	32159	32219	32279	32339	32399	32459	32519	32579	32639	32699	32759	32819	32879	32939	32999	33059	33119	33179	33239	33299	33359	33419	33479	33539	33599	33659	33719	33779	33839	33899	33959	34019	34079	34139	34199	34259	34319	34379	34439	34499	34559	34619	34679	34739	34799	34859	34919	34979	35039	35099	35159	35219	35279	35339	35399	35459	35519	35579	35639	35699	35759	35819	35879	35939	35999	36059	36119	36179	36239	36299	36359	36419	36479	36539	36599	36659	36719	36779	36839	36899	36959	37019	37079	37139	37199	37259	37319	37379	37439	37499	37559	37619	37679	37739	37799	37859	37919	37979	38039	38099	38159	38219	38279	38339	38399	38459	38519	38579	38639	38699	38759	38819	38879	38939	38999	39059	39119	39179	39239	39299	39359	39419	39479	39539	39599	39659	39719	39779	39839	39899	39959	40019	40079	40139	40199	40259	40319	40379	40439	40499	40559	40619	40679	40739	40799	40859	40919	40979	41039	41099	41159	41219	41279	41339	41399	41459	41519	41579	41639	41699	41759	41819	41879	41939	41999	42059	42119	42179	42239	42299	42359	42419	42479	42539	42599	42659	42719	42779	42839	42899	42959	43019	43079	43139	43199	43259	43319	43379	43439	43499	43559	43619	43679	43739	43799	43859	43919	43979	44039	44099	44159	44219	44279	44339	44399	44459	44519	44579	44639	44699	44759	44819	44879	44939	44999	45059	45119	45179	45239	45299	45359	45419	45479	45539	45599	45659	45719	45779	45839	45899	45959	46019	46079	46139	46199	46259	46319	46379	46439	46499	46559	46619	46679	46739	46799	46859	46919	46979	47039	47099	47159	47219	47279	47339	47399	47459	47519	47579	47639	47699	47759	47819	47879	47939	47999	48059	48119	48179	48239	48299	48359	48419	48479	48539	48599	48659	48719	48779	48839	48899	48959	49019	49079	49139	49199	49259	49319	49379	49439	49499	49559	49619	49679	49739	49799	49859	49919	49979	50039	50099	50159	50219	50279	50339	50399	50459	50519	50579	50639	50699	50759	50819	50879	50939	50999	51059	51119	51179	51239	51299	51359	51419	51479	51539	51599	51659	51719	51779	51839	51899	51959	52019	52079	52139	52199	52259	52319	52379	52439	52499	52559	52619	52679	52739	52799	52859	52919	52979	53039	53099	53159	53219	53279	53339	53399	53459	53519	53579	53639	53699	53759	53819	53879	53939	53999	54059	54119	54179	54239	54299	54359	54419	54479	54539	54599	54659	54719	54779	54839	54899	54959	55019	55079	55139	55199	55259	55319	55379	55439	55499	55559	55619	55679	55739	55799	55859	55919	55979	56039	56099	56159	56219	56279	56339	56399	56459	56519	56579	56639	56699	56759	56819	56879	56939	56999	57059	57119	57179	57239	57299	57359	57419	57479	57539	57599	57659	57719	57779	57839	57899	57959	58019	58079	58139	58199	58259	58319	58379	58439	58499	58559	58619	58679	58739	58799	58859	58919	58979	59039	59099	59159	59219	59279	59339	59399	59459	59519	59579	59639	59699	59759	59819	59879	59939	59999	60059	60119	60179	60239	60299	60359	60419	60479	60539	60599	60659	60719	60779	60839	60899	60959	61019	61079	61139	61199	61259	61319	61379	61439	61499	61559	61619	61679	61739	61799	61859	61919	61979	62039	62099	62159	62219	62279	62339	62399	62459	62519	62579	62639	62699	62759	62819	62879	62939	62999	63059	63119	63179	63239	63299	63359	63419	63479	63539	63599	63659	63719	63779	63839	63899	63959	64019	64079	64139	64199	64259	64319	64379	64439	64499	64559	64619	64679	64739	64799	64859	64919	64979	65039	65099	65159	65219	65279	65339	65399	65459	65519	65579	65639	65699	65759	65819	65879	65939	65999	66059	66119	66179	66239	66299	66359	66419	66479	66539	66599	66659	66719	66779	66839	66899	66959	67019	67079	67139	67199	67259	67319	67379	67439	67499	67559	67619	67679	67739	67799	67859	67919	67979	68039	68099	68159	68219	68279	68339	68399	68459	68519	68579	68639	68699	68759	68819	68879	68939	68999	69059	69119	69179	69239	69299	69359	69419	69479	69539	69599	69659	69719	69779	69839	69899	69959	70019	70079	70139	70199	70259	70319	70379	70439	70499	70559	70619	70679	70739	70799	70859	70919	70979	71039	71099	71159	71219	71279	71339	71399	71459	71519	71579	71639	71699	71759	71819	71879	71939	71999	72059	72119	72179	72239	72299	72359	72419	72479	72539	72599	72659	72719	72779	72839	72899	72959	73019	73079	73139	73199	73259	73319	73379	73439	73499	73559	73619	73679	73739	73799	73859	73919	73979	74039	74099	74159	74219	74279	74339	74399	74459	74519	74579	74639	74699	74759	74819	74879	74939	74999	75059	75119	75179	75239	75299
----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------

chimney of like capacity, it is better adapted to soils of low load-sustaining power ; the steel shaft presents a smaller area to the wind than a brick chimney of equal flue area does.

Self-sustaining chimneys are frequently lined with fire-brick, but more often with ordinary hard-burned red brick, which can receive the chimney gases at 600° to 700° without injury.

Some, however, simply line the chimney at the bottom where the flue enters it, and in such cases second-quality fire-brick answers the purpose very well.

The thickness of brick lining should nowhere be less than $4\frac{1}{2}$ inches, and that in the upper portion of the chimney, and the thickness should be increased toward the bottom, adding $4\frac{1}{2}$ inches every 30 or 40 feet.

The size of flue and thickness of lining being known (usually adding from 18 to 36 inches to the diameter of the chimney shell or tube), we may start with the design of the chimney.

For an example we will assume the case of a chimney with an outside diameter of 66 inches and 150 feet high.

Let the diameter of the chimney be called D .

Let the diameter of the bottom of bell-shaped base be called D_b .

The writer usually makes the height of the bell-base, or $h_b = 2D$, and the diameter of bottom of bell $D_b = 2D$, though $1\frac{1}{2}$ times the diameter D is often used for both the height h_b , and diameter D_b .

The outlines of the bell-shaped base in vertical projection should be bounded by straight lines, as of a cone, to give the greatest strength, but the outlines are often made curved as in a peeling bell, making use of thicker sheets of steel to counteract the loss of strength due to the straight outline.

The base-plate, usually made of cast-iron, should be kept from 12 to 24 inches above the level of the ground, but in no case should a high brick pedestal be used, it being much more expensive, less pleasing architecturally than the low foundation, without possessing any advantage with regard to strength, and it occupies much more space on the ground.

The base-plate is usually made of cast iron from 1 inch

thick for 100-foot chimneys to 3 inches thick for 250-foot chimneys, and from 16 inches to 36 inches larger than D_s in diameter for the above heights.

For the convenience of casting base-plates can be made in from two to six sections with flanges, held together by $\frac{3}{4}$ -inch to $1\frac{1}{4}$ -inch bolts, and need be solid only to within 12 inches inside the bell, that is, like a round wrought-iron washer.

Neglecting the flare at the base we will consider the whole height of a chimney with a common diameter D , and proceed to design the shell.

Considering the force of the wind as 50 pounds per square foot—the actual pressure on a cylinder is 50 per cent. of the above, or 25 pounds per square foot on the projected area. Add 5 pounds for compressive strain produced by the wind in one half of the shell and its dead load, and we have 30 pounds as a safe value for wind-pressure.

The height of the chimney under consideration, $H = 150$ feet, which, multiplied by $D = 5\frac{1}{2}$ feet and by 30 pounds, gives 24,750 pounds of wind-pressure distributed over the entire area.

The lever arm about the base being $\frac{H}{2}$, the bending moment is $24700 \times \frac{150}{2} = 185625$ foot pounds.

The section modulus, Z , for hollow cylinders is $\frac{\pi}{32} \left(\frac{D^4 - d^4}{D} \right)$, where d = the inside diameter of the shell, and simplified the value of $Z = .0982 \left(\frac{D^4 - d^4}{D} \right)$; having used feet before, feet should be used in this formulæ, or divide the results obtained from using inches by 12.

Dividing the bending moment obtained as above, by the section modulus Z , we obtain the strain per square inch on any section considered.

By calculating the bending moments at different heights of the chimney by multiplying the diameter by one and one-half of the height above the section under consideration by 30 pounds, we may then make use of the following table.

TABLE No. 20.

MOMENTS OF RESISTANCE OF THIN HOLLOW CYLINDRICAL BEAMS (IN FEET).

 D = outside diameter. R in inches = $\frac{.0982 (D^4 - d^4)}{D}$ d = inside diameter.

Inside Diameter, Inches.	4	5	6	7	8	9	10	11
44	23.9	31.9	39.9	47.9	56.1	64.1	72.2	80.4
48	28.3	37.9	47.4	56.9	66.5	76.1	85.8	95.4
52	33.4	44.5	56.7	66.8	78.1	89.4	101.0	112.0
56	38.6	51.6	64.5	77.5	90.5	104.0	117.0	130.0
60	44.4	59.3	74.0	89.0	104.0	119.0	134.0	149.0
64	50.4	67.3	84.1	101.0	118.0	135.0	152.0	169.0
68	56.8	75.9	94.9	114.0	133.0	152.0	172.0	191.0
72	63.8	85.0	107.0	128.0	149.0	171.0	192.0	214.0
76	71.8	100.0	125.0	150.0	175.0	200.0	226.0	251.0
80	79.8	116.0	145.0	174.0	203.0	232.0	261.0	291.0
84	86.8	116.0	145.0	174.0	203.0	232.0	261.0	291.0
90	100.0	133.0	166.0	200.0	233.0	267.0	300.0	334.0
96	113.0	151.0	189.0	227.0	265.0	303.0	341.0	380.0
102	171.0	213.0	256.0	299.0	342.0	385.0	428.0
108	191.0	239.0	287.0	335.0	383.0	432.0	480.0
114	213.0	267.0	320.0	373.0	427.0	481.0	535.0
120	236.0	295.0	354.0	414.0	473.0	533.0	592.0
132	286.0	357.0	429.0	501.0	572.0	644.0	716.0
144	340.0	425.0	510.0	596.0	681.0	766.0	852.0
156	399.0	499.0	599.0	699.0	799.0	899.0	999.0
168	462.0	578.0	694.0	810.0	926.0	1043.0	1160.0
180	531.0	664.0	797.0	930.0	1064.0	1197.0	1331.0
192	604.0	755.0	906.0	1058.0	1209.0	1361.0	1513.0
204	682.0	853.0	1024.0	1194.0	1365.0	1536.0	1708.0
216	764.0	956.0	1147.0	1339.0	1530.0	1722.0	1914.0
228	852.0	1065.0	1278.0	1492.0	1705.0	1919.0	2133.0
240	943.0	1180.0	1416.0	1653.0	1889.0	2126.0	2362.0

(Power, 1897.)

Dividing above result by the strength in tension of steel-plate—45,000 to 50,000 pounds, divided by a factor of safety of 4, obtain the factor which in the horizontal line of chimney diameter will be found in the column of proper thickness of steel to be used for the shell at the section considered.

Thus for the chimney under consideration, 40 feet down from the top, we have $(5\frac{1}{2} \times 40 \div 2) 30 \times \frac{40}{2} = 13200$, which, divided by 12,000 pounds, gives 11 as the section modulus; so the shell may be made of less than $\frac{3}{16}$ " thickness at that elevation. It is not advisable to use less than $\frac{1}{8}$ " to $\frac{3}{16}$ " thickness of metal in any tall chimney, or short one, if long life is to be desired.

The Philadelphia Engineering Works, Ltd., gives the following for the shells of steel chimneys :

TABLE No. 21.
SIR WILLIAM FAIRBAIRN'S EXPERIMENTS.

	Clear span.	Thickness iron.	Outside diameter.	Sectional area.	Breaking weight.	Breaking weight by Clark's formula. Constant 1.2 lbs.
	Feet. Inches.	Inch.	Inches.	Square inches.	Lbs.	
I....	17 0	.087	12.0	1.3901	2,704	2,627
II....	15 7½	.113	12.4	4.3669	11,440	9,184
III....	23 5	.0631	17.68	3.487	6,400	7,303
IV....	23 5	.119	18.18	6.74	14,240	13,910

Mr. Edwin Clarke has formulated a rule, from experiments conducted by him, in the use of iron and steel for hollow tube bridges, which is as follows :

$$(36) \text{ Centre breaking load in tons} = \left\{ \frac{\text{Area of material in inches.} \times \text{Mean depth in inches.} \times \text{Constant.}}{\text{Clear span in feet.}} \right.$$

When the constant used is 1.2, the calculation for the tubes experimented upon by Mr. Fairbairn are given in the last column of the above table.

D. K. Clark's "Rules, Tables, and Data for Mechanical Engineers," page 513, gives the following rule for hollow tubes :

$$(37) \quad W = \frac{3.14 D^2 T S}{L}$$

W = Breaking weight in pounds in centre.

D = Extreme diameter in inches.

T = Thickness in inches.

L = Length between supports in inches.

S = Ultimate tensile strength in pounds per square inch.

Taking S , the strength of a square inch of a riveted joint at 35,000 pounds, this rule figures as follows for the different examples experimented upon by Mr. Fairbairn :

$$\text{I. } 3.14 \times 144 \times 0.037 \times 35,000 \div 204 = 2,870$$

$$\text{II. } 3.14 \times 153.76 \times 0.113 \times 35,000 \div 187.5 = 10,190$$

$$\text{III. } 3.14 \times 312.5 \times 0.0631 \times 35,000 \div 282 = 7,700$$

$$\text{IV. } 3.14 \times 330.5 \times 0.119 \times 35,000 \div 282 = 15,320$$

The Hartford Street Railway Co.'s (Hartford, Conn.) chimney is 166 feet high, diameter of bell at base 190 inches, tapering to 129 inches diameter at a height of 21 feet. Twenty-one feet of $\frac{1}{4}$ -inch steel at bottom, 30 feet $\frac{1}{8}$ -inch steel, 30 feet $\frac{3}{8}$ -inch steel, 30 feet $\frac{1}{8}$ -inch steel, and 55 feet $\frac{1}{4}$ -inch steel at top. Ladder from top to within 2 feet of the base ; a 5 by $\frac{1}{4}$ -inch flat iron band around the top, on inside ; copper cornice 190 inches diameter by 114 inches high, of 24-ounce copper ; base plate 18 feet 6 inches square. This stack has $4\frac{1}{2}$ inches lining, thus making a 10 feet diameter flue.



ILLUS. No. 3.

HARTFORD STREET RAILWAY COMPANY'S CHIMNEY.

—

A close approximation between the breaking weights obtained by his experiments and those derived from Mr. Edwin Clarke's and Mr. D. K. Clark's rules will be observed. It may be assumed, therefore, that this system of calculation is practically correct, and that it is eminently safe when a large factor of safety is provided, and from the fact that a chimney may be standing for many years without receiving anything like the strain taken as the basis of the calculation—fifty pounds per square foot. Wind pressure at fifty pounds per square foot may be assumed to be travelling in a horizontal direction and be of the same velocity at all points between the top and the bottom of the stack. This is the extreme assumption. If, however, the chimney is round, its effective area will be only half of its diametral plane, that is, the entire force on round chimneys if concentrated in the centre of the height of the section of the chimney to be considered.

Taking the average diameter of a 125-foot chimney as 90 inches, the effective surface in square feet upon which the force of the wind may act will, therefore, be $7\frac{1}{2}$ times 125 divided by 2, which multiplied by 50, gives a total wind force of 23,437 pounds. The resistance of the chimney to breaking across the top of the foundation would be 3.14×168^2 (that is, diameter of base), multiplied by $.25 \times 35,000 \div (750 \times 4) = 258,486$, or 10.6 times the entire force of the wind. We multiply the half height above the joint in inches 750 by 4, because the chimney is considered a fixed beam with a load suspended at one end.

In calculating its strength half-way up, we have a beam of the same character, the beam in this case being fixed at a point half-way up the chimney, where it is 90 inches in diameter and .087 inch thick. Taking the diametral section above this point and the force as concentrated in the centre of it, or half-way up from the point under consideration, its breaking strength is: $3.14 \times 90^2 \times 0.187 \times 35,000 \div (381 \times 4) = 109,220$. The force of the wind to tear it apart through its cross-section at this line, $7\frac{1}{2} \times 62\frac{1}{2} \times 50 \div 2 = 11,725$, or a little more than one-tenth of the strength of the stack.

Riveting.—Not less than $\frac{1}{2}$ -inch rivets, and never a less diameter than the thickness of plate should be used.

For vertical or horizontal seams in flaring base the joints should be double-staggered riveting; above the bell a single riveted joint can usually be made use of, though for horizontal joints double-staggered riveted joint may often be most desirable and necessary—having a greater lap for sheet and consequently giving greater stiffness to the shell.

Button-head should invariably be used, with the button-head inside so as to present the least resistance to the gases.

Rivets should be spaced at least $2\frac{1}{2}$ times their diameter centre to centre, by a distance not any further apart than 16 times the thickness of the plate with which they connect; use all possible care to have the joint air tight and of sufficient strength.

In Releaux's "Constructor" is the following regarding riveted joints, which may be found of value in this connection.

Let s = thickness of plate.

d = diameter of rivet.

a = pitch of rivets, centre to centre of adjacent rivets.

n = number of rows of rivets.

ϕ = ratio of resistance of joint to full plate.

b' = overlap for shearing.

b'' = overlap for bending.

Overlap is the distance from centre of rivets to edge of plate.

In connection with the above we have the following table, No. 22, regarding lap-joints, which type is most frequently used in steel-chimney construction.

For ease of construction and economy also, the method of making the diameter of the circle between the plates the same for all joints is the best, and the upper end of each section should be placed inside the lower end of the section immediately above it. For brick-lined chimneys the reverse order is preferred.

In recent tests made of the flow of water under the direction of Clemens Herschel, of the East Jersey Water Company, of New York City, it has been found that the friction is appreciably less in pipes constructed as above over the style of one large course than one small one, and large one, etc.*

* Reference—One Hundred and Fifteen Experiments on the Flow of Water Through Riveted Pipes. Herschel. Published by John Wiley & Sons.

TABLE No. 22.

PROPORTIONS OF RIVETED JOINTS (RELEAUX'S "CONSTRUCTOR").

$\frac{a}{t} =$		1.0		1.5		2.0		2.5		3.0		4.0	
n		1	2	1	2	1	2	1	2	1	2	1	2
LAP JOINT.	$\frac{p}{t}$	1.63	2.22	2.92	4.33	4.52	7.04	6.43	10.47	8.67	14.33	14.07	24.14
	$\frac{b'}{t}$	0.89	0.89	0.88	0.88	1.57	1.57	2.54	2.54	3.53	3.53	6.28	6.28
	$\frac{b''}{t}$	1.06	1.06	1.78	1.78	2.58	2.58	3.46	3.46	4.31	4.31	6.48	6.48
	R	0.39	0.55	0.49	0.65	0.56	0.72	0.61	0.76	0.65	0.79	0.72	0.83
	$\frac{c}{s}$	0.63	0.63	0.94	0.94	1.26	1.26	1.57	1.57	1.88	1.88	2.51	2.51
$\frac{2nd}{5t} =$													
BUTT JOINT.	$\frac{p}{t}$	2.26	3.52	4.33	7.15	7.04	12.05	10.37	18.21	14.33	25.61	24.14	44.21
	$\frac{b'}{t}$	0.79	0.79	0.96	0.96	3.14	3.14	4.91	4.91	7.07	7.07	12.56	12.56
	$\frac{b''}{t}$	1.39	1.39	2.30	2.30	3.24	3.24	4.37	4.37	5.60	5.60	8.32	8.32
	R	0.56	0.72	0.65	0.79	0.72	0.83	0.76	0.86	0.79	0.90	0.83	0.94
	$\frac{c}{s}$	1.26	1.26	1.88	1.88	2.51	2.51	3.14	3.14	3.77	3.77	5.03	5.03

 d = diameter of rivet. t = thickness of plate. n = number of rows of rivets. p = centre to centre, or pitch of rivets. b' = lap for shearing conditions. b'' = lap for bending conditions. s = stress in the punched plate. R = ratio of resistance of joint to that of the full plate. c = pressure of rivet on thickness of plate.

Wherever possible one section in height should be made of one sheet in circumference, and the author prefers to make the bell one sheet in height by 6, 8, or 12 sheets direction of the circumference; joints in the latter to be double-staggered riveted.

We have the following graphic representation of the rule just given for stability of chimneys:

If the chimney is blown to the position of the angle indicated, or until the line from centre of pressure passes through the third of the foundation, indicated by the arrow, we have, by summation of moments, about $M = 0$ or zero.

$$(38) \quad (W_c + W_r) \frac{D_r}{3} = \text{wind-pressure} \left(\frac{h_c}{2} + h_r \right).$$

Collecting the data of a number of existing self-sustaining steel chimneys and plotting the results given in the last three columns on the right in the accompanying table, the author finds that a straight line fairly represents each mean, and for any chimney of steel—self-sustaining, the following equation holds good:

$$(39) \quad D_r = \frac{h_c^2 d}{26000} + 10.$$

Knowing h_c , h_r , which may be taken equal to or assumed a little less than D_r , W_c , D_r and wind-pressure, and substituting in equation, 38, we can obtain W_r for a given case. By substitution:

$$(40) \quad (W_c + W_r) \frac{D_r}{3} = 30h_c h_r d + 15h_c^2 d.$$


Knowing the least diameter of the base of the foundation we can readily calculate the cubical contents of the necessary

frustum of a cone by the following rule:

The contents of the frustum of a cone or pyramid are found by adding together the areas of the ends and the mean proportional between them (the square root of their product), and multiplying the sum by one-third of the perpendicular height.

In the event of the diameter of the base assumed for top and bottom of the foundation not giving enough weight, the size or area of base may be altered from round to

hexagon, or square, or built up straight for 2 or 3 feet from bottom, or the weight increased in other ways—at the pleasure of the designer.

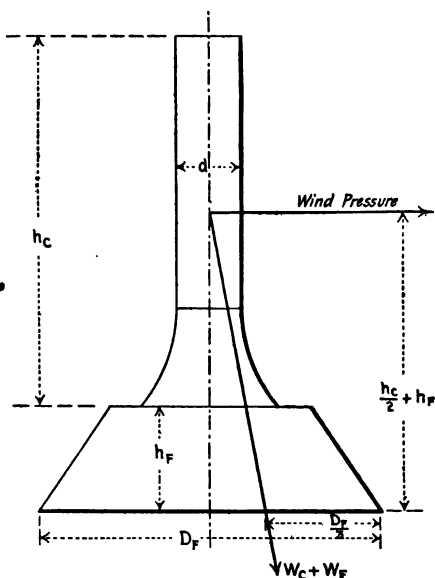

120 to 150 pounds per cubic foot is about the proper weight for such materials as enter into foundations of this character.

They should be made of any clean stone or brick-bats well grouted in Portland-cement mortar, thoroughly rammed.

The part out of the ground should be laid up with good-sized blocks of local quarry stone, rough dressed, or of brick.

The poorest soil will sustain about one ton load to the square foot of foundation area—quicksand not excepted, if it is properly covered over and confined.

Piling, however, is often resorted to in unstable bottoms, and along river-banks and in marshy lands.

Foundation.—The following is the rule for stability of steel chimneys and the relation to the foundation :

Find the total wind-pressure on the chimney and its moment about an axis in the plane of the base of the foundation.

Find also the total weight of the chimney with its lining, and of the foundation.

Divide the moment of the wind-pressure by the weight of the chimney and foundation ; the result will be the distance from the outer edge of the foundation to the resultant force due to the combined action of wind-pressure and weight.

If this resultant force is inside the middle third of the width of the foundation, the chimney is stable.

For the present case we have :

$$(41) \text{ Moment} = 150 \times 25 \times 5\frac{1}{2} \times \left(\frac{150}{2} + 16 \right) = 1918125 \text{ foot-lbs.,}$$

where 16 feet is the depth of the foundation.

Weight of chimney is 38000 pounds.

Weight of foundation is 400000 pounds.

Total weight = 438000 pounds.

As one-third of the base, or 16 feet, is $5\frac{1}{2}$ feet, 6 feet would be a safe resultant ; dividing 1,918,125 by 6 we have 319,687 pounds as the weight of foundation and shell, so our assumption of 400,000 pounds for foundation is heavier than is necessary.

$$(42) \text{ Moment} = h_c \times 30 \times \frac{h_c d}{2} = 30 \left(\frac{h_c^2}{2} \right) d.$$


Diameter at base of foundation = D_r .


Cubic feet of masonry in foundation = C .



TABLE No. 23.

Chimney.	$\frac{h_c^2 d}{2}$	D_r	σ	Foundation Depth.
No.		Feet.		Feet.
1.....	8,575	13 square	2,704	16
2.....	77,890	18 square	8,100	25
3.....	188,360	25 square	15,625	25
4.....	230,000	30 diameter	18,500	30
5.....	430,304	36 square	25,058	22
6.....	146,330	20 square	2,666	20
7.....	9,600	11½ square	632	5
8.....	22,500	15 diameter	1,340	9
9.....	10,666	10½ square	707	9
10.....	9,600	13 diameter	676	8
11.....	348,046	47 diameter	27,566	22
12.....	188,180	30 diameter	6,961	13½
13.....	35,156	15 square	2,250	10
14.....	17,150	10 square	588	8

Anchorage.—To anchor the chimney to the foundation, bolts or rods are used running from a foot fastened to the bell of the chimney through the base-plate nearly to the bottom of the masonry, terminating in a lock-nut cast-iron washer.

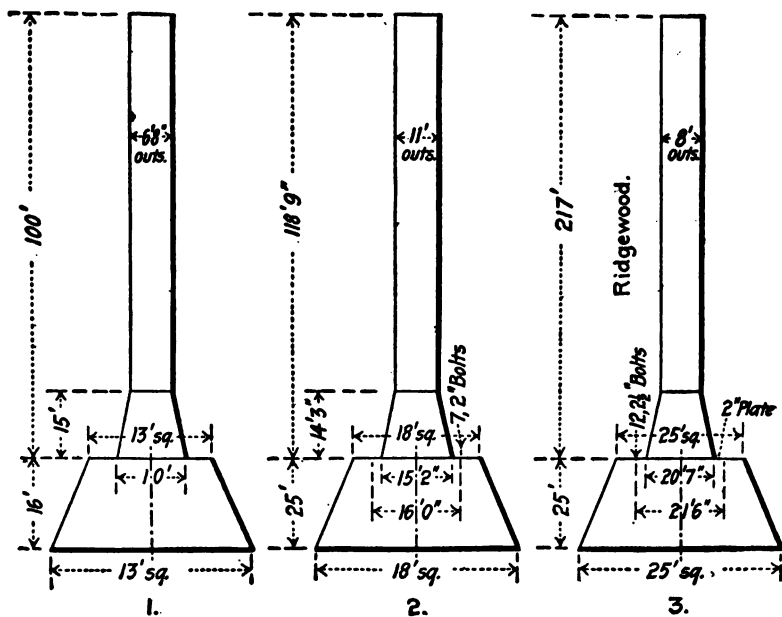

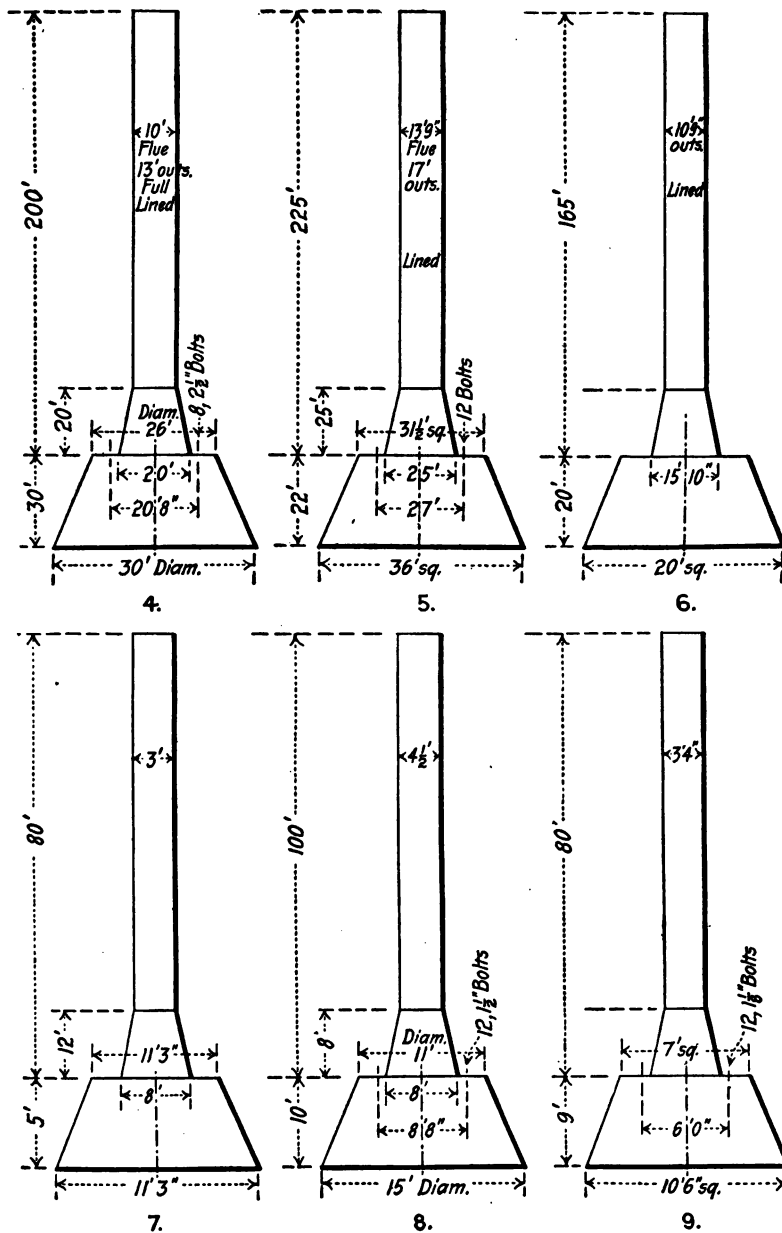

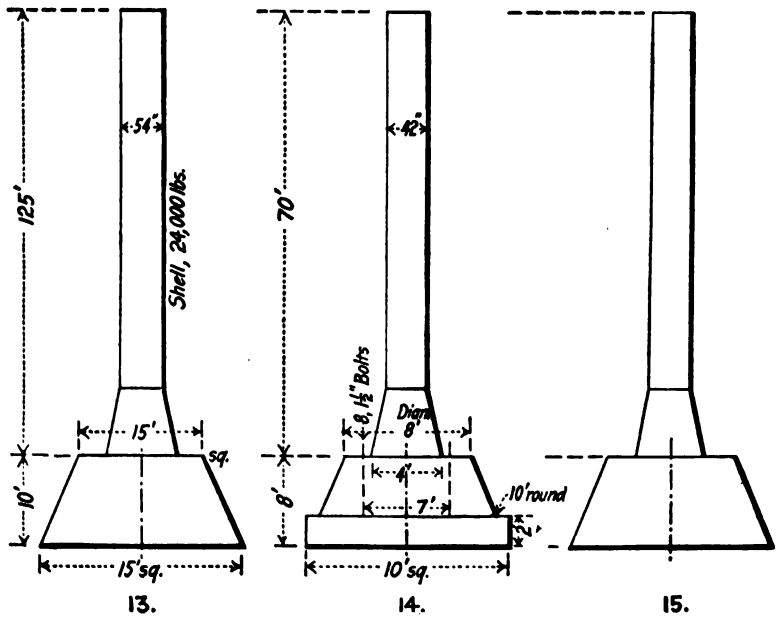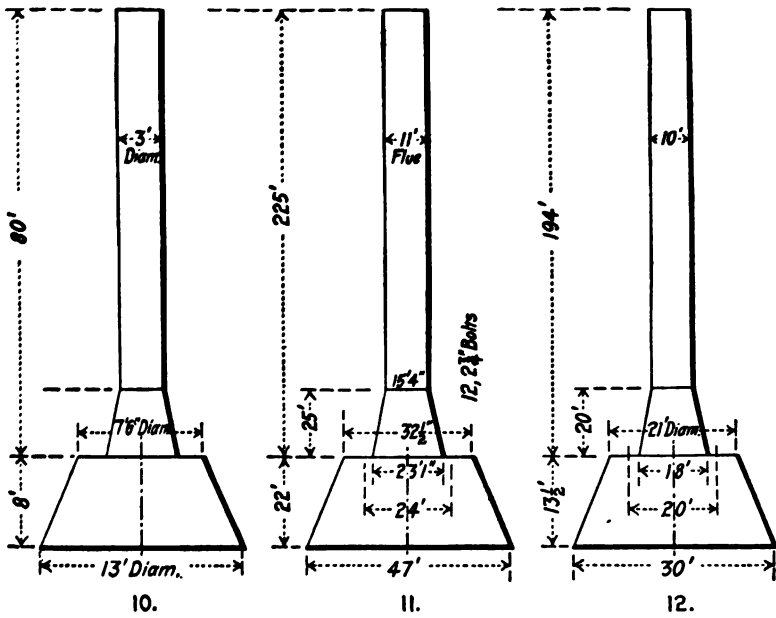

These anchor-bolts are both subjected to tension and shearing, but the chimney being not very likely to slide on its foundation, we neglect the shearing strain in our calculations.

As the lining of chimneys is not always in place or in good repair, we will neglect its weight, as it cannot be counted upon for assistance in keeping the chimney stable.

The overturning moment, M , is about the circumference of the largest diameter of the bell-base, or on a circle whose diameter is D_b and equals, $M = 25D_b \frac{H^2}{2}$. The weight of the steel shell being W , the moment of contrary effect to above, m is $m = W \times \frac{D_b}{2}$; which enables us to find the overturning moment $T = M - m$.

This is the moment on the foundation bolts, which are equally spaced in a circle, and are from 6 to 12 or even more in number, and the calculations for the bolts are made as follows:

Considering any point in the bolt circle, the approximate mean distance from the circumference of same on a line through the centre of the bolt circle to all of the bolts is the radius of that circle; and considering that one-half of the bolts only stand the strain, we have this equation:

$T_c = \frac{D_c}{2} \times \text{tension on bolts} = \frac{D_c}{2} \times 9000 \text{ pounds} \times \text{number of bolts} \times \text{area of one bolt.}$

Where D_c = diameter of bolt circle,

$$(43) \quad T_c = \left(T \times \frac{D_c}{2} \right) \div \frac{D_b}{2} \text{ or the moment on the foundation bolts.}$$

For 6 foundation bolts, $T_c = 27000 D_c \times \text{area of one bolt.}$

For 12 foundation bolts, $T_c = 54000 D_c \times \text{area of one bolt.}$

In reality the mean distance of bolts from circumference in the half circle considered is $\frac{D_c}{2} + \frac{D_c}{6}$, and we are considerably inside the safe limit in the former assumption.

For the application to the chimney under consideration

$$(44) \quad M = \frac{25 \times 5\frac{1}{2} \times 150 \times 15.0}{2} = 1546875.$$

Let $W = 38000$ pounds assumed,

$$(45) \quad m = \frac{38000 \times 11}{2} = 209000,$$

$$T = M - m = 1546875 - 209000 = 1337875.$$

$$(46) \quad \text{Let } D_c = 12\frac{1}{2}, \text{ then } T_c = \frac{1337875 \times 6}{5\frac{1}{2}} = 1459500.$$

(47) If 6 bolts are used, area of one bolt $= \frac{T_c}{27000 \times 11} = 4.91$ square inches for present case.

(48) If 12 bolts are used, area of one bolt $= \frac{T_c}{54000 \times 11} = 2.45$ square inches for present case.

Twelve bolts are the most convenient number to use, and if the base is made in 6 sections, 2 bolts will pass through each segment.

To ascertain the weight of the chimney, W , for the chimney being considered, the following thicknesses from the top down were used :

54 feet..... $\frac{3}{8}$ inch.	18 feet..... $\frac{3}{8}$ inch.
30 feet..... $\frac{1}{4}$ inch.	6 feet..... $\frac{1}{4}$ inch.
24 feet..... $\frac{1}{8}$ inch.	18 feet..... $\frac{3}{8}$ inch.

Base-ring.—The breadth of the base-ring can be readily determined by knowing the pressure on the base, but it is usually proportioned according to good practice, and with good judgment as accompanying conditions assist or compel.

STEEL CHIMNEY, GUYED, FOR AUGER & SIMON SILK DYEING COMPANY, PATERSON, N. J.

Flue 48 inches diameter by 125 feet high. Starting from the bottom with the foundation, which is 7 feet square at the bottom and 5 feet square at the top, 5 feet deep, 12 inches of which is out of the ground; the chimney rests on a cast-iron plate 5 feet square by $1\frac{1}{2}$ inches thick, having a rim 3 inches high inside of the shell of the chimney, this plate is held to the foundation by four $1\frac{1}{2}$ -inch bolts 4 feet long.

The shell is made in sections 5 feet $4\frac{1}{2}$ inches in height of plate, 5 feet centre to centre of joints, each vertical section being made of one sheet.

The lower 65 feet of the chimney is $\frac{1}{4}$ -inch thick steel; the upper 60 feet is $\frac{3}{8}$ -inch steel; the chimney has an ornamental cap of simple design.

All joints are double staggered riveting, $2\frac{1}{2}$ inches centre to centre of rivets.

The upper end of each section is put in place inside the lower end of the section above it.

The chimney is supported by four guy-ropes of $\frac{1}{2}$ -inch crucible-steel wire, six strands, 7 wires to each strand, laid about a hemp centre. These are strongly secured to the chimney at about 83 feet above its base and running from it to the ground, the ropes are made fast at about 80 feet from the base of the chimney to anchorages made of long pieces of 6-inch pipe placed in the ground at an angle of 45° , and the pipe has long timbers laid over it in the trenches to give large earth-bearing surface.

A turn-buckle is placed in each guy-rope for adjusting the tension of the same.

The chimney has stood well, and was erected in 1896.

A NOVEL WROUGHT-IRON CHIMNEY, CREUSOT, FRANCE.


Total height, 279 feet; diameter at base, 23 feet; diameter at top, 7 feet 6 inches. Total weight, 80 tons, exclusive of masonry foundation. The latter is carried 3 feet 3 inches above the ground level and weighs about 300 tons.

The shaft is successive rings, each 4 feet 1 inch high. Thickness of sheets vary from $\frac{1}{8}$ inch at bottom to $\frac{1}{4}$ inch at top.

The nine lower rings have 8 plates in each, the upper ones 4 plates.

The base is encircled by a massive *angle-iron ring* bolted to the foundation.

Fire-brick lines the eight lower rings, or about 32 feet in height; seventy days were required for its erection including removal of scaffolding, which consisted of a 7-inch wrought-iron central tube provided with four cross arms of wood, made adjustable, resting on outer ends on plates, which arms carried the inner platform. The upper end of tube had four similar arms, from which was slung the exterior circular platform, which

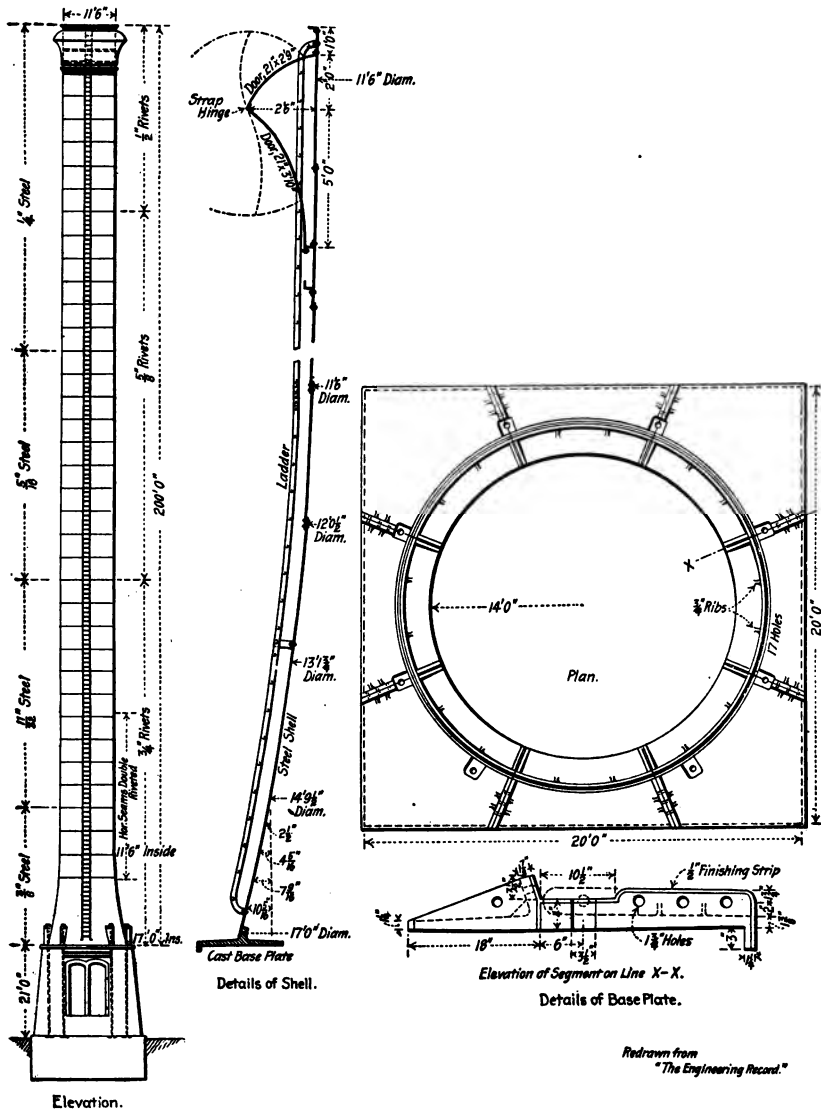

ILLUS. No. 5.

A 200-FOOT STEEL CHIMNEY, WILMERDING, PA.

consisted of a pair of angle-iron rings to the outer edge of which was riveted a plate-iron fence, while the inner part was provided with T-iron stanchions.

Radial bearing timbers, resting on these rings, and adjustable endwise, to suit the varying diameters of the chimney, carried the plate, from an annular space left just sufficient for hoisting the plates.

The plates were hoisted by a rope passed over an adjustable pulley fixed to each jib in turn, and carried down a central tube to a snatch-block fixed at the bottom of the chimney.

The complete scaffold weighed about 4 tons, the heaviest plate about 800 pounds. Total cost of steel part of chimney and lining was about \$8,000.—*Engineering News*, May 10, 1890.

Westinghouse Air Brake Co., at Wilmerding, Pa. Steel chimney, 200 feet high; built by Riter & Conley, Pittsburgh, Pa.



The construction is shown very fully by the illustration on p. 61.

It was designed to resist a wind-pressure of 50 pounds to the square foot with a factor of safety of 4.

The material is punched and formed in the shops, and the principal riveting is done in the field.

The ladder was shipped in 15 or 20 foot lengths. The work was erected by using inside scaffolding, with a centre derrick for raising the sheets, and outside cages for the workmen which are hung on trolleys running on the edge of the shell.

These were raised by the derrick, as each course was added. When the chimney was finished it was painted from a swing carriage suspended from the trolleys which run on the Z bar underneath the top ornament.

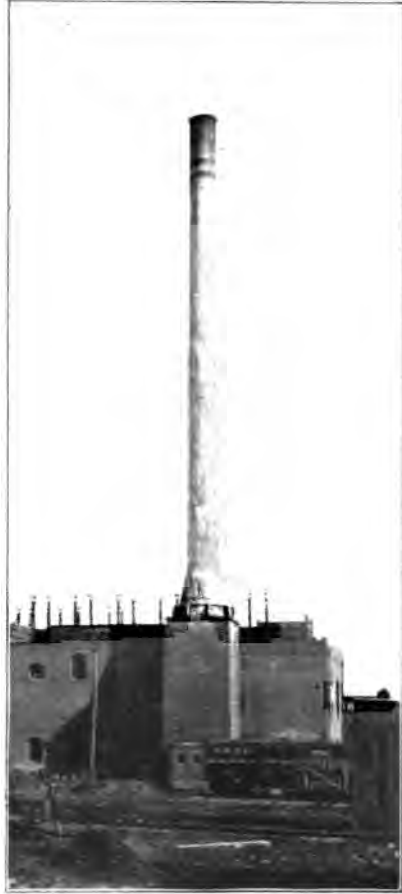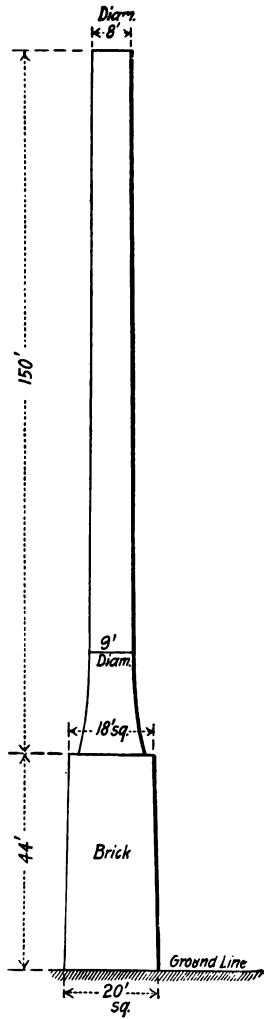

ILLUS. No. 6.

CHIMNEY OF THE REFRIGERATING PLANT OF THE ANHEUSER-BUSCH BREWING ASSOCIATION, ST. LOUIS, MO.

Steel Sheets.

Lower 50 ft.— $\frac{5}{8}$ inch thick.

Middle 50 ft.— $\frac{1}{2}$ inch thick.

Upper 50 ft.— $\frac{3}{8}$ inch thick.

The chimney is lined with fire-brick 125 feet up.

SELF-SUSTAINING STEEL CHIMNEY.

In the design of bases for the chimneys of this type, bell shapes are not strictly adhered to, in some cases, steel cables containing turn-buckles are secured to a straight steel tube at the height of say three diameters of the flue, and secured to the bottom anchor-bolts as usually located for bell bases.

In other cases two angle-irons riveted with thin separators are placed where the wire cable is located as above.

Still another method is very clearly illustrated in the cut on page 68; this chimney is 164 feet high.

Still another type of base is that shown in cut of Anheuser-Busch Brewing Association chimney on opposite page, being a square hollow-brick shaft.

Ladders.—Ladders are placed either within or without unlined chimneys, but always outside of lined chimneys.

Ornamental Caps.—Ornamental caps, as in the chimneys illustrated, are best made of copper, as they are then lighter and do not rust away as quickly as steel or iron caps, but they are expensive.

Ornamentation near the top of steel chimneys, at its best, is a poor investment, and very unsatisfactory, both architecturally and otherwise.

Painting.—Red-lead ground in linseed-oil, graphite paint, or the best quality of black asphaltum varnish should be used; two coats both inside and out should be given at erection, and one coat outside every year or two thereafter, for the proper protection against rust, etc.

Illus. No. 8 illustrates the general style of self-sustaining steel chimneys in and about Philadelphia, Pa. The following data pertain to chimneys of this style at that place:

A chimney 165 feet high, would be 15 feet 10 inches in diameter at the bottom of the bell, tapering to 10 feet 9 inches diameter in the straight part. Foundation would be a 20-foot cube.

A chimney 100 feet high would be 10 feet in diameter at the bottom of the bell, tapering to 6 feet 8 inches in diameter at a height of 15 feet from the base. In first 20 feet up from foundation of $\frac{3}{8}$ -inch steel; the next 30 feet up, $\frac{1}{2}$ -inch steel, and the

upper 50 feet of $\frac{1}{4}$ -inch steel. The foundation would be 16 feet high by 13 feet square.


Chimneys 100 feet high or less, are usually lined with red brick only to the top of the bell.

Angle-iron is often substituted at the top of the copper-moulded cap shown.

The bell is usually made in five rings of sheets 3 feet wide plus the lap, or 15 feet high altogether; the sheets above this being 5 feet or 6 feet wide plus the lap.


Ladders are put on chimneys over 100 feet high; under that height steel cable is placed over a pulley at the top, coming nearly to the ground so as to be used in hoisting a man to the top when it is necessary for painting or repair.

Chimney at the Guggenheim Smelting Company's Works, Perth Amboy, N. J., was 140 feet high, diameter at base 10 feet 6 inches, tapering in a height of 25 feet to 13 feet 6 inches diameter. Shell 35 feet of $\frac{1}{8}$ -inch steel at bottom, 35 feet $\frac{3}{8}$ -inch steel, 35 feet $\frac{1}{4}$ -inch steel, and 35 feet of $\frac{1}{4}$ -inch steel at top. Chimney has a 3 x 5 x $\frac{1}{8}$ -inch angle band around the top; also a Z iron band; ladder the entire height; base plate 23 feet 11 inches diameter. This stack has 9-inch brick lining, thus making a 12-foot diameter flue.

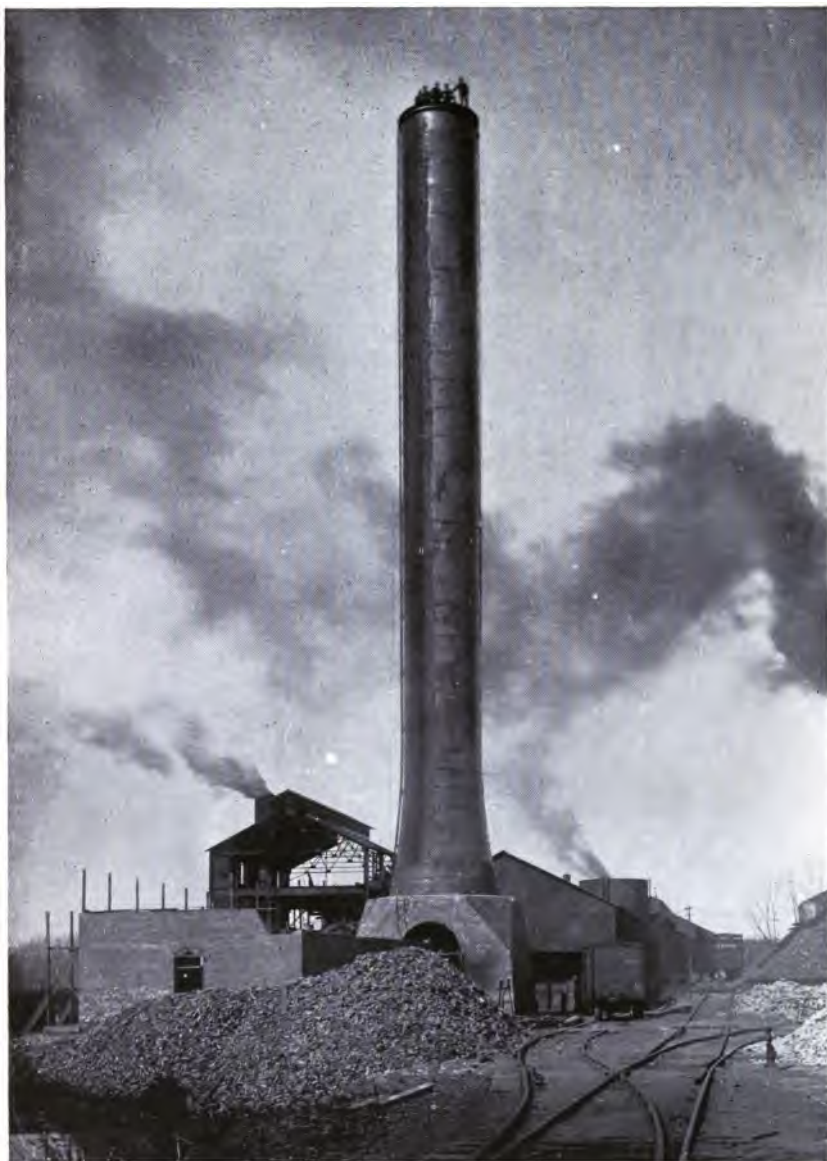

ILLUS. No. 7.

GUGGENHEIM SMELTING COMPANY, PERTH AMBOY, N. J.

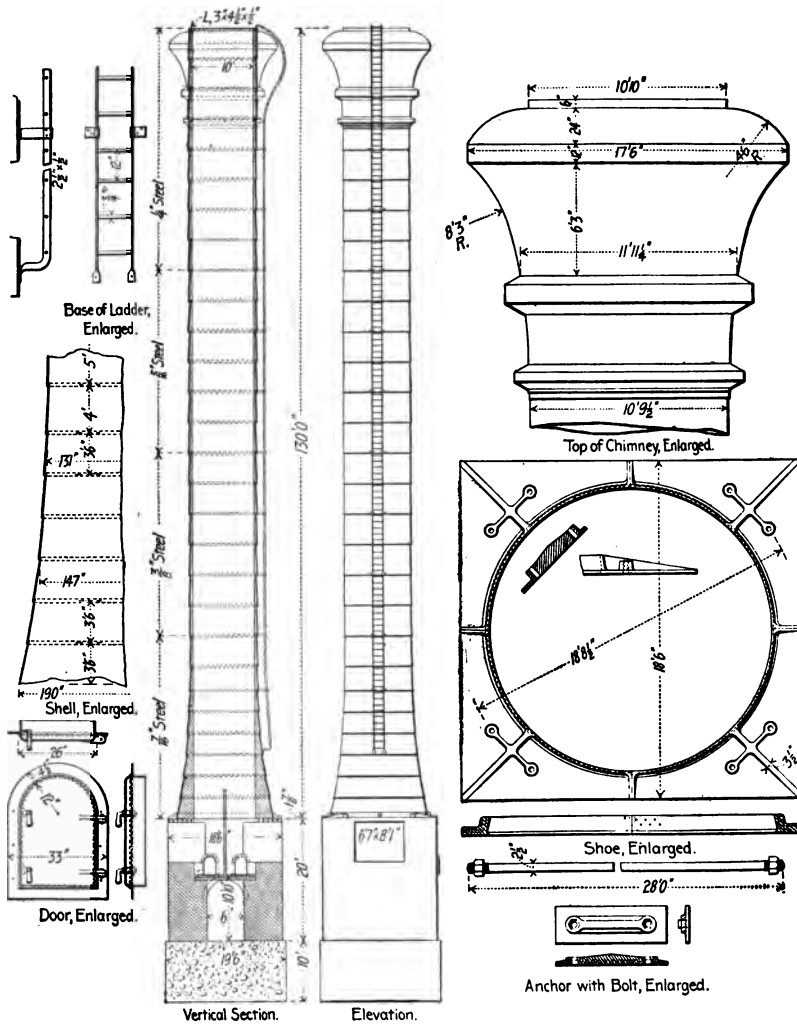


ILLUS. No. 8.

STEEL CHIMNEY AS USED IN AND ABOUT PHILADELPHIA, PA.

DESIGN AND CONSTRUCTION OF TALL STEEL STACKS.


When the large blast-furnace plant of the Maryland Steel Company, at Sparrow's Point, Md., was designed it was deemed advantageous to operate the eight 22 x 75-foot Whitwell blast stoves, and the eight batteries of Babcock & Wilcox water-tube boilers, aggregating 2,000 horse-powers, serving each pair of furnaces by means of one brick-lined steel chimney. Two such chimneys were constructed of 13 feet 9 inches internal diameter and 225 feet in height. Set upon masonry about 16 feet above the surface of the ground, and standing in an exposed situation, independent of guys or bracing. The weight of the metal in each stack is about 77 tons, of the brick about 900 tons, and of the masonry pedestal and foundations about 1,600 tons, making a total of about 2,600 tons, as against 7,400 tons, which a structure of the same height and internal diameter is estimated to weigh if made entirely of brick, stone, and concrete.

The soil on which the chimney was constructed consisted of compact clay, which was excavated to a depth of 6 feet. The first course of stone was laid dry immediately on the clay. No piling was resorted to, and the foundation was built of good masonry in courses to a height of 16 feet above ground level. The base of the stack was made 40 feet square. The load per square foot of foundation area was thus 1.62 tons, and no settlement or irregularity has yet been observed. The masonry was large dimensioned stone, quarry-faced, with dressed arrises, set in a mortar of 1 Portland cement and 3 sand. The inside of smoke tunnels and the shaft was lined with brick offset to form walls of diminishing thickness, decreasing every 40 feet in height by one ring of brick, or in all from seven to two rings of brick.—See Kent, p. 741, for further description.

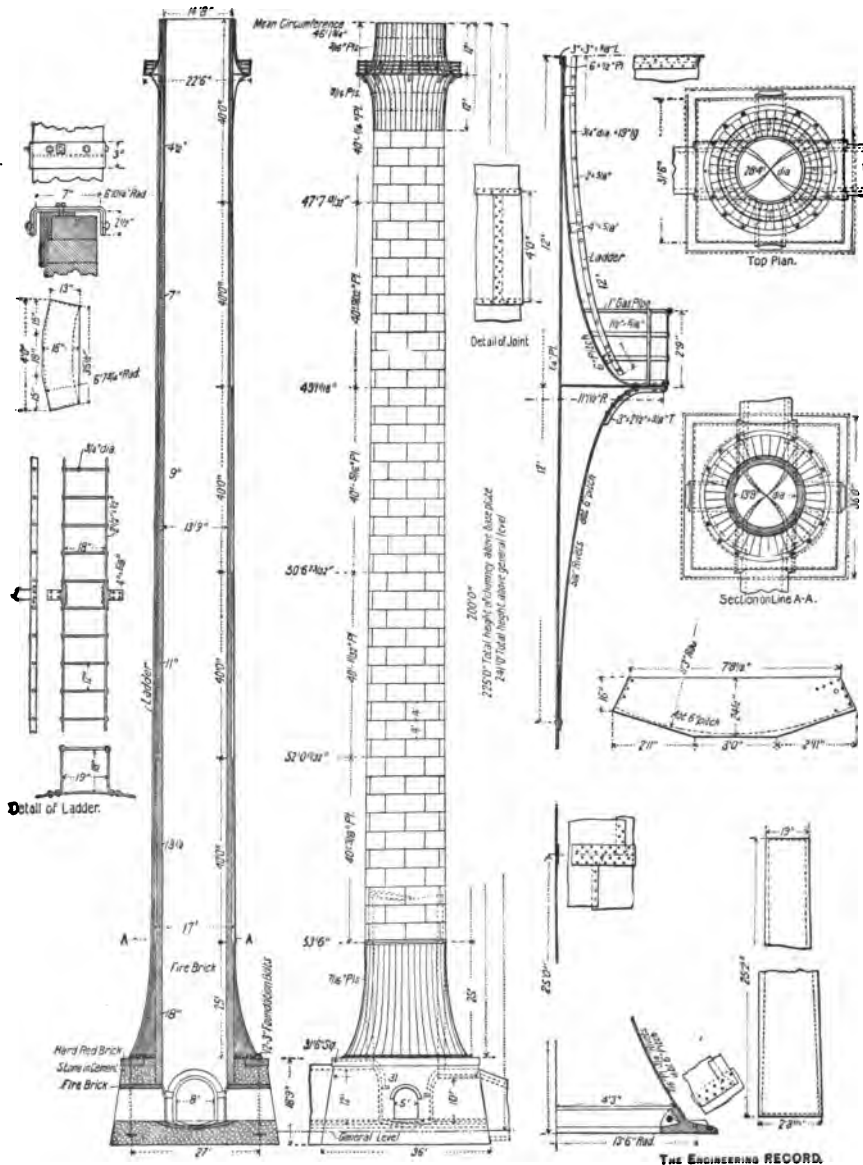

ILLUS. No. 9.

STEEL CHIMNEY, MARYLAND STEEL COMPANY.

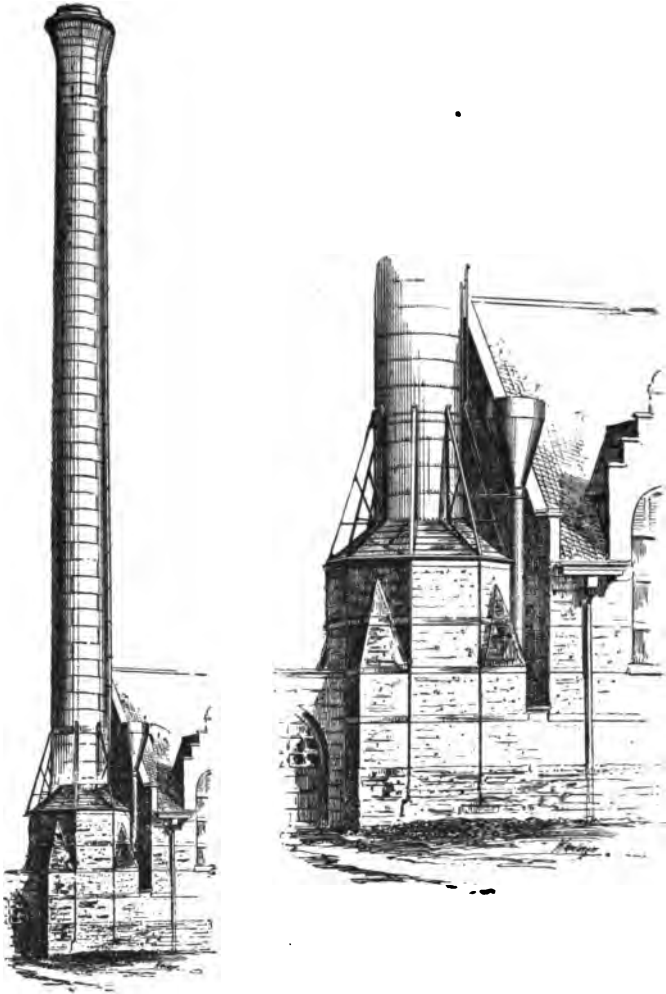

ILLUS. No. 10.

STEEL CHIMNEY, ELECTRIC LIGHT AND POWER CO., GARFIELD PARK, CHICAGO, ILL.

Flue, — diam. by 164 feet high.

1. Pennsylvania Railroad Company, at Jersey City, N. J., built 1892.

Base-plate, cast iron.

Flue, 4 feet 8 inches in diameter by 125 feet high.

Upper half of shell, $\frac{1}{4}$ -inch steel.

Lower half of shell, $\frac{5}{16}$ -inch steel, except bottom sheet of $\frac{3}{8}$ -inch steel.

Diameter outside at bottom, 12 feet 6 inches.

Diameter outside at top, 6 feet 10 inches.

Lined throughout with 12 inches of brickwork.

Vertical seams—rivets, $\frac{5}{8}$ -inch diameter, 3-inch pitch.

Horizontal seams—rivets, $\frac{5}{8}$ -inch diameter, $3\frac{1}{2}$ -inch pitch.

2. Cleveland Electric Illuminating Company, Cleveland, O.

Lined chimney, 11 feet 6 inches diameter by 225 feet high.

(See *Engineering Record*, vol. xxxv., p. 386.)

3. Westinghouse Electric Company, Wilmerding, Pa.

Flue, 11 feet 6 inches diameter by 200 feet high. (See description and cut, pp. 61 and 62.)

4. Bronx Company, Bronxville, N. Y.

Flue, 4 feet 6 inches diameter by 100 feet high.

5. Hartford Street Railway Company, Hartford, Conn., and

6. Manhattan Street Railway Company, Brooklyn, N. Y.

Height, 165 feet.

Diameter at top, 10 feet 9 inches.

Diameter at bottom of bell, 15 feet 10 inches, tapering to 10 feet 9 inches in straight part of chimney.

The foundation is a 20-foot cube.

7. Burden Iron Company, Troy, N. Y.

6 feet 3 inches diameter; 150 feet high.

8. Ridgewood Pumping Station, Brooklyn, N. Y.

8 feet diameter by 217 feet high. (See description and cut, p. 58.)

9. Potomac Light and Power Company, Washington, D. C.

9 feet diameter by 200 feet high.

10. City and Suburban Railway Company, Baltimore, Md.

Two chimneys, 11 feet diameter by 118 feet 9 inches high.

Two stacks are provided, one for each $2\frac{1}{2}$ batteries. These stacks are of steel plate, lined with fire-brick. The metal

stacks rest upon brick piers 18 feet square, of sufficient height (21 feet 6 inches above the boiler-room floor) to take in brick smoke-flues, thus avoiding any cutting of the metal stack, which is weakening and also an unsatisfactory detail to some designers.

The stacks are 11 feet in diameter by 118 feet 9 inches high above the top of the brick pier. The lower section of 14 feet 3 inches is cone-shaped, 15 feet 2 inches in diameter where it rests upon the brick pier. The base-plate is of heavy cast iron, anchored to the pier with seven 2-inch bolts each 24 feet 6 inches long, built into the pier with large anchor-washers; these bolts are up-set $2\frac{1}{2}$ inches for the nut.

The cone-shaped section is $\frac{5}{8}$ inch thick, and the heights of the other sections and the thickness of the steel are as follows: second, 15 feet, $\frac{1}{8}$ inch thick; third, 15 feet, $\frac{1}{2}$ inch thick; fourth, 15 feet, $\frac{1}{8}$ inch thick; fifth, 20 feet, $\frac{3}{8}$ inch thick; sixth, 20 feet, $\frac{1}{8}$ inch thick; balance, 33 feet 9 inches, $\frac{1}{2}$ inch thick. Around the top is riveted a heavy angle-iron stiffening.

11. Cleveland Rolling Mill, Cleveland, Ohio.

11 feet diameter by 190 feet high. (See description, p. 73.)

12. East Boston Electric Railway Power Station, Boston, Mass.

5 feet diameter of flue by 130 feet high.

Outlet for furnaces of 4 Corliss boilers with a total of 8,672 square feet of heating surface. (*Engineering Record*, November, 1894.)

13. Creusot, France.

7 feet 6 inches diameter by 279 feet high. (See description, p. 60, *Engineering News*, May 10, 1890.)

14. Maryland Steel Company, Sparrow's Point, Md.

13 feet 9 inches diameter by 225 feet high. (See description and cut, pp. 66 and 67.)

15. Hartman General Electric Company, Duluth, Minn.

7 feet 6 inches diameter by 200 feet high.

16. Etna Iron Works, Ironton, Ohio.

9 feet diameter by 200 feet high. (Built in 1874.)

17. East River Gas Company, Long Island City, N. Y.
6 feet diameter by 150 feet high.
18. United Glass Company, Chicago, Ill.
6 feet diameter by 125 feet high.
19. Aspinook Company, Jewett City, Conn.
6 feet diameter by 100 feet high.
20. Consolidated Gas Company of New Jersey, Long Branch, N. J.
Not lined; 5 feet diameter of flue by 130 feet high, built in 1896.
21. Consolidated Gas Company of New Jersey, Long Branch, N. J.
6 feet diameter of flue by 120 feet high, built in 1897.
22. Arnold Print Works, North Adams, Mass.
Built in 1896. 42 inches diameter by 100 feet high—guyed.
23. Arnold Print Works, North Adams, Mass.
60 inches diameter by 130 feet high—guyed.
24. Arnold Print Works, North Adams, Mass.
88 inches diameter by 128 feet high—guyed.
Of the latter the lower 23 feet is $\frac{3}{8}$ -inch steel,
the next 50 feet is $\frac{1}{2}$ -inch steel,
the upper 55 feet is $\frac{1}{4}$ -inch steel.
Base-plate is of cast iron, 14 feet diameter, $2\frac{1}{2}$ inches thick, with a shoulder-ring $3\frac{1}{2}$ inches high by 2 inches thick to go inside of the chimney, and with rivets through same.
Total weight of chimney and base-plate, 22 tons.
Through the base-plate were eight $1\frac{1}{2}$ -inch bolts for anchorage.
Each of these chimneys was erected in one piece.
(*Power*, November, 1896.)
25. Darwin and Mostyn Iron Company.
Height above foundation, 260 feet.
Depth of foundation, 15 feet.
External diameter at base, 27 feet 6 inches; external diameter at top, 11 feet.
Weight of chimney with foundation, 1,100 tons; weight of equivalent brick chimney, 3,000 tons.

26. Kineshmia, Russia.
170 feet high.
27. Middlesborough, England.
165 feet high.
28. Gottfried Brewing Company, Chicago, Ill.
Outside diameter 9 feet 5 inches by 175 feet ; lined.
Steel varies in thickness from $\frac{3}{8}$ inch at the top to $\frac{3}{4}$ inch at the bottom.
The lower 75 feet is lined with fire-brick 8 inches deep, formed to fit the shell ; above this is a hollow-tile lining.
The lining is supported at intervals of 25 feet by an angle-iron riveted to the shell.
The foundation is one layer of cement, then two layers of steel rails in cement, then one layer of I-beams, on which the cast-iron base-plate rests.
This chimney furnishes draft to 12 boilers, 60 inches diameter by 20 feet long.
29. Straight-Line Engine Works, Syracuse, N. Y.
Unlined, of No. 10 iron, self-supporting ; 79 feet high.
38 inches diameter at top, and 40 inches at bottom.
It has stood gales which demolished large trees, and is built with the top end of the first piece outside of the bottom end of the piece above. (*Power*, December, 1896.)
30. Toledo Traction Company, Toledo, Ohio.
Lined with fire-brick and tile ; self-supporting.
Flue 13 feet inside diameter by 213 feet high.
Furnishes draft for four 300 horse-power Sterling boilers.
Furnishes draft for four 200 horse-power Heine boilers.
To run four 1,200 indicated horse-power Green-Wheelock engines.
Thirteen pounds steam per indicated horse-power is guaranteed. (*Electrical Engineer*, January 6, 1897.)
31. Schneider's, Creusot, France.
Top diameter, $27\frac{1}{2}$ inches, by 98 feet 6 inches high.
London *Engineering*, p. 419, 1898, gives an illustration of these chimneys, or one of them being erected in one piece.

32. Dublin (Ireland) United Tramways Company.

2 steel-lined self-supporting chimneys, 10 feet diameter by 200 feet high, on brick bases, which are 26 feet high. Total height of chimney, 226 feet.

33. Metropolitan Street Railway Company, Kansas City, Mo.

Self-supporting steel chimney ; flue, 8 feet 4 inches diameter by 175 feet high ; shell, 10 feet 6 inches diameter. (*Engineering News*, April 8, 1897.)

34. Edison Lighting Station, New York City.

Two steel-lined chimneys.

Flue, 12 feet diameter by 139 feet high, from ceiling or base to top.

The upper 74 feet 9 inches is self-supporting, the cast-iron base of which is secured by eight 1½-inch anchor-bolts passing down 32 feet in wall.

The *Engineering Record*, vol. xxx., p. 44, contains a detail cut of these chimneys, showing a very ingenious expansion-joint, at the place where cast-iron cap above-mentioned is set.

35. Elevated Railroad Company, Chicago, Ill.

Self-supporting steel chimney.

Flue, 5 feet diameter by 120 feet high, lined.

To furnish draft to three 150 horse-power Heine boilers.

36. Cleveland Rolling Mill Company, Cleveland, Ohio. Engineers and constructors, Messrs. Witherow & Gorden, Pittsburg, Pa.; built September, 1881. About 50 days were occupied in its erection, apart from the building of the foundation proper.

Dimensions.—

Height, including foundations.....	213 feet 6 inches.
Height, from ground line to top.....	190 feet 0 inches.
Height of bell-shaped base.....	21 feet 0 inches.
Outside measurement of foundation.....	30 feet 6 inches.
Outside diameter at foot of bell-base..	21 feet 2 inches.
Outside diameter at top of bell-base	13 feet 0 inches.
Outside diameter at top.....	12 feet 0 inches.
Internal diameter throughout.....	11 feet 0 inches.

Foundation.—Stone, laid in cement, and is situate in what is termed the "Bottom," next to Cuyahoga River, where the ground is all of alluvial formation. For such a load as this

chimney the foundation required close piling ; the piles were driven 23 feet to 24 feet in depth, and almost in contact with each other ; through the stone foundation eight $2\frac{1}{2}$ -inch bolts were passed, connecting a circular cast-iron foundation-plate of T-section, 18 inches by $8\frac{1}{4}$ inches at bottom of stonework, to similar casting upon the top of stone foundation ; this top circular ring or base-plate is formed with a projecting flange placed at an angle of sixty degrees to receive plates forming bell-shaped base, 2 feet above ground.

Construction.—The chimney was constructed by inside scaffolding, and built up one plate high at a time ; the workmen hanging what is called a “cage” on the plates, to serve as a stand for the “holder on” while riveting the plates *in situ*.

Bell-shaped Base.—The plates forming the base are bolted to the flange of chimney base-ring by $\frac{3}{4}$ -inch bolts, and when completed to a height of 21 feet form a bell-shaped base 21 feet 2 inches diameter at bottom, and 13 feet 6 inches at top.


Shaft.—From the top of bell-shaped base the wrought-iron outer casing is continued to height of 21 feet from below top ; from this point the cap is formed as shown in drawing.

Rivets and Riveting.—The plates are all riveted together with a lap of two inches ; the constructors used conical-shaped rivet-heads, and the diameter of rivets for this class of work is as near as possible twice the thickness or upward of plate, and the pitch of rivets is 5 diameters.

Ladder.—A wrought-iron ladder is fixed to the outside.

Fire-brick Lining.—A fire-brick lining was built up through the entire height of the chimney, commencing at junction of flues at foundation with a thickness of 18 inches, and finishing at top 5 inches thick. The internal diameter, when finished with lining, is 11 feet, and constant throughout its height ; the radiated fire-bricks were of five sizes, purposely made.

Stability.—The chimneys built on this plan are calculated to withstand 50 pounds wind-pressure per square foot with safety ; the constructors say the climate of America is dry, and no doubt better for such structures than the climate of England ; they believe that no one alive at the present time will see the end of a wrought-iron chimney, lined with brick ; the oldest ones in America show no material deterioration. Cost, complete, \$13,000.

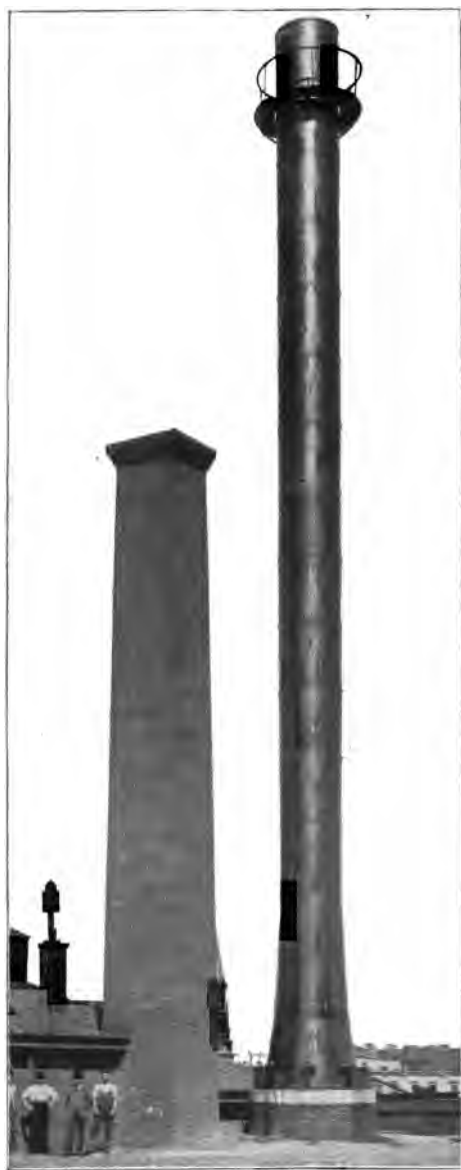

ILLUS. No. 11.

SELF-SUSTAINING STEEL CHIMNEY (WOOLSON).

Dimensions.—54 inches diameter x 85 feet above foundation, 100 feet from ground.

CHAPTER VII

BRICK CHIMNEYS—THEORY PERTAINING TO SAME, AND EXAMPLES FROM EXISTING STRUCTURES

RULES FOR BRICK CHIMNEYS.

MOLESWORTH'S "Pocket Book" gives the following: "Diameter outside of the base, not less than one-tenth the height; batter of outside, 0.3 inch per foot; thickness of brickwork, one brick from top to 25 feet down; one and one-half brick from 25 feet to 50 feet, etc. If inside diameter exceeds 4 feet at the top, the top thickness should be one and one-half bricks; if less than three feet it may be one-half brick for the first 10 feet down."

The Metropolitan Board of Works Rules for furnace chimney shafts contain this: Brickwork should be at least $8\frac{1}{2}$ inches thick at the top, and for 20 feet below, and must be increased $4\frac{1}{2}$ inches every 20 feet of additional height measured downward. There should be no cornice or projection of more than $8\frac{1}{2}$ inches at the top of the shaft.

The author would advise making the lengths of each varying thickness 20 to 30 feet, with an outside batter of 1 in 30 to 1 in 36, and also running the inner core to within a few feet of the top, but not to connect it with the outside shell; in all cases calculate each section for stability, which will also aid in determining the thickness of brickwork.

One authority suggests for a brick chimney 100 feet high, an outer shell in three steps, the first 20 feet, 16 inches thick; the second 30 feet, 12 inches thick; the third 50 feet, 8 inches thick—all minimum thicknesses; batter not less than 1 in 36 to give stability. The core should be in three steps of equal height, 12, 8, and 4 inches thick.

Brick chimneys should not be connected in a structural manner with any other structure, owing to both their swaying motion and expansion by heat. A chimney near Marseilles, 115 feet high was observed to oscillate one foot eight inches; when a sudden gust of wind struck the shaft it would vibrate four or five times before coming to rest. Excessive oscillations are frequently prevented by loading the cap.

CHIMNEY DESIGN.

M. Bassine—*Engineering News*, April 22, p. 247—considers a chimney as a vertical beam fixed at the base, and thus determines the limiting conditions of pressure and tension in the different horizontal sections. He recommends an exterior profile with a batter ranging from 33.1 on 1 to 25 on 1, and divides the vertical height into sections of from 16 to 20 feet each, with the thickness of wall constant for each section, and decreasing by $1\frac{1}{2}$ to $2\frac{1}{2}$ inches in each ascending section. He prefers an octagonal base with a height equal to one-fifth of the height of the chimney. The foundation should be a truncated pyramid with a square base, and sides inclined at an angle of at least 45 degrees. The length of the sides of the foundation should vary between $\frac{1}{4}$ and $\frac{1}{3}$ of the height of the chimney.

Stability.—Rankine says: "It had been previously ascertained, by observation of the success and failure of actual chimneys, and especially those which respectively stood and fell during the violent storms of 1856, that in order that a round chimney may be sufficiently stable, its weight should be such that a pressure of wind, of about 55 lbs. per square foot of a plane surface, directly facing the wind, or $27\frac{1}{2}$ lbs. per square foot of the plane projection of a cylindrical surface, . . . shall not cause the resultant pressure at any bed-joint to deviate from the axis of the chimney by more than one-quarter of the outside diameter at that joint."

The angle of repose for dry masonry and brickwork is 31 to 35 degrees, and the coefficient of friction, 0.6 to 0.7; the coefficient of friction for masonry on dry clay is 0.51; the coefficient of friction for masonry on wet clay is 0.33.

Rankine says: "Towers and chimneys are exposed to the

lateral pressure of the wind, which may be assumed to be horizontal, and of uniform intensity at all levels." The inclination of the surface of a tower or a chimney to the vertical is seldom sufficient to be worth taking into account, in determining the pressure of the wind against it.

The greatest intensity of the pressure of the wind against a flat surface directly opposed to it, hitherto observed in Great Britain, has been 55 lbs. per square foot. Note, see p. 30. St. Louis, Mo., chimney in tornado; and this result, obtained by observations with anemometers, has been verified by the effects of certain violent storms in destroying chimneys and other structures.

In any other climate, before designing a structure intended to resist the lateral pressure of the wind, the greatest intensity of that pressure should be ascertained either by direct experiment, or by observations of effects of the wind on previous structures.

The total pressure of the wind against the side of a cylinder is about one-half the total pressure against a diametral plane of that cylinder.

Let Fig. 1 represent a chimney of any section, and let it be required to determine the conditions of stability of a given bed-joint DE . Let A denote the area of a diametral vertical section of the part of the chimney above the given joint, and p the greatest intensity of pressure of the wind against a flat surface.

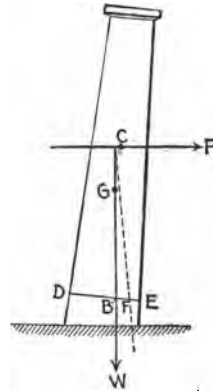


FIG. 1.

Then the total pressure of wind against the chimney will be sensibly :

$$P = pA \text{ for a square chimney ;}$$

$$P = p \frac{A}{2} \text{ for a round chimney ;}$$

$$P = \frac{3}{4} pA \text{ for a hexagonal chimney ;}$$

$$P = 0.7 pA \text{ for an octagonal chimney ;}$$

and its resultant may, without appreciable error, be assumed to act in a horizontal line through the centre of gravity of the

vertical diametral section C . Let H denote the height of that centre above the joint DE ; then the moment of the pressure is

$$H \times P = HpA \text{ for a square chimney;}$$

$$H \times P = Hp \frac{A}{2} \text{ for a round chimney;}$$

$$H \times P = Hp \frac{1}{4} A \text{ for a hexagonal chimney;}$$

$$H \times P = Hp \times 0.7A \text{ for an octagonal chimney;}$$

and to this the least moment of stability of the portion of the chimney above the joint DE should be equal.

For a chimney whose axis is vertical, the moment of stability is the same in all directions.

But few chimneys have their axes exactly vertical, and the least moment of stability is obviously that which opposes a lateral pressure acting in that direction in which the chimney leans.

Let G be the centre of gravity of the part of the chimney which is above the joint DE and B , a point in the joint DE vertically below it; and let the line $\overline{DE} = t$ represent the diameter of that joint which traverses the joint B . Let q' represent the ratio which the deviation of B from the middle of the diameter DE bears to the length t of that diameter.

Then the least moment of stability is denoted by

$$(49) \quad W \times \overline{BF} = (q - q') Wt.$$

The value of the co-efficient q is determined by considering the manner in which chimneys are observed to give way to the pressure of the wind.

This is generally observed to commence by the opening of one of the bed-joints, such as DE at the windward side of the chimney.

A crack thus begins which extends itself in a zig-zag form diagonally downward along both sides of the chimney, tending to separate it into two parts, an upper leeward part and a lower windward part, divided by a fissure from each other.

The final destruction of the chimney takes place, either by the horizontal shifting of the upper division until it loses its support from below, or by the crushing of a portion of the brickwork at the leeward side, from the too great concentration

of pressure upon it, or by both causes combined ; and in either case the upper portion of the structure falls in a shower of fragments, partly into the interior of the portion left standing, and partly on the ground beside its base.

It is obvious that, in order that the stability of a chimney may be secure, no bed-joint ought to tend to open at its windward edge ; that is to say, there ought to be some pressure at every point of each bed-joint, except the extreme windward edge, where the intensity may diminish to nothing ; and this condition is fulfilled with sufficient accuracy for practical purposes, by assuming the pressure to be an uniformly varying pressure, and so limiting the position of the centre of pressure F , that the intensity of the leeward edge, E , shall be double the mean intensity.

Chimneys in general consist of a hollow shell of brickwork, whose thickness is small compared with its diameter ; and in that case it is sufficiently accurate for practical purposes to give q the following values :

For square chimneys, $q = \frac{1}{3}$;

For round chimneys, $q = \frac{1}{4}$;

For other shapes, $q = \frac{\text{Moment of Inertia.}}{2Fe^2}$

F = area of section.

e = distance of outer fibre from neutral axis.

The following general equation, between the moment of stability and the moment of external pressure, expresses the condition of stability of a chimney :

$$(50) \quad HP = (q - q') Wt.$$

This becomes, when applied to square chimneys ;

$$(51) \quad HpA = (\frac{1}{3} - q') Wt ;$$

and when applied to round chimneys ;

$$(52) \quad \frac{HpA}{2} = (\frac{1}{4} - q') Wt.$$

The following approximate formulæ, deduced from these equations, are useful in practice :

Let B be the main thickness of brickwork above the joint

DE under consideration, and *b* the thickness to which that brickwork would be reduced if it were spread out flat upon an area equal to the external area of the chimney. That reduced thickness is given with sufficient accuracy by the formula :

$$(53) \quad b = B \left(1 - \frac{B}{t} \right),$$

but in most cases the difference between *b* and *B* may be neglected.

Let *W* be the weight of a unit of volume of brickwork ; being on an average 112 lbs. per cubic foot, or, if the brick are dense, and laid very closely, with thin layers of mortar in the joints, from 115 to 120 lbs. per cubic foot should be used. Then we have approximately

$$(54) \quad \text{for square chimneys, } W = 4wbA ;$$

$$(55) \quad \text{for round chimneys, } W = 3.14wbA ;$$

which values, being substituted in previous equations, give the following :

$$(56) \quad \text{for square chimneys, } Hp = (\frac{1}{4} - 4q') wbt ;$$

$$(57) \quad \text{for round chimneys, } Hp = (1.57 - 6.28q') wbt.$$

These formulæ serve two purposes, first, when the greatest intensity of the pressure of the wind, *p*, and the external form and dimensions of a proposed chimney are given, to find the mean reduced thickness of brickwork, *b*, required above each bed-joint, in order to insure stability ; and secondly, when the dimensions and form and the thickness of the brickwork of a chimney are given, to find the greatest intensity of pressure of wind which it will sustain with safety.

The shell of a chimney consists of a series of divisions, one above the other, the thickness being uniform in each division, but diminishing upward from division to division. The bed-joints between the divisions where the thickness of brickwork changes (including the bed-joint at the base of the chimney) have obviously less stability than the intermediate joints ; hence it is only to the former set of joints that it is necessary to apply the formulæ.

Making $q' = 0$ we have

for square chimneys, $Hp = \frac{1}{2}wbt$;

for round chimneys, $Hp = 1.57wbt$.

If $w = 115$ lbs. and $p =$ wind pressure of 50 lbs. then

for square chimneys, $H = 3.06bt$;

$t =$ diameter of chimney on plane considered,

for round chimneys, $H = 3.611bt$.

Rankine's calculations upon the stability of the outer core of a 455½-feet chimney at Glasgow, Scotland, are as follows :

TABLE No. 24.

Divisions of chimney.	Height above ground.	External diameter.	Thicknesses.	Greatest pressure of wind consistent with security. Lbs. per square foot.
	Feet.	Feet. Inches.	Feet. Inches.	
V	435½	13 6	1 2	77
IV	350½	16 9	1 6	55*
III	210½	24 0	1 10½	57
II	114½	30 6	2 3	63
I	0 to 54½	{ 35 0 to 40 0 }	2 7½	71

* Joint of least stability.

Fifty-five lbs. is but 4 lbs. above the highest noted wind pressure in the west of England.

The external diameter of the foundation of this chimney is 50 feet.

GENERAL NOTES.

Material.—All material entering into the construction of a chimney, its connections, and foundations should be of the best obtainable of their respective kinds. This applies even more forcibly to steel chimneys.

Progress.—Foundations for brick chimneys should be laid up a month before the superstructure is built to allow the mortar to set thoroughly and harden; after this the shaft should be erected at from three to five feet of height per day, and the walls should be trued up or plumbed every three feet in height with the greatest care.


Weather.—Brick chimneys should be commenced and fin-

ished in the spring or summer months ; take advantage of fine days, and do not lay brick at frosty or freezing temperatures.

Bonding.—In England some chimneys are laid up in Flemish Bond ; some in half brick bond, twice as many stretches as in Old English Bond. In the United States a great many chimneys are laid up in a bond made of one course of headers to five or six courses of stretchers, as shown.


Often in large brick chimneys, an iron band or hoop, such as $\frac{1}{4}$ by 2 inch or 3 by 3 inch T-iron is laid within the brick wall at intervals of three to five feet, having a continuous circumference, which is very good practice when the walls are over eight inches thick.

*Alternate Stretchers and Headers
in each Course.*




Flemish Bond

*Alternate Courses of
Stretchers and Headers.*




Old English Bond.

*{ 1 Row Headers,
5 Rows Stretchers.*

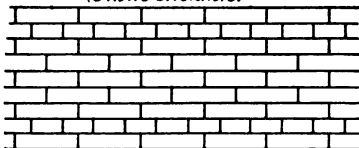

Usual Bond.

2 Rows Stretchers.



Old English Bond.

Mortar.—It is customary in brick chimneys to use a lime mortar for the inner shell until within a few feet of the top, where cement mortar is used because of its strength of adherence ; the outer shell being laid up in mortar of lime, cement, and sand.

The practice of some engineers is to build a ring of chimney about eight feet high laid up in cement mortar, alternating with a similar ring laid up in lime mortar, thereby gaining greater strength and tenacity.

Chimneys which are used to convey the gaseous products of chemical reactions are laid their whole height in cement mortar ; the interior surface of the flue laid up as true and smooth as it is possible to make it, and all joints entirely filled.





ILLUS. No. 12.
PUMPING STATION, WATER WORKS, MANCHESTER, N. H.

English refuse-destroyer chimney constructed for the Hornsley Local Board (England) for use in connection with its sanitary depot for treatment of house refuse.—*American Gas Light Journal*.

Principal Dimensions.

	Feet.	Inches.
Total height, bottom of foundation to top of capping	244	0
Height from ground line to top capping.....	217	0
Outside diameter at ground surface.....	18	3
Inside diameter at ground surface.....	12	3
Outside diameter at top, under capping	8	6
Inside diameter at top, under capping.....	6	3

The bricks used in its construction were good London stocks, 9 by 4½ by 2½ inches, and the work throughout is laid in English bond, with Dorking lime mortar in the proportion of three Thames sand to one of lime. No grouting was used in any part of the construction. The foundation bed is clay, 27 feet below ground line. On this a block of concrete was formed, 39 feet square, and 16½ feet deep, composed of six parts Thames ballast to one of Portland cement.

The brick footings in the cement are 33 feet square at base, and built up to ground line, which is 10 feet 6 inches from top of concrete bed, with regular offsets of 2½ by 6½ inches.

The shaft proper, starting from top of footings, is built up in six sections, commencing at the base:

	Feet.	Inches.	Bricks.
First section.....	30	0	by 4
Second section.....	34	6	by 3½
Third section.....	34	6	by 3
Fourth section.....	37	0	by 2½
Fifth section.....	37	0	by 2
Sixth section.....	21	0	by 1½
Seventh (cap).....	23	0	by 2
	217	0	

The cap portion, which is constructed in white-glazed and blue Staffordshire bricks, is ornamented with a circular cast-iron capping weighing 2,200 lbs., cast in six segments, and bolted together by internal flanges, and forms a very good finish to this tall shaft.

A fire-brick lining, or inner shaft, is built up to a height of 60 feet, the lower 30 feet in 9-inch, and the upper in $4\frac{1}{2}$ -inch work set in fire-clay.

An annular space of 15 inches is left at the base, between the fire-brick lining and the main shaft, to admit of expansion in the fire-brick.

The top of lining nearly touches the main shaft, which is corbelled over to fire-brick lining to prevent any deposit accumulating in the annular space.

Cast-iron inlets 9 by 6 inches are provided at ground level to admit cold air, and to prevent the inrush striking the fire-brick lining; a $4\frac{1}{2}$ -inch brick pier, 2 feet high, is built between the two shafts.

Two rings at the base and one toward the top, of hoop-iron bonding, $\frac{3}{8}$ by $1\frac{1}{2}$ -inch, are built in main shaft, about every 3 feet 6 inches in height.

The connection between flues of boilers and furnaces with main shaft is made by an arched flue opening, 9 feet by 3 feet 3 inches at the base, and a soot door is also provided, whereby access can be obtained to the inside of shaft when required.

The time occupied in building this shaft was a little over five months, commencing in July and finishing in December, 1888.

The bricklaying was continued all through the foggy weather in the latter month, although the workmen could not see the ground through the fog below.

A lightning conductor is fixed to the shaft, composed of two copper tapes or bands, $1\frac{1}{4}$ by $\frac{1}{8}$ inch, winding spirally around the outer circumference to underside of cap, where they are connected to a ring encircling the shaft, and from thence to 6 copper rods, 1-inch diameter, which are carried to a height of 4 feet above the cap, and the rods terminate with crow-foot ends. The tapes are joined at a distance of about 40 feet from the base, north of the shaft, and 18 feet below the ground level, and terminate in a copper earth-plate 3 feet by 2 feet by $\frac{1}{2}$ inch.

Outside scaffolding was used, and no accident whatever occurred during the construction. The shaft forms a conspicuous landmark to the surrounding locality, and dwarfs all other similar structures for miles around.

t of
nch

pen
on

is
we-

el
3-
n

1
}




ILLUS. No. 13.
QUEEN LANE PUMPING STATION, PHILADELPHIA, PA.

Queen Lane Pumping Station, Philadelphia, Pa., completed in 1896, is a brick chimney with a very elaborate exterior casing, as may be seen from the engraving shown.


The flue is 12 feet in diameter, perfectly straight.

Height, 200 feet above ground.


The foundation is 24 feet below grade level, and its bottom course 37 feet square ; the base of chimney above grade is 24 feet square.




Section C-C.



Section B-B.



Section A-A.

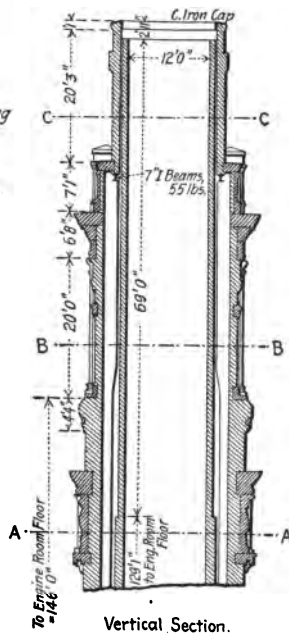

Redrawn from
"The Engineering Record"

ILLUS. No. 14.

QUEEN LANE PUMPING STATION, CHIMNEY SECTIONS.

BRICK CHIMNEY AT IMPERIAL FOUNDRY NEAR FREIBURG, IN SAXONY.


Flue 453 feet high, with an interior or flue-diameter of 15 feet 9 inches. Projected and designed by Engineer Huppner, it is built on the right bank of the river Mulde, on a hill which rises 259 feet above the ground on which the furnaces stand, so that the top of the chimney will be 712 feet above the works.

The base is 39 feet $4\frac{1}{2}$ inches square, and 28 feet 6 inches high, and at its top the chimney proper begins.

The works being on the left or opposite bank of the river, the flues running from the furnaces are carried across on a bridge built for the purpose, and then up the hill to the point where they enter the chimney.

The total length of these flues or ducts is 3,228 feet.


The chimney is built of brick entirely, and cost \$40,000.—*Railroad and Engineering Journal*.

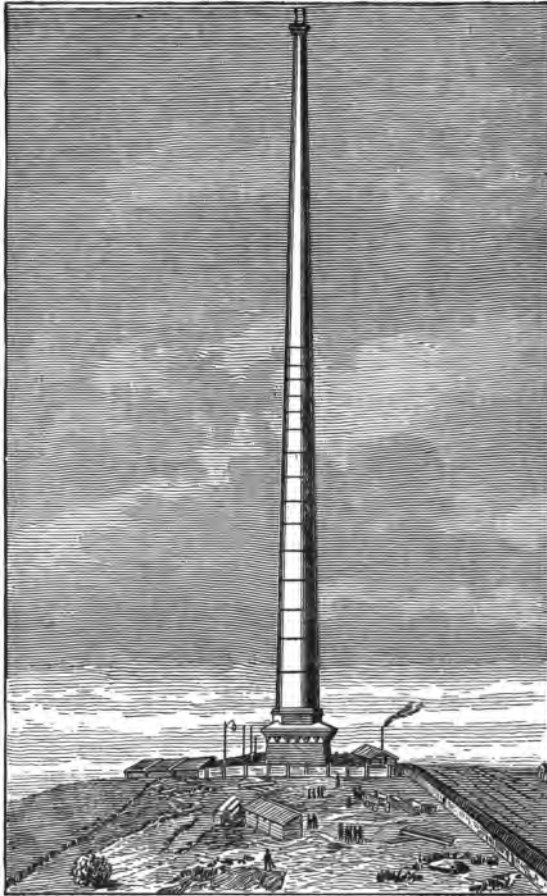

ILLUS. No. 15.


FREIBURG, SAXONY.

Chimney 453 feet high.

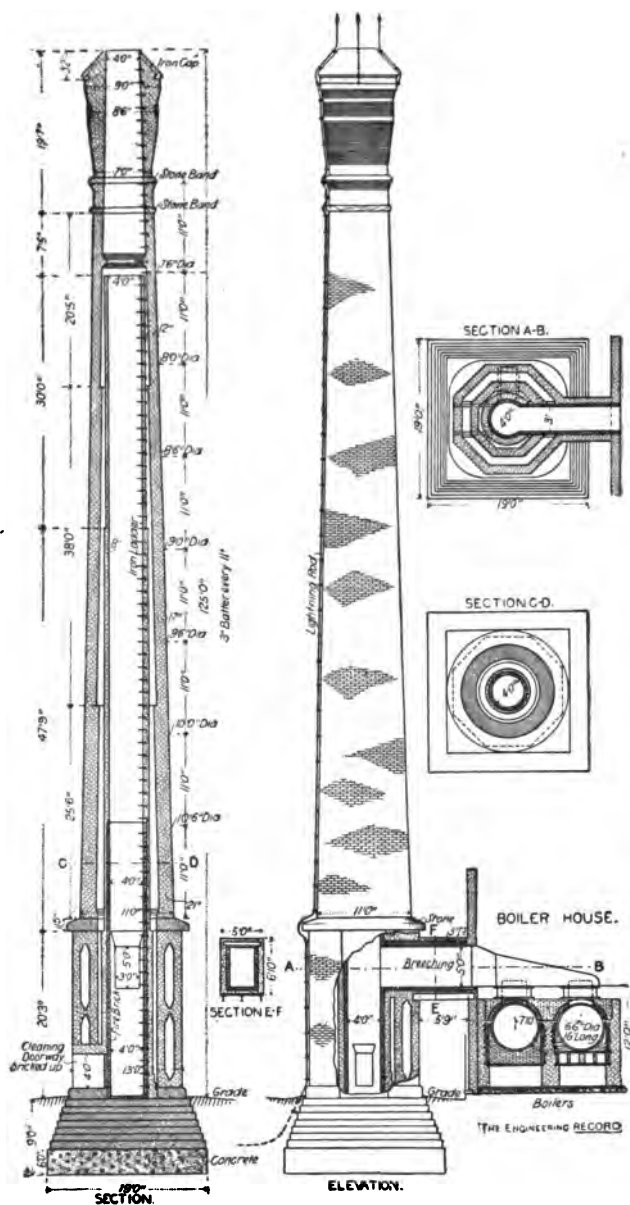


ILLUS. No. 16.

BRICK CHIMNEY, TWEEDVALE MANUFACTURING COMPANY.
4 feet diameter by 135 feet high. — *Eng. Record*, vol. xxxii., p. 407.

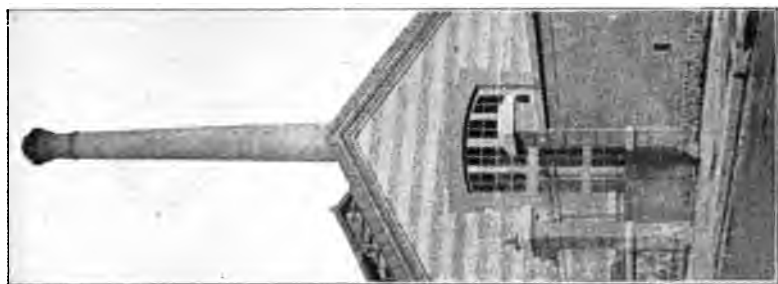

ILLUS. No. 17.
THREE BRICK CHIMNEYS.

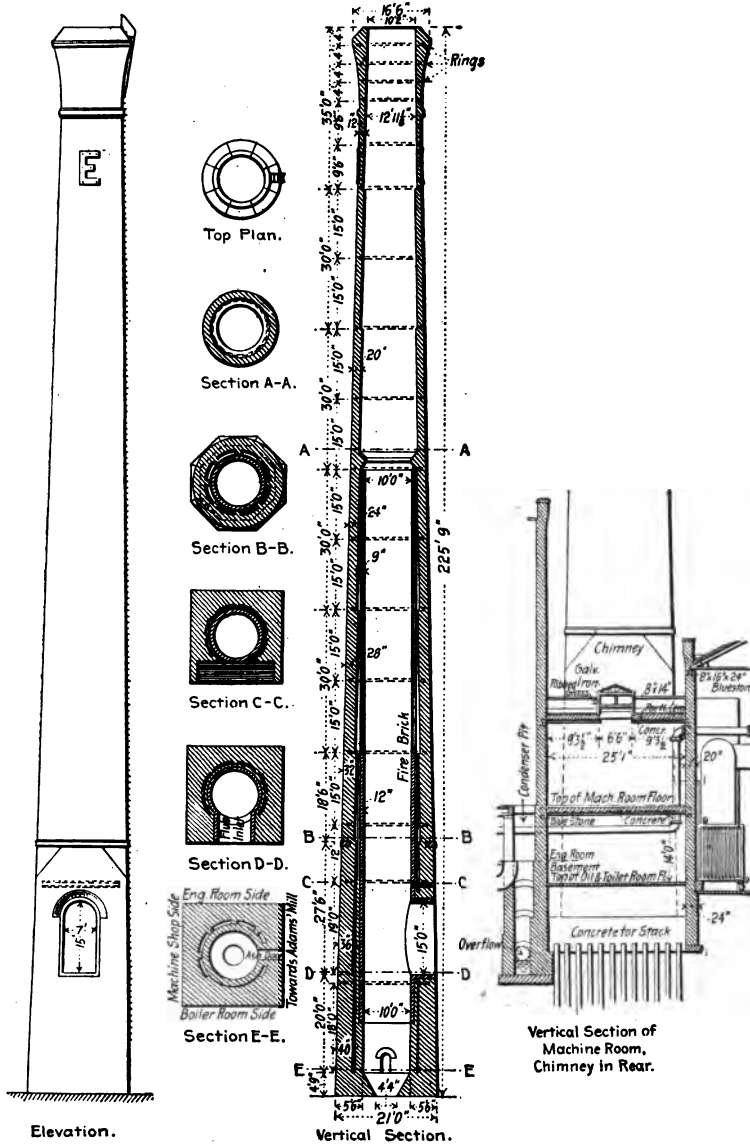

ILLUS. No. 18.

EDISON ELECTRIC ILLUMINATING COMPANY, PATERSON, N. J.
 From *Electrical Engineer*, vol. xxii., Dec. 9, 1896.

**EDISON ELECTRIC ILLUMINATING
CO., PATERSON, N. J., 1896.**

Flue, 10 feet diameter, 225 feet high ; calculated for 4,000 boiler horse-power.

The smokestack is the highest but one in the State of New Jersey, and its construction deserves special attention. The height from the foundation to the top is 235 feet, with a 10-foot flue, and its diameter at the base is 22 feet ; the other dimensions will be found in the detail drawing, Fig. 9. The foundation on which it is built is piling driven into the earth and over this is laid 5 feet of concrete. The chimney is double walled for 130 feet 9 inches, and at every 15 feet a wrought iron ring is set into the brickwork, in this way bonding the chimney together. There were 900,000 bricks used in the construction of this chimney, and an electric hoist was used during its construction, no outside staging whatever being employed. The material was hoisted on the interior of the chimney.

In their old plant the company used an octagonal brick chimney ; flue, 8 feet diameter by 186 feet high ; calculated for 2,500 boiler horse-power, and it is reported to have furnished draught for 5,000 lbs. of coal per hour.



ILLUS. No. 19.

EDISON ELECTRIC ILLUMINATING COMPANY, PATERSON, N. J.

Amoskeag Manufacturing Company, Manchester, N. H.
Architect, George W. Stevens; Steam Engineer, Charles H.
Manning; builders, Amoskeag Manufacturing Company.

Description.—Circular brick; built 1883; 60 days occupied in construction.

Dimensions.

	Feet.	Inches.
Total height, including foundations	265	0
Height from ground line to top	255	0
Outside measurement at foundation	25	8
Inside measurement at foundation	19	8
Outside diameter at ground surface	25	0
Inside diameter at ground surface	19	8
Thickness of brick at ground surface	2	8
Outside diameter at top (exclusive of cornice)	12	6
Inside diameter at top	10	0
Thickness of brickwork at top	1	3

Foundation.—The shaft is founded on a bed of ledge. No concrete used.

Pressure.—On foundations (as given by the firm) is 10,220 lbs. per square foot.

Bond.—Headers every tenth course.

Batter.—1 in 40.8.

Bricks.—1,000,000 common bricks used in construction.

Weight.—2,330 tons.

Scaffold.—Outside scaffold used, costing \$750.

Duty.—This shaft was designed to burn 18,000 lbs. of anthracite coal per hour. It carries off the fumes from sixty-four boilers = 8,400 horse-power. The company chiefly manufacture gingham, ticking, and fancy shirtings.

Inner Shaft.—The chimney has an inner shaft of 10 feet internal diameter.

Lightning Rods.—Wrought-iron; costing \$95.

Cost.—Complete, \$16,000.

Merrimack Manufacturing Company, Lowell, Mass. Engineer, J. T. Baker, C. E.; chimney built 1882.

Description.—Circular brick shaft, with inner shaft and core.

Dimensions.

	Feet.
Height above ground line.....	282
Outside diameter foundation	30
Outside diameter 2 feet 6 inches above ground	28
Inside diameter 2 feet 6 inches above ground....	12
Inside diameter at top.....	12

Foundation.—The chimney is founded on a ledge of sand-stone. The foundation, 30 feet in diameter, is built of granite blocks, laid on their natural beds. At the surface of the ground there is a dressed granite base 2 feet 6 inches in height, laid in clear Portland cement, the remainder of the foundation being in Rosendale cement and sand.

Upon this base is placed the brickwork, consisting of three cylinders, as follows:

Outer Shaft.—Batter, 0.42 inches per foot, for a height of 100 feet.

First section... 75½ feet high, 28 feet diameter 24 inches thick.
 First section... at junction of inner shaft.... 36½ inches thick.
 Second section 60 feet high..... 20 inches thick.
 Third section.. 70 feet high..... 16 inches thick.
 Fourth section 74 feet high, including cap.. 12 inches thick.

279½ high above granite base.

Inner Shaft.—Vertical, 18 feet diameter; 75½ feet high; 8 inches thick.

At this height the inner shaft connects with the exterior brickwork, making the masonry at that point 36½ inches thick, as above.

Lining or Core.—Uniform inside diameter, 12 feet.

It is entirely separate from the outside masonry, except the doorways and flue-openings, and is built up as follows:

First section.... 100 feet high, 16 inches thick.
 Second section.. 60 feet high, 12 inches thick.
 Third section.... 90 feet high, 8 inches thick.
 Fourth section.. 29½ feet high, 4 inches thick.

279½ feet high above granite base.

Construction.—The core was laid in mortar of lime and sand; the outside shell in lime, cement, and sand.

Ladder and Lightning Conductor.—On one side of the chimney is a ladder of iron extending from the ground to the top, and on the opposite side is a $\frac{3}{4}$ -inch galvanized iron-wire rope, both ladder and rope being connected with a copper ring, having four spurs, the central point of which extends 8 feet above the top of the shaft. The bottoms of both ladder and rope are connected to a 16-inch water-pipe.

Duty.—Two wrought-iron flues enter the chimney, one 5 feet by 6 feet, and the other 5 feet by 11 feet. The chimney is constructed to provide for 15 sets of boilers; only 12 are now in use. Each set has $103\frac{1}{2}$ square feet of grate surface, and is rated at 300 horse-power.

Weight.—Chimney, 3,392 tons; cap, 18,600 lbs.

Materials.—Brick used, 1,101,000; 6,875 cubic feet stone masonry.

Cost.—\$18,500.

Holyoke Machine Company (1883). Flue, 42 inches square by 120 feet high.

Double Wall.—Inner wall to within $24\frac{1}{2}$ feet of top, above this wall the flue is enlarged to 48 inches square.

There are three arches in each side with stone water-tables above each, and a double arch at the top of chimney.

The top is covered with a casting bolted together in sections; 144,044 bricks were used in its construction, and its cost was, aside from cast cap, \$2,160.60.

Weight of cast cap was $869\frac{1}{2}$ lbs., which, with labor, adds \$31.41 to cost, or a total of \$2,192.01.

An internal ladder of round iron provides means of access to the top.

Each wall is built in three steps or thicknesses, not given above the base, where the outer wall is 16 inches, 54 feet high, those above it probably 12 inches, 23 feet high, and 8 inches for the balance, 12-inch inner, 39 feet core; those above probably 8 inches, 45 feet, and 4 inches, $55\frac{1}{2}$ feet high.

A very clear engraving of this chimney can be found in the *American Machinist*, March 24, 1883.

Pacific Mills, Lawrence, Mass. Architect and builder, H. F. Mills, C. E.; built 1873.

Description.—Brick, octagonal outer shaft, circular inner shaft, vertical inner lining. Shaft situate 210 feet from boilers.

Dimensions.

	Feet.	Inches.
Total height.....	242	0
Height of outer shaft, including footings.....	233	0
Height of inner lining.....	234	0
Outside measurement, outer shaft at base.....	20	0
Outside measurement, outer shaft at top, under projecting cornice	11	6
Inside diameter, vertical flue.....	8	6

Foundation.—Foundation bed, 19 feet below ground; coarse gravel; concrete, 35 feet square, enclosed by pine-sheet piling 1 foot thick; rubble masonry of granite, in Rosendale cement, 7 feet high.

Outer Shaft.—This is constructed in six sections, viz.:

First section	12 feet high, 28 inches thick.
Second section ..	18 feet high, 24 inches thick.
Third section ...	20 feet high, 20 inches thick.
Fourth section ..	40 feet high, 16 inches thick.
Fifth section	60 feet high, 12 inches thick.
Sixth section....	83 feet high, 8 inches thick.

233 feet high above granite masonry.

Inner Shaft:

First section	27 feet high, 24 inches thick.
Second section...	154 feet high, 12 inches thick.

181 feet.

Lining:

First section	20 feet high, 20 inches thick.
Second section...	17 feet high, 16 inches thick.
Third section	52 feet high, 12 inches thick.
Fourth section....	145 feet high, 8 inches thick.

234 feet above granite masonry.

Construction.—The foundations were laid in mortar of Rosendale cement and sand; the outer shell in mortar of Rosendale cement, lime, and sand; and the flue-walls in mortar of lime and sand.

Duty.—In the winter of 1873, the vertical flue having reached 90 feet in height above ground, boilers having 542 square feet of grate surface were connected with the chimney, with satisfactory results. The chimney was designed to serve boilers having 700 square feet of grate surface.

Weight.—The approximate weight of the chimney is 2,250 long tons.

Bricks.—There were 550,000 bricks used in the construction of the shaft.

Lightning Conductor.—The shaft was struck by lightning in June in 1880, after which date a lightning-rod was put up. It consists of a seamless copper tube, $\frac{1}{4}$ inch thick, 1 inch inside diameter, at the top of which are seven points radiating from a ball 4 inches in diameter, the top of the central point being $8\frac{1}{2}$ inches above the iron cap. The rod is attached to the chimney by brass castings, and is connected at the base to a 4-inch iron pipe extending 60 feet to a canal.

This is a very weak chimney, the diameter at the base is 15 feet; one-tenth of the height (a common rule) would give 21.1 feet.

J. B. Francis, in a report on the above chimney, says 44 lbs. wind-pressure per square foot would blow the chimney down.

Brick chimney of the Narragansett Electric Lighting Company, at Providence, R. I. Designed by Messrs. Remington and Henthorn, Providence, R. I.

The foundation of the chimney consists of piling and concrete, and to arrange for it 44 square feet was excavated 5 feet 6 inches below the zero line of high water, and the sides protected by 3-inch spruce sheet-piling 16 feet long.

Over this excavation the pile-driver, having a ram weighing 2,200 pounds, was rolled.

Spruce piles, 50 feet long, were driven as far as possible without breaking, and were spaced 30 inches centre to centre, as shown in Fig. 1.

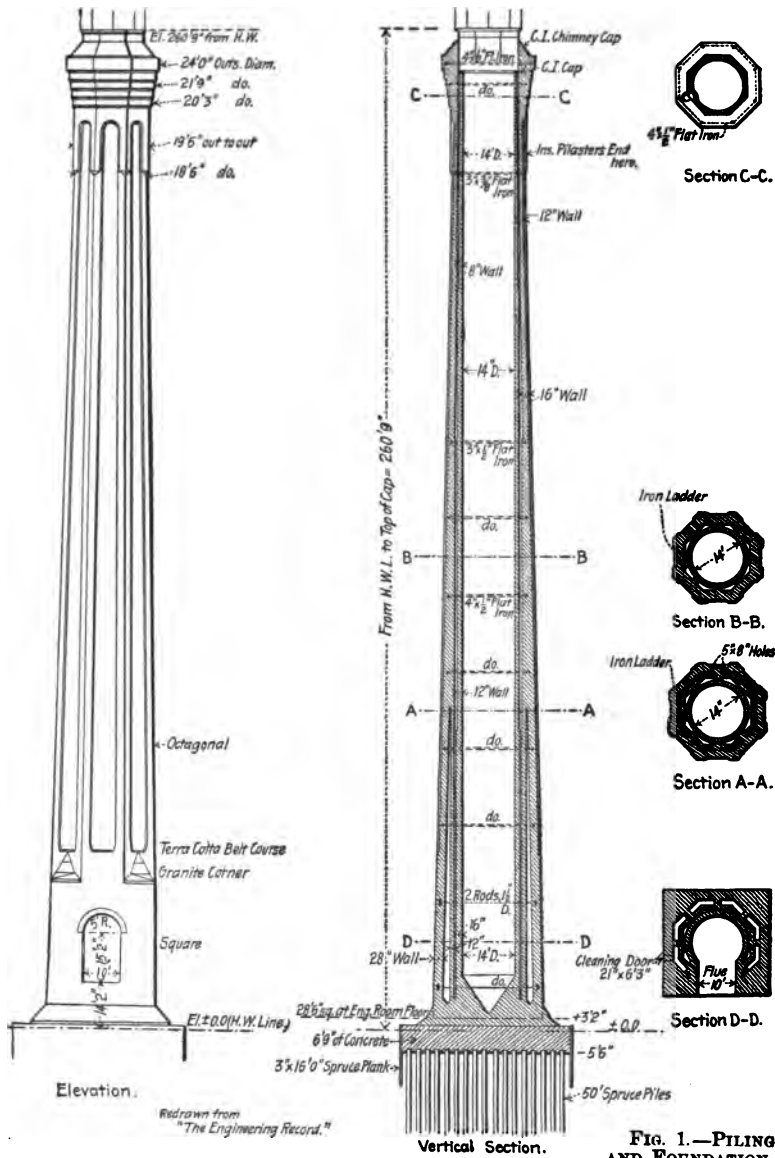


FIG. 1.—PILING AND FOUNDATION.

ILLUS. No. 20.

BRICK CHIMNEY, NARRAGANSETT ELECTRIC LIGHTING COMPANY, PROVIDENCE, R. I.
260 feet 9 inches high. Flue, 14 feet diameter.

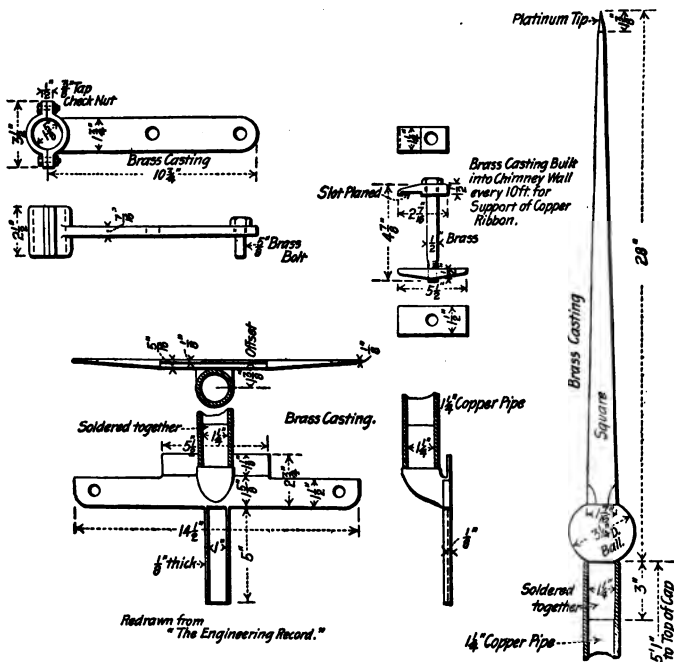
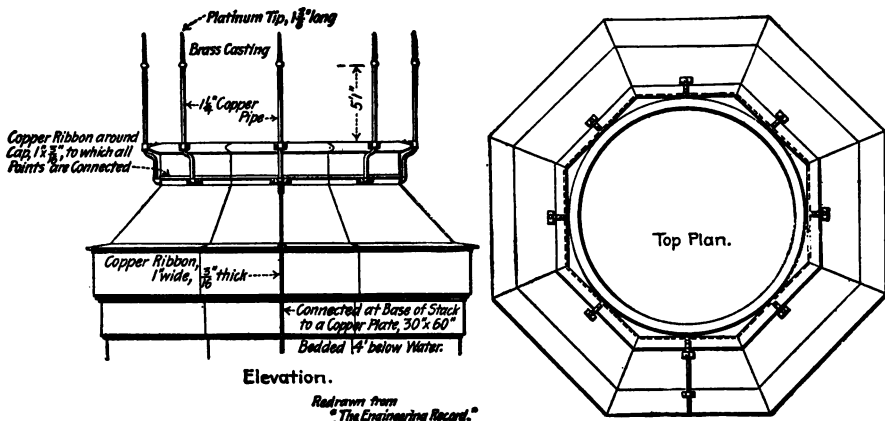


FIG. 3.—LIGHTNING FIXTURES.

ILLUS. No. 21.

NARRAGANSETT ELECTRIC LIGHTING COMPANY, PROVIDENCE, R. I.

There are, however, many more piles shown in this cut, but those were driven to sustain other structures alongside. In the drawing of chimney, of which there are 231 piles, they are shaded lightly that they may be more readily recognized.

These piles are cut off uniformly at 5 feet below the high-water line, the earth around their heads thus being 6 inches below their tops. The intervening space between the sheet-piling was filled in with concrete composed of one part of Norton's hydraulic cement, two parts sand, and three parts coarse gravel and broken stone.

This mass was carried up to the 1 foot 3-inch level, and consequently, formed a foundation 6 feet 9 inches thick, with the head of each pile projecting 6 inches therein. This was then covered with earth and allowed to season during the winter. On May 31, 1889, work was resumed by laying the first brick of the chimney. This was carried up in the form of a square of 36 feet, to a height of 3 feet 2 inches, and from that level the base of the chimney proper, which was 28 feet 6 inches square, was started.

The centre of the chimney was fixed by building into the chimney a cast-iron plate, upon which was a well-defined centre mark.

From this centre mark all measurements and plumbing were established while the chimney was being built.

As each 20 feet in height was built, the centre of its axis was re-established, and if any deviation from the plumb was found it was corrected before the next 20-foot level was reached.

The base of the chimney, as before stated, is 23 feet 6 inches square; consists of three walls, an outer wall 28 inches thick, an intermediate wall, octagonal in form, 12 inches thick, and a core wall, circular in section, 16 inches thick. The outer and intermediate walls are joined together by pilasters 12 inches thick.

In commencing the base of the core wall each course of brick was set back $2\frac{1}{2}$ inches from the previous course, until the inside diameter, 14 feet, was reached, when the wall was carried plumb 16 inches in thickness up to the 78 feet 2-inch level, where it was reduced to 12 inches, and run up to 193 feet 2 inches, where it was again reduced in thickness to 8 inches,

and thus carried to 249 feet 9 inches. This wall, complete, was laid up in lime mortar which had been slaked from three to six months before using.

The outer wall, of rectangular cross-section, was carried up to the 38 feet 2-inch level, where, at each of the four corners, cut granite blocks were laid to change from a square to an octagonal cross section.

The chimney was built entirely from the inside platforms, the masons working overhanded, and thus no staging was necessary on the outside. Up to the level of the granite work all the stock used was carried up a ladder placed on the outside. But at this point there was constructed inside the 14-foot chimney-flue an elevator, fitted with safety clutches, and capable of carrying a thousand pounds, although not more than four hundred and fifty was allowed to be placed upon it at any one time; and thereafter everything used in the process of construction was sent up the elevator, to hoist which a 19-strand steel cable was used. The temporary framework inside the flue consisted of four 6 by 8-inch timbers, laid across each other at right angles in pairs, and built into the walls at intervals of every 5 feet.

Through the opening at the centre the elevator passed.

Over these timbers was laid a platform of 2-inch plank, upon which the masons performed their work. To these 6 by 8-inch horizontal timbers, at opposite corners, were bolted the vertical guides for the elevator and its upright framing, by which it was hoisted; these were spliced out at the top each alternate staging.

The opening for smoke-flues is 10 feet wide and 18 feet high, with a 28-inch arch of 5 feet radius. The lower part of the opening is on the 14 feet 2-inch level.

Directly below and above the opening on the 13 feet 2-inch and 33 feet 2-inch levels, were placed on each of the four sides of the chimney, and 8 inches from the outside surface of the wall, two $1\frac{1}{4}$ -inch diameter rods, with $1\frac{1}{2}$ -inch ends, connected together by cast-iron plates 12 by 14 inches square.

Openings were left at each corner so that the nuts could be examined occasionally as the work dried out.

From and including the 53 feet 2-inch level, there were laid

edgewise at each 20 feet in height and 8 inches from the outside surface of the chimney wrought-iron bars of 4 inches by $\frac{1}{2}$ inch with their ends bolted together, forming an octagon corresponding to that of the chimney. At the 153 feet 2-inch levels these braces were reduced in size to 3 inches by $\frac{1}{2}$ inch, and were not again used until the 223 feet 2-inch level, or where the commencement of the head was reached, at which point bars 3 inches by $\frac{3}{8}$ inch were bolted together in the wall. Their next application was in the head, where two braces made of 4-inch by $\frac{1}{2}$ -inch iron were used to help in binding the heavy brickwork together during construction, which had considerable overhang (2 feet 9 inches on each side).

With reference to the outside walls, the outer and intermediate walls, with their connected pilasters, were built as one structure and terminated on the 83 feet 2-inch level (see p. 96), where by the batter the outer wall is thus joined to the intermediate, and become one wall from that point.

At this level two holes 5 by 8 inches were left in each of the eight sides of the intermediate walls, so that the intervening space between the outer and inner walls might be ventilated, if by any possible chance gases should find access to this space.

These ventilating spaces or holes are in communication with the space between the outer wall and the core, which is carried nearly to the top.

An attempt has been made to protect the structure from lightning, by encircling the cast-iron cap with a copper ribbon 1 inch by $\frac{3}{8}$ inch thick, to which are connected, by riveted and soldered joints, eight brass upright sockets, one in the centre of each panel of the cap.

To these brass sockets castings are secured by soldered joints $1\frac{1}{2}$ -inch seamless drawn copper tubing, which extends upward above the top of the cap and conforms to the shape thereof, and after projecting 5 feet above the top of cap the tubes are each surmounted by a brass casting 28 inches long, tapering in cross section, and having at its extremity a platinum point $1\frac{3}{8}$ inches long.

The encircling ribbon around the cap is connected to the ground ribbon by a brass casting thoroughly riveted and sol-

dered thereto, which, as it runs down the chimney is secured in position by brass clamps with bolts built into the brickwork as it progressed.

This arrangement, as a whole, is shown in detail in Figs. 2 and 3.

The lower end of the ribbon, which is 1 by $\frac{3}{8}$ -inch copper, rolled in one piece 285 feet long, terminates in a copper plate 30 inches wide by 60 inches long, and $\frac{1}{8}$ -inch thick, and is buried 4 feet below the natural level of the water in the soil of the premises.

This plate is buried in a load of powdered coke, 18 inches being placed above and 18 inches in thickness below the plate, and the whole filled up with gravel.

CHIMNEY AT CLARK'S THREAD WORKS, KEARNY, N. J.

"One of the tallest chimneys in America has been erected at the works of the Clark Thread Company, at Kearny, near Newark, N. J. The shaft is circular and 335 feet in height; it is 28 feet 6 inches in diameter at the base and 14 feet at the neck. Its internal diameter is 11 feet in one circular flue. The top is surmounted by a cast-iron coping weighing 6 tons and made in 32 sections bolted together by inside flanges.

"The foundation is concrete, made with 6 parts crushed limestone, 3 parts sand, and 1 part German Portland cement. This foundation is 40 feet square and 5 feet deep, resting on a bed of firm gravel. On this is founded the base of the chimney of brick and extending 4 feet above the surface of the ground. The material used was brick laid in mortar made $1\frac{1}{2}$ sand to 1 of Portland cement. The shaft up to 160 feet in height was laid with mortar made of 6 parts sand, 2 parts lime, and 1 part cement; the sand and lime have stood for three months previously made up as mortar, and the cement was added just before use. The top of the chimney was laid in mortar made of 3 parts sand to 1 of lime and 1 of cement.

"The outer bricks were first quality North River, and the backing bricks were of a good quality New Jersey brick. At intervals of 20 feet an iron ring 4 inches wide, $\frac{3}{4}$ to $\frac{1}{2}$ inch


thick placed edgewise, was built into the walls about 8 inches from the external surface.

"At the base the chimney is double, with an outer wall 5 feet 2 inches thick, and inside of this is a second 20-inch wall placed about 20 inches inside the first. From the interior of the main wall eight buttresses are built up, nearly touching the main flue wall and intended to keep the flue proper from sagging. The interior wall starting with 20 inches in thickness is gradually reduced until at 90 feet high it is 8 inches thick, and at 165 feet it ceases entirely. No fire-brick was used in the lining.

"Two horizontal flues enter the base of the chimney directly opposite to each other, and a 12-inch deflecting wall is built across the shaft between these flues for a height of 16 feet. The two flues are arched and are 7 feet wide and 8 feet high, and in these flues will be placed feed-water heaters for the boilers; 21 boilers of 200 horse-power each will depend on this one chimney.

"The lifting was done by an inside elevator, with a $3\frac{1}{2}$ by 3 foot platform, running between 4 by 6 inch guides braced against the inside walls. The interior platforms, erected at every few feet, rested upon two 3 by 8 inch beams built in the wall. The greater part of the brick laying was done by 8 bricklayers and 5 helpers, with 7 laborers on the ground supplying material.

"The foundation and base were put in and the shaft run up 18 feet in December, 1887. The work was again commenced in April, 1888, and finished in September, or in 150 days of 9 hours each. The total weight is about 5,000 tons, divided as follows: Brickwork, 9,051,900 pounds; concrete, 1,000,000 pounds; iron-work, 40,000 pounds. The base contains 1,600 square feet, which would give a load of about 2.8 tons per square foot. No permanent means of access to the top were provided; as if such access becomes necessary a small balloon can be sent up the shaft with a line and allowed to descend on the outside, and a line sufficiently heavy for use is thus carried up."—*Engineering News*, November 10, 1888.

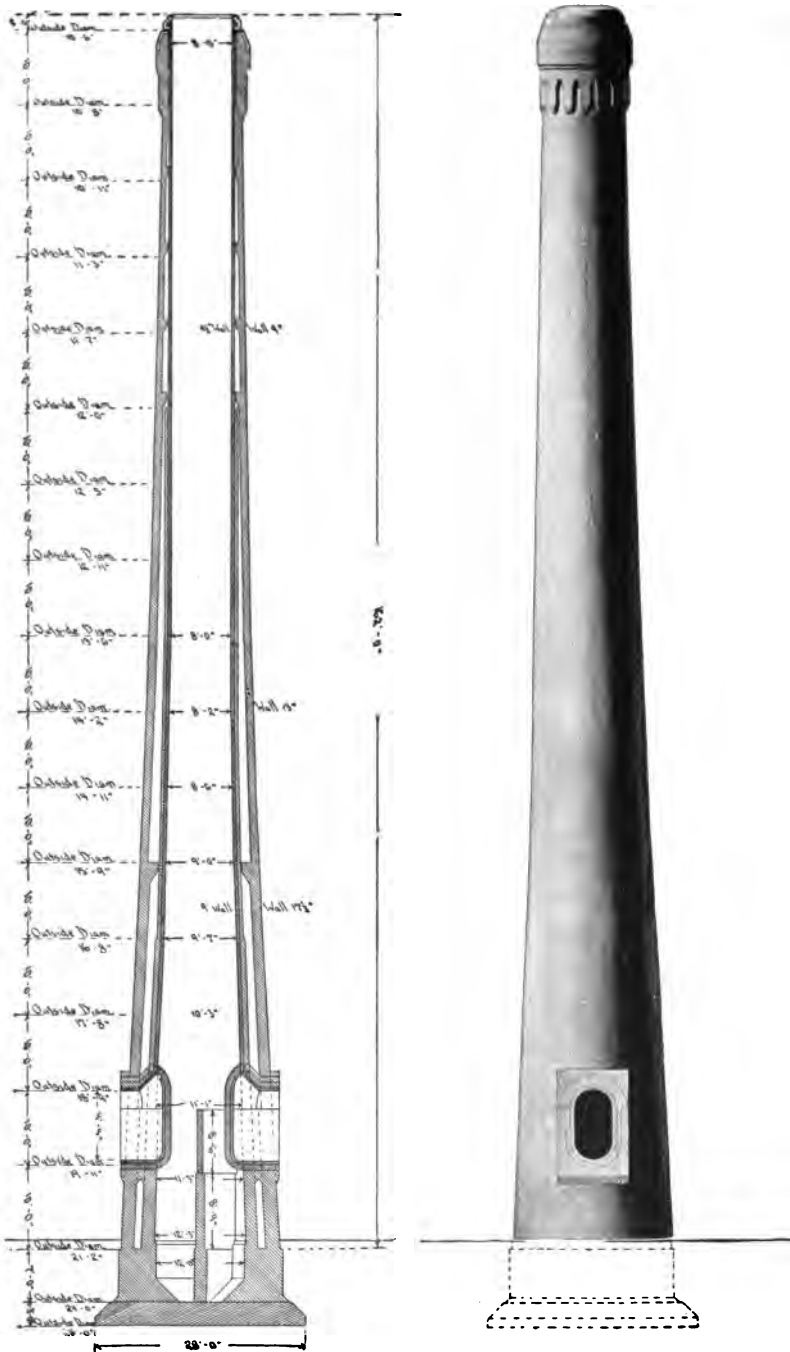

ILLUS. No. 22.

BRICK CHIMNEY AT THE POWER HOUSE OF THE UNION DEPOT RAILWAY COMPANY, ST. LOUIS, MO.

BRICK CHIMNEY AT THE POWER HOUSE OF THE UNION DEPOT RAILWAY COMPANY, ST. LOUIS, MO.

This chimney was partially blown down by the tornado at St. Louis on May 27, 1896.

Construction.—It consisted of an outer shell built of selected hard-burned dark-red brick laid in a mortar of equal proportions of one part Portland cement to two parts sand, and one part lime to two parts sand.

Bricks laid with push-joints under inspection, and all joints are well filled.

The inner core is built of a ring of $4\frac{1}{2}$ -inch fire-clay brick, re-inforced in the lower section by a ring of hard-burned red brick.

The fire-brick are laid in fire-clay. Each shell is finished at the top by a cast-iron cap 2 feet deep, of $\frac{1}{2}$ -inch metal, secured to the brickwork by bolts. The inner shell is separated from the outer one by a varying distance; the dimensions, as planned, give this distance as a minimum of 2 inches at the top, and the same at 50 feet below the top where the section changes.

The inner shell is stayed by brackets built into the outer shell at intervals of 10 feet vertically. There are six of these brackets on a level, each having a face of about 8 by 8 inches. (See American Society of Civil Engineers. Proceedings, January, 1897. Baier on Tornadoes.)


BRICK CHIMNEY AT THE OMAHA AND GRANT SMELTING AND REFINING WORKS, DENVER, COL.

The *Denver Times* thus describes the Grant Smelting Company's chimney:

"The big chimney of the Grant Smelting Company was designed by W. J. Scanlon, and is the most marvellous construction of the kind in the world and the highest in the United States. Its dimensions are as follows: It commences with a gravel foundation 8.4 feet high and 58 feet square, composed of Dikerhoff cement, containing from one to six parts of broken stone and sand. Barney Currigan had charge of the cement work.

"On top of this cement foundation the brickwork starts, 40 feet square at the base, and tapers to 35 feet at a distance of 7 feet from the base. On the top of this level there are two courses of Fort Collins stone 9 feet thick, bedded in cement mortar, the stonework being the grade line from which the chimney proper starts. The base of the chimney from here is 33 feet square, and it continues to the height of 352 feet 3 inches, diminishing 13 feet from the bottom to the top. The octagonal corners are not built on an inclined plane as usual. They are curved, with a prominent outside curve of about three feet. This was so constructed in order to obviate an optical delusion through the use of a centre line, by plumbing down to the centre, which was established by bedding plate in the centre of the chimney. A 15-pound bob was used for this purpose, with as fine a line as would carry it. Plumb rules were changed every ten feet, with curve established on the rule to carry up from one measurement to the other and also measured out from centre line every ten feet and came out on top within a fraction of the size required.

"The chimney has a flue of 16 feet in the clear, and walls 8 feet 6 inches thick, which extend to the top of the racking. At this level start two walls with a space between of 2 feet; the outer wall is 4 feet thick, and the core wall 2 feet 6 inches thick. The space between these walls of 2 feet extends to the top of the chimney, to the open air, and the outer wall for the last 100 feet is reduced to a 13-inch wall. The core wall is reduced to a 9-inch

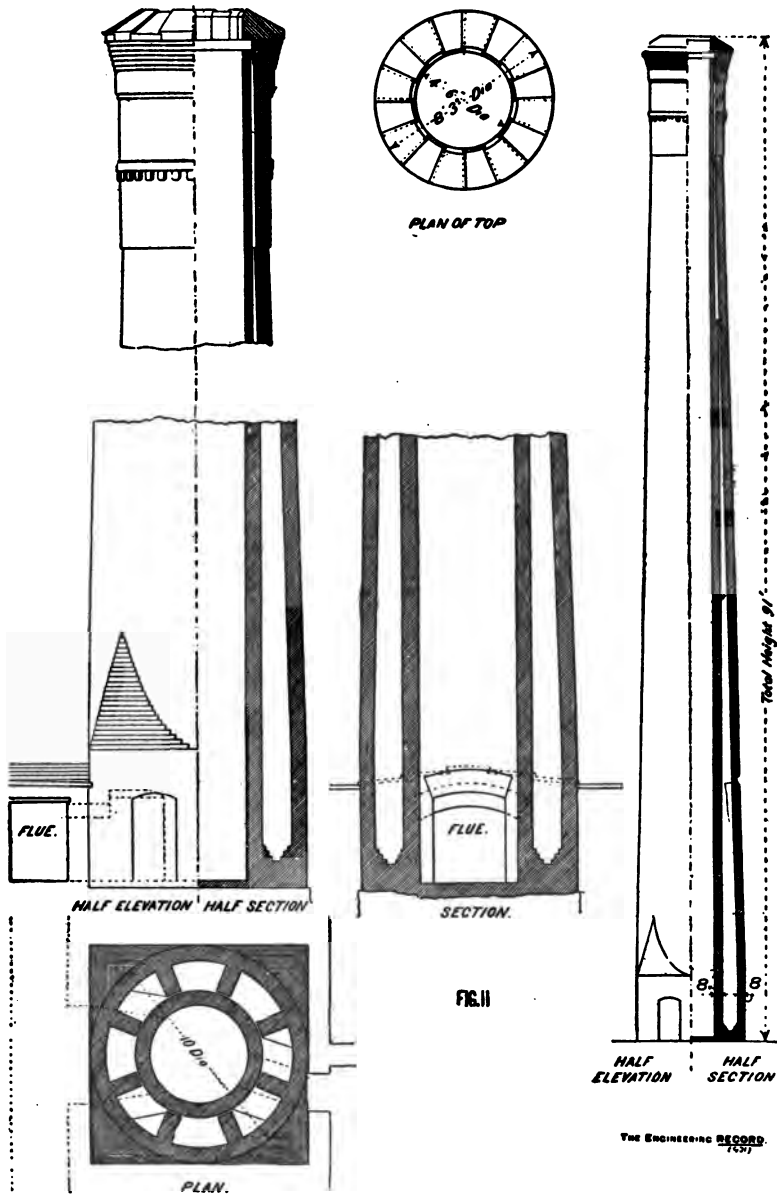

ILLUS. No. 24.
CHIMNEY DETAILS, CHENEY BROTHERS' SILK MILLS, SOUTH MANCHESTER, CONN.

wall for the same height. From the 28-foot level the outer or main wall is separate from the core, or practically one chimney within the other.

"At intervals of every ten feet in each octagonal section there are buttresses carried from both walls with plates between. There are six rollers between each plate, so that the core can rise when the heat is great enough to cause expansion. This idea was to prevent the pressure from being sidewise.

"The top or finish, which is 30 feet high, with a projection of 5 feet 2 inches, is the heaviest one ever made in brick. It is banded by large iron circlelets passing around the structure. These bands are placed over the inner walls with bolts running out, which fasten to angle irons that form the octagon. These angle irons are placed on the outer course of brick and built in solid with the best cement mortar.

"While being built it was kept level and the weight equalized the pull or pressure of going out on these irons. There were several sets of these irons. A cast-iron plate covers the entire top, with a trap-door which connects with an iron ladder built in the main wall on the inside next to the core wall.

"The weight of the structure is 8,000 tons, and its cost was \$55,000. Over 2,000,000 pressed bricks were used in its composition. The brickwork was done by John Cook in 199 days. Twelve bricklayers worked on the first 100 feet, eight bricklayers on the next 100 feet, and six workmen on the remainder. The laborers were paid \$7 a day, and the foreman received \$8."

A TALL BRICK CHIMNEY.*

The largest chimney on the Pacific coast, 1892, the third in point of size in the United States, and the fourth in the world, is being built in San Francisco. The broad column of bricks is seen high above the roofs of the houses in its vicinity, and towers above every factory chimney in the city. The structure was put up by the Edison Electric Light and Power Company on Jessie Street near Third, in connection with a new building 75 feet front, 165 feet deep, and 52 feet high. The chimney is 175 feet above the pavement, and will rest on foundations, be-

* San Francisco Chronicle.

low the street level, of solid concrete 9 feet 8 inches thick, and 28 feet square. The interior diameter for the entire height is to be 12 feet. At the base the chimney has an exterior diameter of 18 feet 6 inches, and the outside diameter of the cap will be 14 feet. Inside, for a height of 73 feet, there will be a detached fire-brick lining with air-space between it and the interior surface of the chimney. The object of this lining is to protect the chimney from the expansion and contraction incident to the varying degree of heat. As the base is of concrete so is the topmost ring of the chimney. Laid in the artificial stone of the cap and intended to bind it firmly together, are seven hoops of one-inch wire rope. Between base and cap machine-made brick is used entirely, it being estimated that 275,000 bricks will be required to complete it. The concrete ring will be 4 feet deep, and the ornamental brick and concrete capital of the chimney will be 16 feet high. The only vertical openings in the chimney will be one about the level of the roof of the building in order to repair the fire-brick lining and to clean it, and one at the base through which to remove soot and ashes. From the roof an iron ladder will rise outside the chimney to the very top, so as to afford a means to repair the exterior when necessary. This ladder would, if connected by copper wires to the earth, form a lightning conductor. The latter has not been provided, however, it being considered unnecessary, as there is no instance in the history of the city of a chimney or building of any kind having been struck by lightning. The sole duty required of this enormous chimney is to afford a natural draught to twenty-eight boilers, which will furnish the motive power to six engines of 1,200 horse-power each, or 7,600 joint. The cost of this chimney is estimated at \$10,000.

At Paterson, N. J., a great many of the old mill chimneys are built as follows: with square flue or core about 3 feet 4 inches square inside, and 75 feet high.

A chimney of the above dimensions has been built as follows:

Foundation of concrete, 9 feet by 9 feet by 4 feet deep; base of chimney, 7 feet 9 inches square; 12-inch wall tapering up 25 feet 6 inches; the next 19 feet 6 inches is 8-inch wall.

The core is 3 feet 4 inches square inside, with 8-inch wall running up and meeting the outer wall at 45 feet above the foundation, where the chimney is 6 feet square, above this the flue continues straight up, and the outside is drawn in to about 8 inches thickness of wall at the top.

A square cap of cast iron in four pieces is put on top, and bolted by inside flanges.

About 45,000 brick and 36 cubic yards of concrete entered into its construction.

The weight per square foot on foundation is 2.20 tons.

The weight per square foot on soil is 1.82 tons.

Air vents are placed in outside wall to let out the heated air from cavity between walls.

Some of these chimneys have had their top part lifted off by reason of the heat of the flue, and the flue and outer shell being run together, others have stood very well, probably because the fires have not been forced.

BRICK CHIMNEY AT THE PLANT OF THE STEIN- WAY ELECTRIC COMPANY, ASTORIA, L. I.


Flue, 8 feet in diameter.

Height, 140 feet above the ground.

Fire-brick lining, 45 feet up from the bottom, 5 inches thick.


Core of chimney, 13 and 8 inches thick to within 50 feet of the top.

Outer shell, 32 inches thick at the bottom, reduced to 12 inches thick at the top.

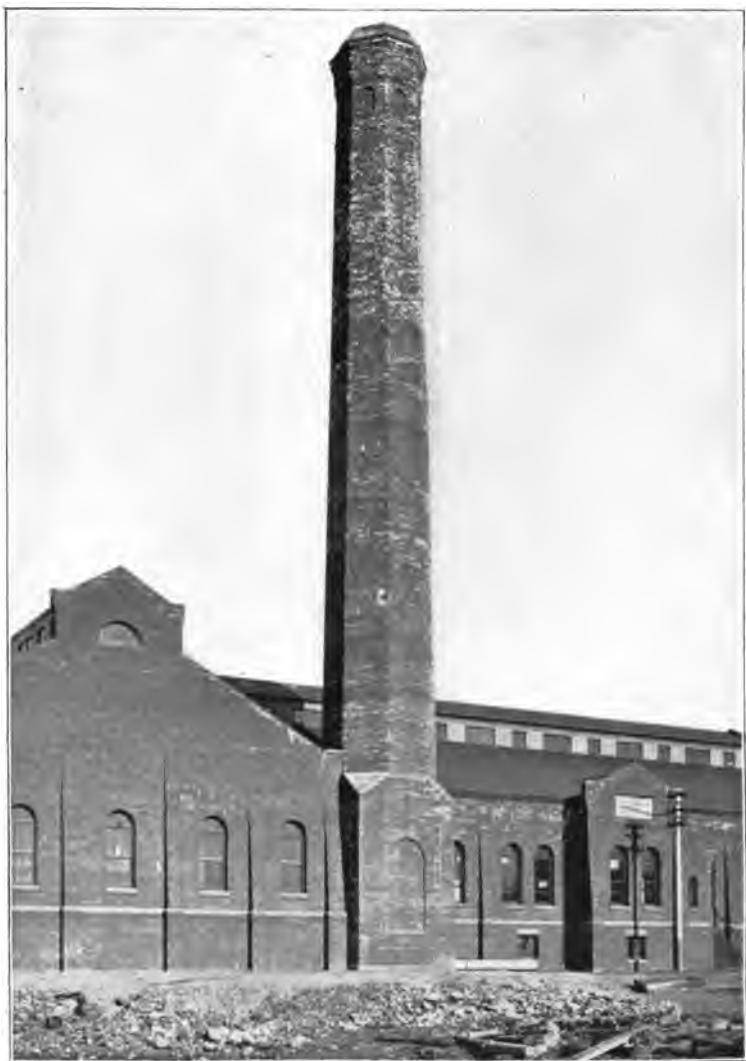

ILLUS. No. 25.

STEINWAY ELECTRIC COMPANY, ASTORIA, L. I.

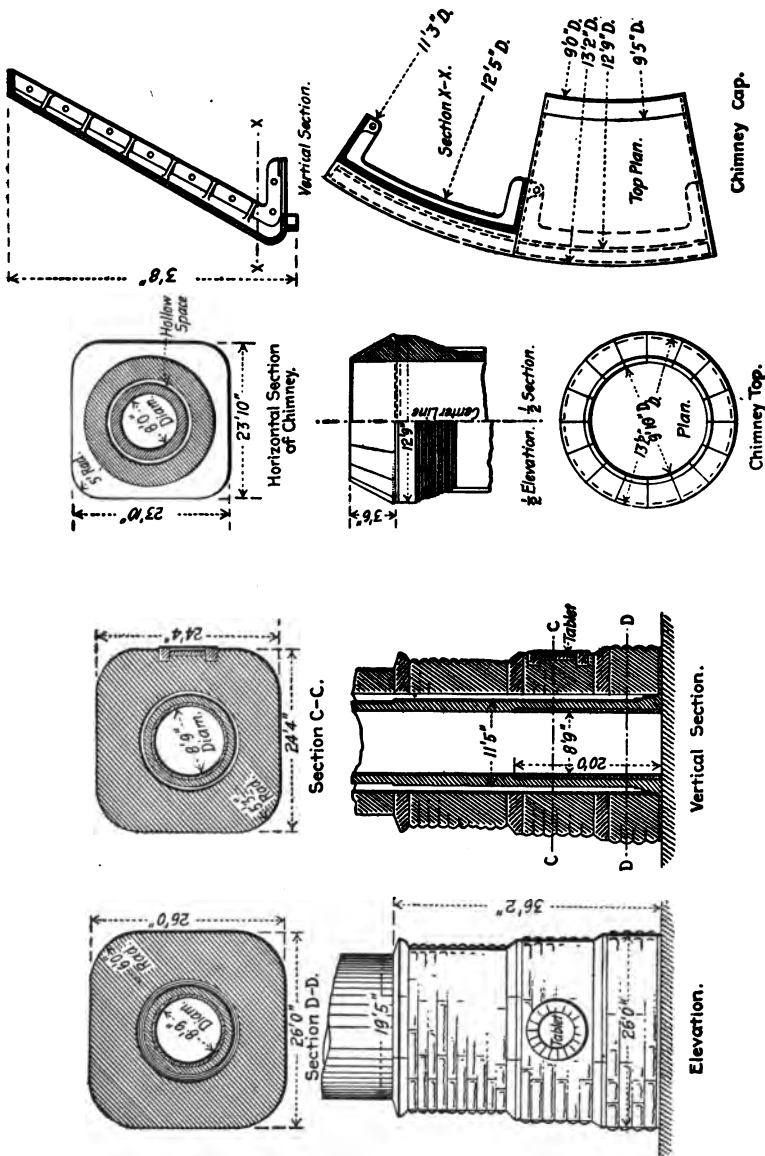

ILLUS. No. 26.
DETAILS OF BRICK CHIMNEY, IVORYDALE, O.

BRICK CHIMNEYS.

The Cambria Iron Company, Johnstown, Pa., in 1881 built two sizes of chimneys, which from the peculiar design were termed "Crinoline" chimneys.

One was 140 feet 6 inches high above base-plate, with a flue 7 feet 11 inches in diameter.

The other, 200 feet high above base-plate, with a flue 10 feet in diameter.

The prominent features of their design are:

First.—Single-brick tube.

Second.—Cast-iron base-plate.


Third.—Steel rails set vertically in outer walls, with wrought-iron binders or hoops.

They have been in constant use up to the present time, and have proved themselves well fitted to the work for which they were designed.

Through the courtesy of Mr. Jos. Morgan, Chief Engineer of the works, the 140-foot chimney is pictured in detail on the opposite page.



Top  Plan.

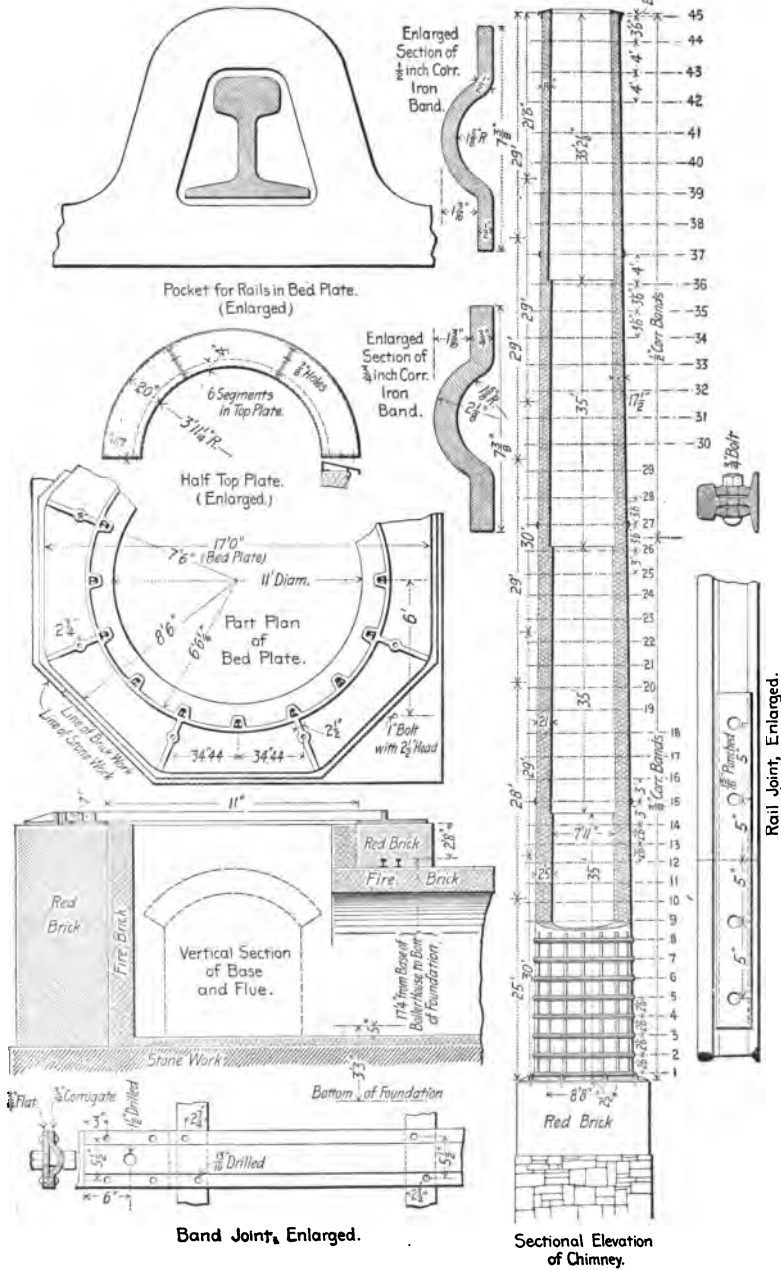

ILLUS. No. 27.

THE CAMBRIA IRON COMPANY, JOHNSTOWN, PA.

Robert Kuntsman* gives the data for material for a brick chimney of 2,000 horse-power capacity, as follows:

Working capacity of chimney.....	2,000 horse-power.
Depth of foundation	12 feet.
Height of chimney inclusive of foundation	205 feet.
Height of chimney from base line to top of cap	193 feet.
Height of cap from neck of shaft to top	14 feet 9 inches.
Effective height from inlet of boiler-flues	178 feet 3 inches.
Batter per foot on side walls $\frac{1}{10}$ inch outside, and	$\frac{3}{100}$ inside.
External diameter of chimney at base line	17 feet.
Internal diameter of flue at base line	8 feet.
External diameter at neck under cap	10 feet 6 inches.
Interior diameter at extreme top.....	7 feet.
Thickness of outer wall under the cap	1½ brick, 12 inches.
Thickness of outer wall at section <i>CD</i>	2 brick, 16 inches.
Thickness of outer wall at section <i>EF</i>	2½ brick, 20½ inches.
Thickness of outer wall at section <i>GH</i>	3 brick, 24½ inches.
Thickness of outer wall at section (with inlet flue) <i>IK</i>	3 brick, 24½ inches.

Size of inlet flue from boilers, 9 feet by 4 feet 6 inches, with an area of 32 feet square.

Area of outlet on top of chimney.....	38.5 square feet.
Total weight of chimney, including foundation.....	1,588½ tons.
Total weight of brickwork, from base line upward	1,016½ tons.

Load on concrete foundation 2.9 tons, or nearly 3 tons per square foot.

The load on the ground and distributed over an area of 1,370 square feet is therefore 0.86 ton per square foot.

It should not be difficult to arrive at the cost of this chimney at any locality if, according to local conditions, price of materials and labor are estimated from the quantities we have given.

It will require 390,000 brick.

* Brick, April, 1897.



CHIMNEY METROPOLITAN STREET RAILWAY POWER HOUSE, NEW YORK CITY.

BRICK CHIMNEY FOR THE METROPOLITAN STREET RAILWAY COMPANY,

NINETY-FIFTH STREET AND FIRST AVENUE, NEW YORK CITY.

Built in 1898.

The ground on which it is built was originally low ground, being covered at one time by the water of the East River, but had been filled in at a later period. A number of borings were made to determine the character of the strata below the earth and ash filling, averaging, respectively, about 10 and 15 feet in depth. Below the filling, blue clay or mud was found to an average depth of 35 feet, beach sand to about 45 feet, fine red sand from 45 to 55 feet, and, from this down, clay was present as far, at least, as 80 feet. Rock was found in one trial at a depth of 125 feet.

In building the foundations, which cover an area of about 85 feet square, the earth and ash filling were removed to a depth of 20 feet below the determined level of the station floor, taken as datum, and piles were driven to a depth of about 40 feet over the entire area. The piles are upon 2-feet 6-inch and 2-feet 3-inch centres, and a total of about 1,300 were driven by means of pile-drivers suspended from derrick booms. At a depth of 40 feet it was found that a 2,500-pound hammer falling 20 feet drove the piles about one inch, on an average. In driving the last 20 or 30 piles, the resistance was so great that they could not be driven over 15 feet. The piles were cut off 1 foot above the top of finished ground, or at a grade of — 19. An immense concrete block was laid upon them, 85 feet square and 20 feet thick, of 1, 3, and 5 Giant Portland cement-concrete. Cement mortar used in the brick-work was made of 1 part Giant Portland cement and 2 parts sand.

It is located close to the wall separating the engine and boiler rooms of the station, and divides the boiler room in two parts. Smoke flues lead from the boilers to the chimney from opposite directions, and as there are three stories in the boiler house upon which the boilers are to be installed, there

are six large openings to the chimney, two on each of the three floors. The chimney is built of two concentric shells, and the outer shell is stiffened by 12 interior longitudinal ribs projecting radially toward the inner shaft and leaving a clearance of $\frac{1}{4}$ inch. The inner shaft has a constant diameter of 22 feet, and the outer dimensions of the stack range from a square base, 55 feet on a side, to a neck of 26 feet 10 inches in diameter, 316 feet above. The cylindrical exterior of the chimney is given a batter of $3\frac{1}{4}$ inches in 10 feet, or 0.312 inches per foot.

The two shells rise from a common brick base resting on the concrete, and are practically a single structure up to a few feet above the smoke-flue openings. These openings are 24 feet 6 inches, one above the other, and 4 feet below the first opening, at the 15-foot elevation, the shaft is lined with an 8-inch thickness of fire-brick to a height of 90 feet, which is about 10 feet above the third-floor opening. Beyond this for 25 feet the fire-brick is only 4 inches thick, and from the 115-foot elevation upward the walls are of common brick. The weakening caused by the openings is overcome by the double-arch construction and the use of tie-beams of channel iron. A 12-inch brick wall, 85 feet high and provided with a buttress divides the lower part of the shaft into two parts, separating the two tiers of smoke-flue openings. The inner shell is built in five sections from the basal thickness of the wall, which is 24 inches, to an 8-inch wall at its top, 340 feet high. The outer shell, as to thickness, ranges from 28 to 16 inches. The fourth section, from the 200 to the 280-foot elevation, is 16 inches thick, as shown, and the wall thickness then becomes 20 inches. The successive gradations of thickness up to this point conform to the requirements of the limiting stresses allowed, but the enlargement is made, aside from providing for the coping, to bring the two shells in closest proximity, so that both may assist in resisting lateral strains. The gap between the two shells near the top of the chimney is protected with an apron of sheet-iron 4 feet wide and provided with a flange at the top imbedded in the brickwork. The top of the chimney is protected with an iron cap formed of 40 cast-iron sectors, bolted one to the other.

They envelop the top brickwork, and are anchored by vertical tie-rods to an annular steel ring about 28 inches in diameter imbedded in the brickwork about 14 feet below the cap. Ten lightning-rods point upward 6 feet above the top of the chimney, and are connected to a copper ring, which is provided with two descending conductors of copper, each 1 by $\frac{3}{8}$ inch in cross section. These conductors are also connected to the iron top. Two other steel rings are also encased near the top, one about 342 feet and another about 313 feet from the base, to prevent any tendency to disintegration resulting from incipient cracks.

The chimney for the station, now practically completed, stands 353 feet above its foundation, and it is, therefore, the tallest chimney in the United States. Its internal diameter is 22 feet, and in that dimension it is the largest brick chimney in the world. Rankine's formula was used in determining its capacity, and in designing the chimney it was assumed that the wind-pressure would be equivalent to a pressure of about 40 pounds per square foot of diametrical area. The total weight of the chimney is 8,540 tons, and 3,400,000 red bricks were used in the construction.

The drawings show at various elevations the total weight supported, and the corresponding stress per square foot of sectional area. The pressure intensity of the outer shell is on the average greater than that in the interior shaft, being about 9 tons per square foot. The unit load at the concrete base is only 3.5 tons for the whole weight of the chimney.

The chimney was designed by the Engineering Department of the Metropolitan Street Railway Company.—*Engineering Record*, vol. xxxix., p. 53.



ILLUS No. 29.

BARBOUR FLAX SPINNING CO., GRAND STREET, PATTERSON, N. J.

Flue, 6 feet diameter Height, 175 feet.

LIST OF BRICK CHIMNEYS.

1. At Knoxville, Tenn. Illustrated in *Engineering News*, November 2, 1893.

Flue, 6 feet diameter ; 120 feet high ; double walls.

TABLE No. 25.

EXTERIOR WALL.		INTERIOR CORE.	
Height, feet.	Thickness, inches.	Height, feet.	Thickness, inches.
20	21	35	13½
30	17	35	8½
30	13	29	4
40	8½	21	0

Exterior diameter at base is 15 feet 6 inches ; batter, $1\frac{1}{8}$ inch in 12 inches from the bottom to 8 feet from the top, then straight. Space between walls, 16 inches at bottom, diminishing to nothing at the top of core wall.

The interior is of red brick, except a lining of fire-brick for 20 feet up from the bottom.

2. Montreal (Can.) Street Railway Company, William Street Power House.

This chimney (1894) is the highest in Montreal, 190 feet high above the fire-grate, and with a flue 9 feet diameter, gives a draft of $1\frac{1}{8}$ inches of water.

The chimney is built with double walls, and the square pedestal base is 18 feet square outside.

Three thousand horse-power of Lancashire double-flue boilers are connected to it.

3. Mechernich Lead Mining Company. Flue, 9 feet 10 inches ; height, 440 feet 6 inches ; foundation of dressed stone, 36 feet square by 11 feet 6 inches high.

The base, a cube of 32 feet 9 inches, and the octagonal plinth of the shaft are both built of annular kiln bricks.

The circular shaft is formed of radial bricks, it is 24 feet 6 inches outside diameter, and 11 feet 6 inches inside at base ; at the top it is 11 feet 6 inches outside and 9 feet 10 inches inside diameter.

4. New Sessions Foundry, Bristol, Conn.

Flue, 42 inches diameter by 110 feet high ; circular, 6 feet diameter at top, 10 feet diameter at base, set on an 11-foot square bed at ground. Three 150 horse-power Heine boilers connected to it.

5. Passaic Print Works, Passaic, N. J.

Flue, 9 feet diameter by 200 feet high ; cost, \$15,000 ; built by Flynt Building and Construction Company.

This chimney has three batters in the height.

Eighteen 6 feet diameter by 18 feet long horizontal tubular boilers are connected to it, with a total of 760 square feet of grate.

6. Fall River Iron Company.

Flue, 11 feet diameter by 350 feet high ; diameter outside at base, 30 feet ; diameter outside at top, 21 feet.

Foundation of granite, 55 feet by 30 feet by 16 feet deep.

Required 1,700,000 brick, 2,000 tons stone, 2,000 barrels mortar, 1,000 loads of sand.

Estimated cost, \$40,000.

7. Dundee Chemical Works, Passaic, N. J.

Circular, 175 feet high, 14 feet square at bottom ; laid up in cement.

Used to get rid of gases from chemical reaction at a high altitude ; cost \$7,000.

Since it was built it showed several large cracks from the top one-third the way down and has been rebuilt ; iron bands being placed around the outside to retain the brick.

8. Merrimack Manufacturing Company, Lowell, Mass.

Flue, 12 feet diameter ; 282 feet high ; round pedestal, cost \$18,500 ; load on foundation 4.8 tons per square foot.

The foundation is 30 feet in diameter of dressed granite blocks laid in clear Portland cement ; core was laid in lime and sand mortar ; the outside shell was laid in lime, cement, and sand.

9. Municipal Lighting Plant, Frankfort-on-Main, Germany.
Flue, 7 feet diameter ; 164 feet high.
Supplies draft for 12 internally fired boilers with single furnace, and four Galloway tubes.
Boilers, 82 inches diameter by 28.8 feet long ; 925 feet of heating surface each.
10. Port Dundee, Glasgow, Scotland.
488 feet high. Cost, \$40,000.
11. Townsend, Glasgow, Scotland.
454 feet high.
12. Tennant & Company, Glasgow, Scotland.
434 feet 6 inches high.
13. Crossley's, Halifax, England.
381 feet high. Octagonal, stone.
14. Dobson & Barlow, Bolton, England.
13 feet 2 inches diameter ; 367½ feet high.
15. Brooks's Fire-clay Works, Huddersfield, England.
306 feet high. Circular, brick, and stone.
16. Mitchel Brothers, Bradford, England.
300 feet high. Octagonal, stone.
17. Edinburgh Gas Light Company, Edinburgh, Scotland.
Flue, 12 feet diameter ; 264 feet high. Cost, \$25,000.
Circular, stone, square pedestal.
Load on bottom or soil is 2.5 tons per square foot.
18. West Cumberland Hematite Iron Works, England.
251 feet high. Circular, stone.
19. Amoskeag Mills, Manchester, N. H.
Flue, 10 feet diameter ; 250 feet high. Circular, brick.
20. Washington Mills, Lawrence, Mass.
Flue, 10 feet diameter ; 250 feet high. Circular, brick.
21. Tremont and Suffolk Mills, Lowell, Mass.
(1) Flue, 10 feet diameter ; 250 feet high. Circular, brick.
22. Tremont and Suffolk Mills, Lowell, Mass.
(2) Flue, rectangular, oblong, brick. Height, 238 feet.
23. Lower Pacific Mills, Lawrence, Mass.
Flue, 8 feet diameter ; 214 feet high. Circular, brick.
24. Edison Electric Illuminating Company, Paterson, N. J.
(1) Old chimney ; 184 feet high. Octagonal.

25. Edison Electric Illuminating Company, Paterson, N. J.
(2) New chimney ; 225 feet high. Circular.
26. Newland's Mills, Bradford, England.
Flue, 9 feet diameter ; 260 feet high.
Load on bottom on soil, 4.5 tons per square foot.
27. McCormack's Reaper Works.
Flue, 6 feet 8 inches diameter ; 160 feet high.
Load on soil, a dry hard clay, 1.8 tons per square foot.
28. Queen Lane Pumping Station, Philadelphia, Pa.
Flue, 12 feet diameter ; 200 feet high.
Foundation, 37 feet square by 24 feet deep.
29. Tweedvale Manufacturing Company.
Flue, 4 feet diameter ; 125 feet high.
Foundation, 19 feet square by 9 feet deep.
30. Grosvenordale Company, North Grosvenordale, Conn.
Flue, 5 feet diameter ; 150 feet high. *Power*, December, 1897.
31. New Chester Water Company.
Flue, octagonal ; area, 2,430 square inches ; height, 105 feet. Lined with fire-brick 20 feet up above the opening for breeching.
Furnishes draft to five 60 inch diameter by 16 feet horizontal tubular boilers.—*Engineering Record*, vol. xxv.
32. Chicago City Railway Company.
14 feet diameter of flue by 208 feet high. Top round ; base square.
Foundation, 50 feet square ; 16 feet deep.
For twenty-four 78 inches by 20 feet horizontal tubular boilers. John Mohr & Sons.—*Power and Transmission*, May, 1897.
33. Akron, Ohio, Street Railway and Illuminating Company.
Octagon exterior, brick, round flue ; 72 inches diameter ; 130 feet high.
34. Brisbane, Queensland, Australia, Electric Power Plant.
Brick chimney, 7 feet diameter of flue by 15 feet high, for 2,400 horse-power B. and W. boilers ; 1,200 of which is now in.



ILLUS. No. 30.

OLD COPPER WORKS CHIMNEY AT BELLEVILLE, N. J.

CHAPTER VIII

CHIMNEY PERFORMANCES.—SPECIAL TYPES.—STRAIGHTENING CHIMNEYS.—FLUES

CHIMNEY PERFORMANCES.

BRICK chimney, Dwight Manufacturing Company, Chicopee, Mass.

Flue, 4 feet square by feet high.

Burned through it 1,587.8 pounds anthracite coal per hour ;
burned through it 1,459.0 pounds combustible per hour ; draft
0.45 inch.

Horse-power developed in boilers, 460.9.

Equivalent evaporation per pound of combustible from and
at 212° = 11.17 pounds.

Coal burned per hour per square foot of grate = 10.97
pounds.

Boilers connected to chimney : 4 vertical Corliss boilers 8
feet diameter, and 2 vertical Corliss boilers 10 feet diameter.

A chimney 80 feet high, flue 42 inches diameter, has been
found to cause sufficient draft for a rate of combustion of 120
pounds of coal per hour per square foot of area of chimney, or
if the grate area is to the chimney area as 8 to 1, a combustion
of 15 pounds of coal per square foot of grate per hour, or a
total combustion of 1,154.4 pounds of coal per hour.—Kent :
"Transactions of the American Society of Mechanical Engi-
neers," vol. vi.

The author's Table No. 10 gives the capacity of this chimney
as 1,128 pounds.

A chimney 92 feet high, flue 50 inches diameter.

Area of 13.63 square feet ; area of flue inlet = 13.12 square
feet ; area of grate 48 square feet, with an air space of 21

square feet, with a temperature of chimney gases of 609° Fahr., caused sufficient draft for the combustion of 1,179 pounds of free bituminous coal per hour.—Gale: "Transactions of the American Society of Mechanical Engineers," vol. vi.

The author's formulæ, Table No. 10, gives the capacity of this chimney as 1,141 pounds.

"Transactions of the American Society of Mechanical Engineers," vol. xv., p. 610, says: "Three hundred boiler horse-powers were connected to a chimney 72 inches diameter of the flue by 125 feet high, with poor results; but when chimney was changed to 42 inches diameter by 125 feet high, the boilers worked much better."

The author's Table No. 8 gives the capacity of the latter chimney as 351 boiler horse-power.

Steel chimney, 38 inches diameter by 110 feet high, over a Cahall vertical boiler at Armstrong Cook Co's. Works, Pittsburg, Pa.

Tests by J. M. Whitham. Coal, nut and slack, from Sandy Creek Mine, near Pittsburg, Pa. Efficiency test, 917 pounds of coal burned per hour.

According to the author's formulæ, this chimney capacity is 1,073 pounds; capacity test, 1,702 pounds of coal burned per hour.

Brick chimney, 8 feet diameter flue by 175 feet high, Armour & Co's. plant, Kansas City, Mo.

Coal—Ardmor, Mo., bituminous Mine-Run coal. Tests by F. G. Gasche, M.E.

Flue temperature, 580° Fahr.; out-door temperature, 80° Fahr. (approximate).

Draft in chimney, 0.68 inch of water.

Boiler horse-power is 1,167.

Coal burned per hour, 7,198 pounds.—*Power*, August, 1897.

Steel chimney, 4 feet diameter flue by 100 feet high. Reid & Barry, Passaic, N. J.

Attached to two boilers rated at 250 horse-power each, with

a total of 104.76 feet of grate-surface, gave the following results with different coals used under boiler :

	Anthracite buck. coal.	Bituminous lump coal.
Temperature of external air.	45° Fahr.	42° Fahr.
Temperature of gases at base of chimney.....	372° Fahr.	427° Fahr.
Coal burned per hour, total dry.....	1,902 pounds.	1,865 pounds.
Force of draft in inches of water.....	0.48	0.55
Theoretical draft, we might look for.....	0.556	0.624
Barometer.....	30.35 inches.	29.9 inches.

Natural draft was used, and the coal burned in both cases coincides with what might be looked for from the author's tables.

An old chimney, 67 feet high, with internal diameter of 19.6 inches to 13.8 inches, and with a total distance from fire to chimney of 98 feet, was taken down, and a new chimney with an intended total distance from fire to outlet of 95 feet, and a minimum internal diameter of 25.5 inches was planned ; when the chimney had gone up 39 feet it was tried, already there was a great improvement on the old chimney ; again at 46 feet it was still better, and at 52.5 feet the draft was excellent, and there was an economy of 15 to 20 per cent. in fuel. The chimney was therefore finished at that height. Ramdohr of Gotha confirms this, and recommends a uniform internal diameter as being more rational and as protecting the brickwork from the hot and rapid axial stream.—*Journal du Gazet l'Electricitat*, 1897.

A steel chimney, 110 feet high, with flue 42 inches diameter, attached to a boiler rated at 250 boiler horse-power, with 57 square feet of grate-surface, under test, when starting the plant with outside air quiet, and with a temperature of 40° Fahr., showed the following results :

Temperature of gases at base of chimney..	300° F.	445° F.	525° F.	575° F.
Force of draft in inches of water.....	0.36	0.46	0.52	0.56

—Geo. H. Barrus, 1894.

OFFICE-BUILDING CHIMNEYS.

Tall office-building chimneys in the large cities are often made of steel, circular in shape, and placed in the ventilating shaft in many instances to assist it in the purifying of the air throughout the building; these chimneys need no special strength, being braced to the walls of the shaft and easy to support.

The metal and riveting should be proportioned as in guyed steel chimneys.

Other chimneys are of brick in office buildings built like any house chimney, while others of steel are placed in the "open air" or light shaft, as the chimney of the Manhattan Life Building, New York City; this is 4 feet 6 inches diameter of flue by about 360 feet high, and is secured to the wall by wrought-iron straps. It furnishes draft to three internally fired Scotch boilers, with 1,620 square feet of heating surface each, total 4,860 square feet.


The first record of steel chimneys in use in tall office buildings, is that at "the Fair," Chicago, Ill., built in 1890-91, which is described as follows:

Diameter of outside of 4-inch tile lining is 6 feet 9 inches.

Diameter of flue in clear at fire-brick lining, 5 feet 9 inches.

Diameter of flue in clear at tile lining, 6 feet 1 inch.

Height of chimney, 172 feet 6 inches.

Starting from the basement floor, the chimney rests on a brick base $2\frac{1}{2}$ feet high; at the base two 4 by 4 by $\frac{1}{8}$ -inch angles are riveted, one inside and one outside of the $\frac{1}{2}$ -inch shell, and they in turn rest on a cast-iron ring $1\frac{1}{2}$ by $8\frac{1}{4}$ inches in section, through all of which the $\frac{3}{4}$ -inch anchor or foundation bolts pass; thickness of shell is $\frac{1}{4}$ inch throughout, the first 40 feet is lined with fire-brick 6 inches thick, above which a 3 by 4 by $\frac{1}{8}$ -inch angle-iron is riveted thus  to the shell, and similar ones above this about every 15 feet, which carry the 4-inch tile-lining which goes to the top of shell.

The cap is made of $\frac{1}{4}$ -inch steel shaped like an inverted U, fitted outside of shell, and inside of tile riveted to shell.

The chimney is braced to the building by two 3 by 3 by $\frac{1}{2}$ -inch

angles fastened to columns. Space around the chimney is utilized for purposes of ventilation.—*Engineering Record*, vol. xxix., p. 157.

REMOVING BRICK CHIMNEYS.

A brick chimney octagonal in section, 135 feet high, external diameter 12 feet, base 17 feet square by 16½ feet high, with walls 3 feet thick, at a brick works in Lörincznyaralo, Hungary, was blasted by Lieutenant-Colonel Tangl of the army and his men.

Bricks were removed for about three feet in height, directly above the base, leaving two openings—one in front, one in the rear; this work being done by four men in nine hours.

The structure was to fall to the ground close to the base on account of nearby buildings.

A mine of 15 pounds of "ecrasite" was placed in one opening, and two of 11 pounds in the other, all placed 10 inches above the base in order to spare it.

They were fired simultaneously, and the chimney fell in a bottle-shaped mass just away from the base, occupying a length of 190 feet, height of 10 feet, and the greatest width was 56 feet at 66 feet from the base.

Observers did not feel the rush of air, but in the direction of the fall windows were broken at a distance of 260 and 500 feet.—*Engineering*, p. 658, 1898.

CAST-IRON OFFICE-BUILDING CHIMNEY.

University Block, Syracuse, N. Y., eleven-story steel-cage building.

Boilers, 470 boiler horse-power.


Chimney, 172 feet high; flue, 4 feet diameter.

Foundation, a bed of concrete 16 inches thick; on this 20-inch brick wall about 6 feet high, capped with a circular cast-iron shoe or base-plate. From this plate six sections of flanged cast pipe 4 feet 10 inches diameter are placed, lined with 4-inch fire-brick, capped again with a cast-iron plate on which stands the spigot end of the 4-foot inside diameter cast-

iron water-pipe, which, with bell ends and spigot ends, makes the balance of height of chimney, excepting the upper section, which tops out in a moulding above which is a serrated edge. The chimney is anchored to the floor-beams by $\frac{1}{2}$ -inch bolts.

In the building this chimney is surrounded by a double tile wall each 3 inches thick, 3-inch air-space between them, and greater air-space between tile and cast-iron chimney pipe.

—*Engineering Record*, vol. xxxviii., p. 190.

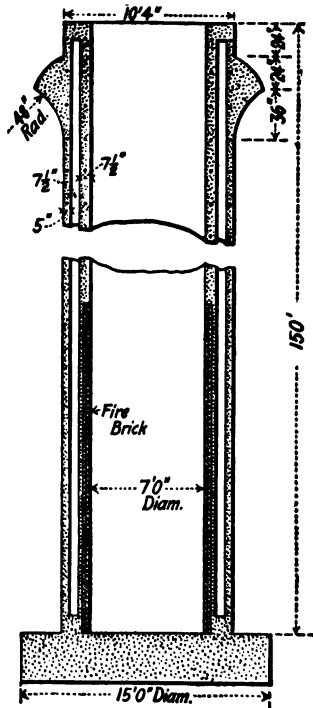

ILLUS. No. 31.

PACIFIC COAST BORAX COMPANY,
CONSTABLE HOOK, N. J.

MONOLITHIC FACTORY CHIMNEY.

Pacific Coast Borax Company, Constable Hook, N. J., 1898.

The entire mill is built of concrete and iron after E. L. Ransome's patent and by him, as is also the chimney.

Only the hottest zone of the chimney, bottom to 20 feet up, is protected by a fire-brick lining.

The reinforcement of this stack consists of $\frac{1}{2}$ -inch rings two feet apart vertically and eight $\frac{1}{2}$ -inch vertical bars in each wall of the chimney.

This chimney is built inside the factory, which protects it from wind strains up to a height of 70 feet, above which it rises 80 feet exposed to the elements.


The flue is 7 feet diameter by 150 feet high. Between the inner and outer shell are eight concrete and iron brackets, 6 inches wide, running the entire height of the chimney.—*Engineering Record*, vol. xxxviii., p. 189.



ILLUS. No. 32.

IRON FURNACES, STOCKHOLM, N. J.

Built about 1781, for forge using forced draught generated by water power. Wheel and wood cylinder at the right of the picture.

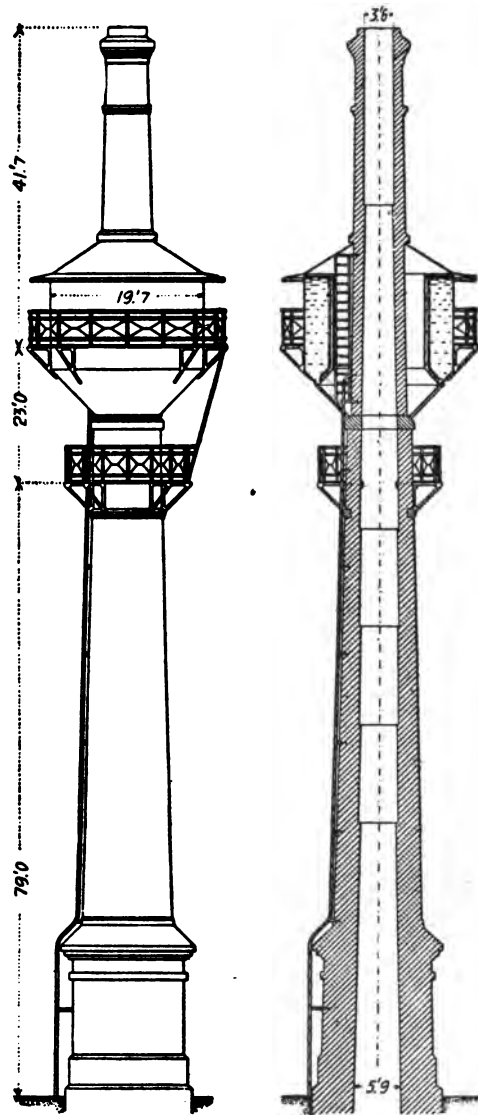*Engineering News.*

ILLUS. No. 33.

A WATER TANK SUPPORTED UPON A BRICK CHIMNEY.

CHIMNEY AS TANK TOWER.

Professor O. Intze and F. A. Nasmann, of Aachen, Germany, have patented such an arrangement. It consists of a brick chimney built as usual to where tank is to rest, where a capstone is placed upon it; from there upward the outside size of chimney is smaller, leaving a shoulder for tank brackets.

In an illustration in *Engineering News*, vol. xxxix., p. 287, the total height of the brick chimney is 143 feet, the base for tank being at 102 feet elevation.

Diameter of flue is 3 feet 6 inches at the top, and 5 feet 9 inches at the bottom. The steel tank has a capacity of 26,400 gallons, and space is left between it and the chimney for a ladder.

Several of these structures have been built of the capacity of the above, or less.

COMPARATIVE COST.

W. E. Crane, in *Power*, August, 1897, gives the cost of a brick chimney, with flue $8\frac{1}{2}$ feet in diameter by 150 feet high, as \$2,800, above the foundation, while for a steel chimney, for the same capacity, he gives \$3,500, above the foundation.


A 6,000 horse-power chimney of brick is estimated at \$6,000.

A 6,000 horse-power chimney of steel, lined half way up, \$11,600.

The base of brick chimney is 24 feet square. The base of steel chimney is 22 feet square.

W. B. Snow, in a paper read before the North Western Electric Association in 1898, which advocates the general substitution of mechanical for chimney draft, estimates the cost of a chimney with flue 8 feet diameter by 180 feet high to be \$9,300; while a fan outfit to replace the same would cost only \$3,500.

He does not give any figures relative to the cost of operating the fan, such as labor, steam consumption, oil, etc., which in the opinion of the writer would be a considerable item.

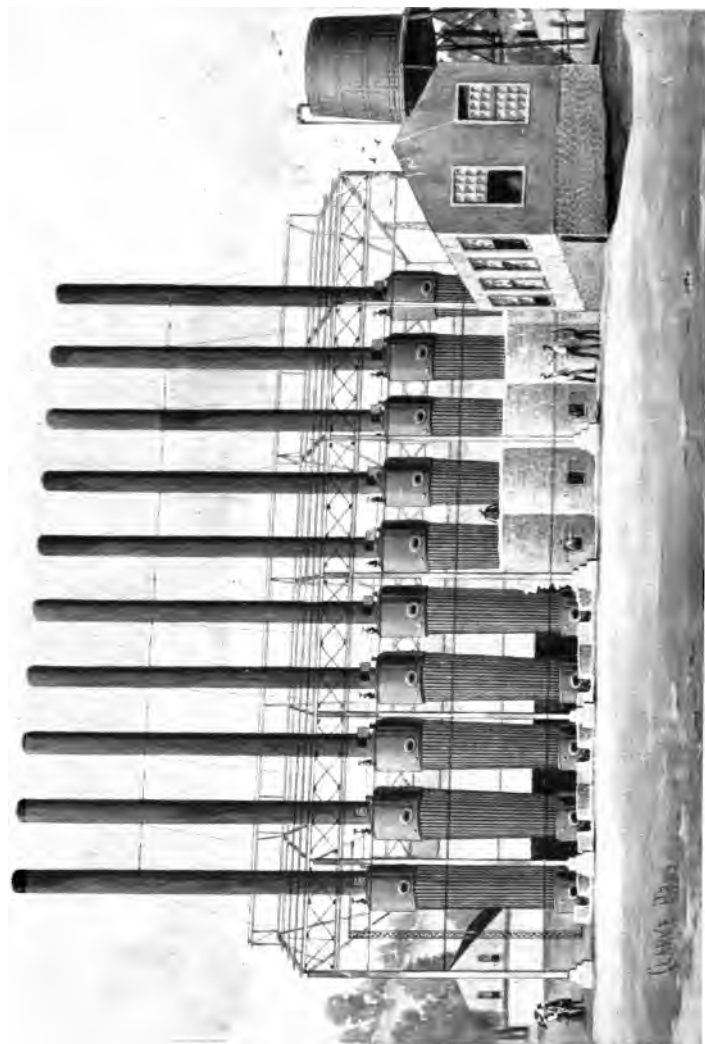

ILLUS. NO. 34.
CARNEGIE GAS COMPANY'S BAGDAD PLANT. CARALL BOILERS.

HIGH CHIMNEYS ARE NOT NECESSARY.

In the language of Professor Wood they are "a monument to the folly of the builders."


While multiple chimneys do not look as imposing as one stately structure, yet better results are often obtained by their use.

A notable example of chimneys in multiple is at the Spreckles Sugar Refinery, Philadelphia, Pa., where five chimneys are used for one plant of 7,500 horse-power of boilers, costing less than one chimney for the combined plant.


The new plant of the Carnegie Steel Company, Bagdad, Pa., is a still more striking example, as shown by Illus. No. 34.

The author has changed one plant from one chimney for two boilers to three chimneys for three boilers, with very beneficial results.


*This Style Made Use of by
Locom. Builders.*




Best to Split Wind, etc.



Bad.



Good.



Bad.

Chimney Top Designs.

STRAIGHTENING A CHIMNEY.

The Standard Concrete Manufacturing Company, Earnest, Pa., have a brick chimney 122 feet high, 11 feet square at the base, with tapering walls, weighing 400 tons; walls 36 inches thick.

The top leaned 45 inches from a vertical line. To sink the side $4\frac{1}{2}$ inches, $10\frac{1}{2}$ inches of brickwork were removed at the foundation from three sides, and square blocks of wood put in their places—brick piers being built 6 inches high so as to leave the $4\frac{1}{2}$ inch space.

The wood was then set on fire and made to burn evenly. As the top gradually swung over, small fissures which appeared on the bottom were filled with steel wedges, to maintain solidity of the walls.

The work consumed one day, the burning of the blocks one hour.—*Engineering News*, vol. xxxvi., p. 160.

CHIMNEY ACCIDENTS.

See a paper by Gustav Kaufman, before the Engineers Society of West Pennsylvania, giving data regarding a square chimney 125 feet high, built of brick, with rules. (Proceedings of Engineers Society of West Pennsylvania, June, 1893.)

TEARING DOWN OR RAZING A CHIMNEY.

The *Engineering News*, May 17, 1894, gives some details in relation to the successful tearing down of a square brick chimney, 75 feet high, by use of four dynamite cartridges set off at once.

STRAIGHTENING A CHIMNEY.


Square brick chimney, 100 feet high, leaning 28 inches, at factory of Ormsby Textile Company, Waterford, N. Y., erected in 1893, located one-third of a mile from the west bank of the Hudson River on north side of outlet of Mohawk River. The underlying rock is shale, irregularly covered by earth.


Chimney is 5 feet 4 inches square at the top, and 9 feet 6 inches square at the bottom, and has a flue 3 feet square; its foundation is 14 feet deep—4 feet by 14 feet square being concrete, and heavy stone-work 10 feet by 14 feet square at bottom, tapering to 9 feet 6 inches at top. Foundation weighs 149 tons, making with chimney 355 tons on 196 square feet of earth, or about 1.8 tons per square foot. — "Transactions of the American Society of Mechanical Engineers," paper dcxi.

This chimney settled in all about 0.598 of a foot. The manner in which it was straightened is described by Mr. J. C. Platt in part as follows:

"The work of straightening the chimney commenced on March 19, 1894. A scaffold was erected, and eight oak timbers 6 inches by 10 inches by 10 feet were placed at the corners at the height of 42 feet above the stone-work, and $4\frac{1}{2}$ feet below the centre of gravity of the brickwork; the object of the oak timbers being to spread the bearing of the wire ropes over as large a section as practicable.

"Wire ropes were passed around the timbers, and another



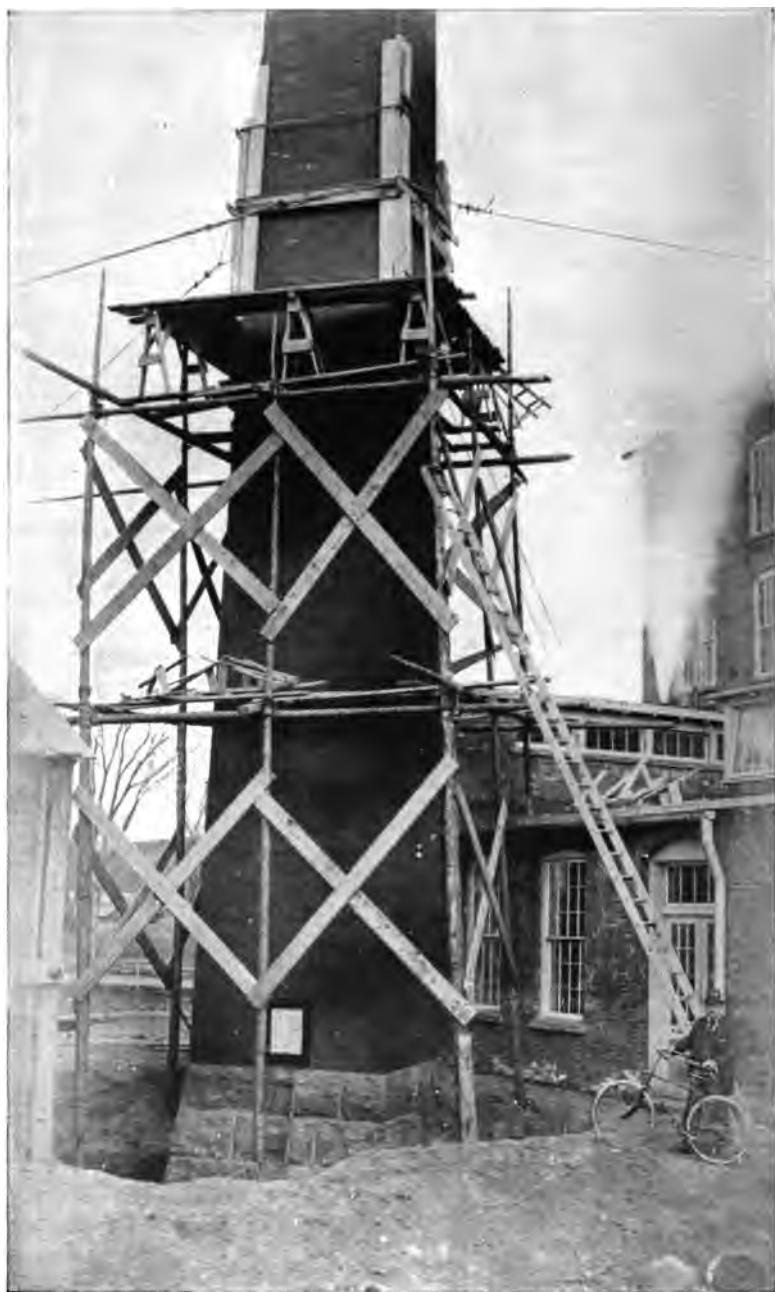

"Trans. A. S. M. E."

ILLUS. No. 35.

ORMSBY TEXTILE COMPANY, WATERFORD, N. Y.

wire rope $2\frac{1}{2}$ inches in diameter with eye in each end, was fastened to the first-mentioned ropes at its upper eye.

"The lower eye was connected with a system of pulleys secured to the dock at the river edge at a distance of 78 feet, and directly opposite the direction in which the chimney leaned, the pulleys being made up of three sets of double and single blocks connected together in series, having three points of fastening to the dock, and having eleven pulleys in a system.

"Cables were also put out from the chimney on each side at right angles to the main cable, and having turn-buckles to tighten them; also a guard cable in the rear.

"The earth was then excavated on the high side of the foundation nearly one-half way around the bottom of the foundation (to a depth of 13 feet), and the main cable put under strain with the pulleys.

"In the course of three weeks the chimney was brought back about 4 inches.

"Then with a post-hole digger, 8 inches in diameter, eleven holes were sunk vertically in the bottom of the trench around the foundation, principally at the highest point, to a depth of 5 feet 6 inches to 6 feet. At this time the water in the river stood up to within $1\frac{1}{2}$ feet of the bottom of the foundation; the ground being soft to a depth of 4 feet, it then became very hard, showing that the strata supporting the chimney had been reached.

"No movement or flow of the soil was discovered until the eighth hole was sunk $4\frac{1}{2}$ feet and the tool withdrawn for clearance, when it could only be reinserted readily about 3 feet and headway made very slowly.

"From this removal of the earth there resulted within a few hours a righting of the chimney of 5 inches, increasing to 8 inches by the next morning.

"The slack of the pulling-rope was taken up as fast as the chimney moved, and the rope was kept under strain.

"By tightening up the pulley-rope two or three times a day, in a week the chimney was brought back to $8\frac{3}{4}$ inches.

"In similar manner, the post-hole diggers being reduced to 6 inches diameter, about one-fifth as much more material was

removed, immediately followed by righting the chimney to 4 inches, and from that point, after filling the holes with fine broken stone and gravel thoroughly rammed, by continued daily strain on the main cable the chimney was brought back to plumb at the rate of a quarter of an inch per day.

"The turn-buckles in the side cables were occasionally used to control any tendency toward lateral inclination.

"The work has been accomplished without injury to the structure."

Chimneys have been straightened at Louisville, Ky., in a similar manner.

CHIMNEYS FOR FORCED DRAFT.

Chimneys for forced or induced draft should be made of sufficient diameter to carry off the products of combustion; and the writer recommends the top of such chimneys to be at least 15 feet above the top of the boiler-house roof or the roofs of adjoining structures.


If the greatest diameter of chimney flue, corresponding to the given horse-power or boiler plant, be looked up in the authors' table No. 8 for chimney sizes, it will coincide very closely with present practice, and give abundance of room, so as not to necessitate too high a velocity for the gases.

The above is applicable to either brick or steel chimneys.

By the use of the fan, high and expensive chimneys are done away with, and the capacity is not as limited as the ordinary chimney, and while the draft of the ordinary chimney is affected by the weather and climatic conditions, forced or induced draft can be regulated so as to be nearly constant in its effects, and there is less waste of heat of the flue gases.

The cheap grades of fuel can be used, in fact anything that will burn at all can be made use of, and money possibly saved, though the interest of the investment must be met, and the running expenses of the draft-producing appliance is never ending.


Provided mechanical draft is an easily applied remedy, unless the flue in the chimney is large enough of area, the results obtained will not meet one's expectations as well as a properly designed chimney; it may be said, however, that

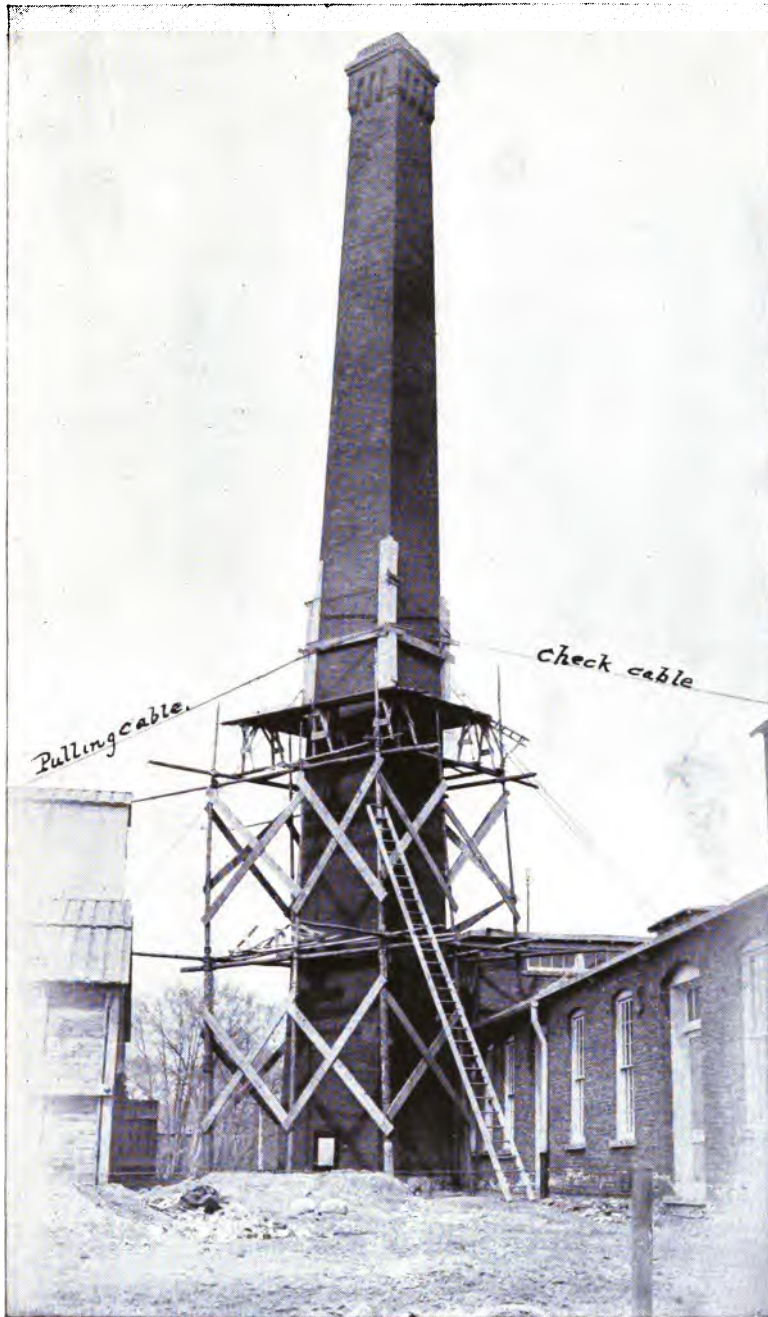

"Trans. A. S. M. E."

ILLUS. No. 36.

ORMSBY TEXTILE COMPANY, WATERFORD, N. Y.

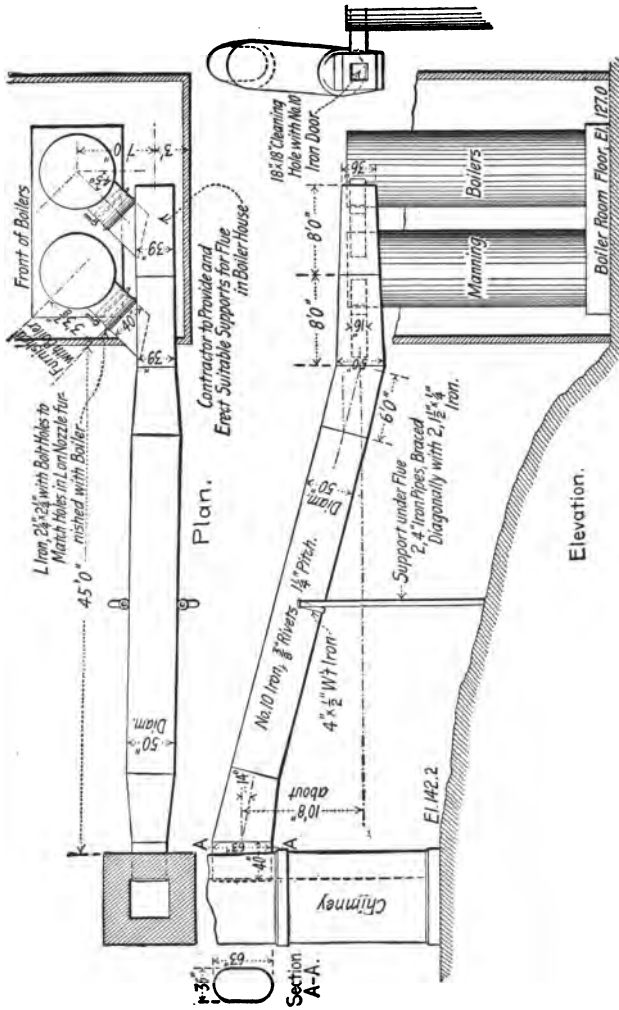

Flue for Vertical Boilers.
ILLUS. No. 37.

mechanical draft is a necessity in the burning of dust and rice coal and other cheap fine fuel.

FLUES.

In conveying the gases from the boiler furnace to the chimney a flue must be used fitted with an easily swinging damper close to boiler connection, and be made as air tight as possible all of the way to chimney flue.

Having seen that there is less friction in a round than square chimney to the flue gases, we should make the flue round whenever possible, and it is more easily built, while the square flue needs flanged corners or special angle-iron corners.

Round flues for more than one boiler are made tapering from a small size at first boiler to the largest size at chimney.

The area of the flue should be at all sections as large or larger than the total area of tubes emptying in it at that section.

When more than one flue is to connect with a chimney from opposite sides, a partition or deflector is provided so as to separate the two currents of gases, and deflect them upward.

Sometimes one opening is made at least three or four times its diameter above the other flue inlet, without a separator.


Overhead flue connections are of steel sheets, those under ground are sometimes of steel, but often of fire-brick laid in fire-clay and covered with red brick.

Exposed flues should be protected with hair felt, asbestos board, or some other heat retainer, that all the heat from the gases may be available in the chimney proper for draft.

The effect of changing the length of the flue leading into a chimney 60 feet high and 2 feet 9 inches square is as follows:

TABLE No. 26.
DRAFT POWER—VARYING FLUE LENGTHS.

Length of flue in feet.	Horse power.	Length of flue in feet.	Horse-power.
50	107.6	800	56.1
100	100.0	1,000	51.4
200	85.8	1,500	43.3
400	70.8	2,000	38.2
600	62.5	3,000	31.7

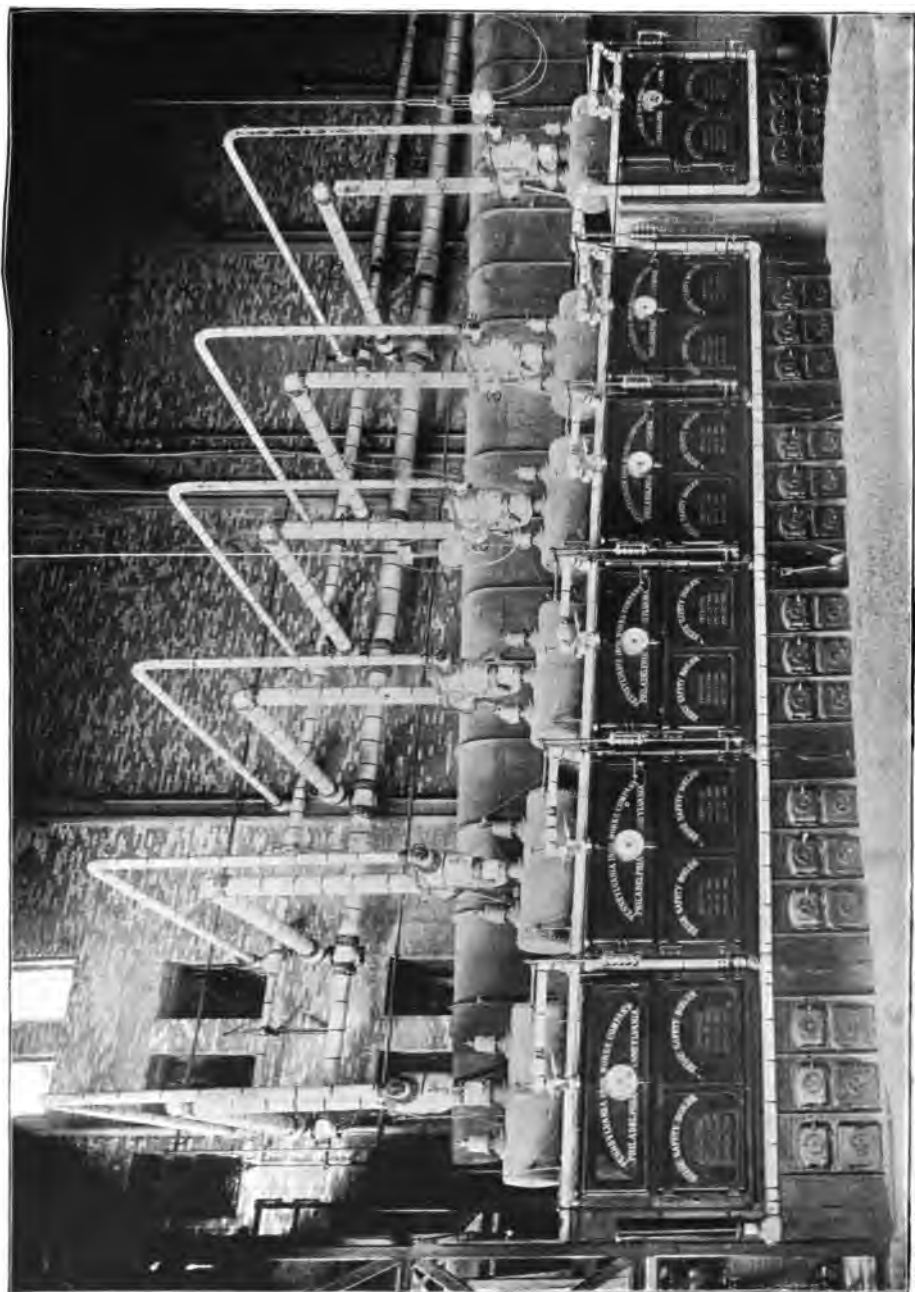

"Hobbs."

ILLUS. No. 38.

FLUE ARRANGEMENT 1,500 HORSE-POWER PLANT OF HEINE BOILERS, PART OF 4,500 HORSE-POWER PLANTS OF BROADWAY AND SEVENTH AVENUE CABLE RAILWAY COMPANY, NEW YORK.

The following table may also be useful.


TABLE No. 27.

REDUCTION OF CHIMNEY DRAFT BY LONG FLUES.

Total length of flues in feet....	50	100	200	400	600	800	1,000	2,000
Chimney draft in per cent.....	100	93	79	66	58	52	48	35

In the above the total length from grate to base of chimney must be considered.

When several boilers are connected with one flue, increase size as before noticed.

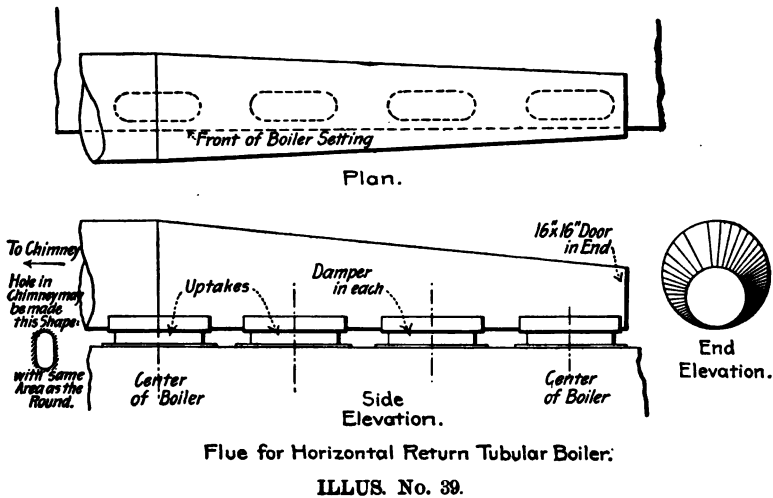

CHAPTER IX

HOUSE CHIMNEYS

HOUSE-HEATING

SCHUMAN * gives these formulæ for house-heating calculations.

Let A = sectional area of flue in square feet.

V = volume of smoke delivered in cubic feet per second; usually 600 is allowed for V .

K = pounds of coal consumed per hour.

H = height of chimney in feet.

v = velocity of smoke in feet per second.

t = external temperature, average 50° .

t_1 = internal temperature, average 550° .

$$(58) \quad v = 0.08 \sqrt{(t_1 - t)H},$$

$$(59) \quad A = \frac{12.5 V}{\sqrt{(t_1 - t)H}},$$

$$(60) \quad V = Av = A0.08 \sqrt{(t_1 - t)H},$$

$$(61) \quad H = \frac{156}{t_1 - t} \left(\frac{V}{A} \right)^2,$$

allowing 600 for V , we have

$$(62) \quad A = 0.128 \frac{K}{\sqrt{H}},$$

$$(63) \quad H = 0.01638 \left(\frac{K}{A} \right)^2.$$

The following table is adapted from the Blackmore Heating and Ventilation Company for hot-air furnaces.

* Manual of Heating and Ventilation, p. 69.

TABLE No. 28.
SIZE OF CHIMNEY FLUE.

Diameter of grate. Inches.	Area of grate. Square inches.	FLUE. INCHES.	
		Round.	Rectangular.
16	201	9	8 × 8
18	254	9	8 × 8
20	314	11	8 × 12
22	380	11	8 × 12
24	452	14	12 × 12
26	530	14	12 × 12
28	615	16	12 × 16
30	706	16	12 × 16
32	804	16	12 × 16

H. J. Barron, New York City, gives the following :

Chimney for a small dwelling..... 8 × 8 inch, rectangular flue.
 Chimney for a large dwelling..... 8 × 12 inch, rectangular flue.
 Chimney for a five-story flat, 25 × 80 feet 12 × 12 inch, rectangular flue.
 Chimney for a six-story flat, 36 × 80 feet..... 16 × 16 inch, rectangular flue.
 Chimney for a church, 400,000 cubic feet..... 20 × 20 inch, rectangular flue.
 Chimney for a school, 100 × 100 feet..... 20 × 20 inch, rectangular flue.
 Chimney for an office building, 100 × 100 feet. 30 × 30 inch, rectangular flue.

The Herendeen Manufacturing Company, Geneva, N. Y.,
 gives

For grates 16 inch diameter to 22 inch diameter..... a flue 8 × 8 inches.
 For grates 24 inch diameter to 26 × 34 inch rectangular a flue 8 × 12 inches.
 For grates 28 × 36 to 36 × 42 inches rectangular..... a flue 12 × 12 inches.
 For grates 36 × 56 inches rectangular..... a flue 12 × 16 inches.
 For grates 44 × 56½ to 44 × 70½ inches rectangular..... a flue 20 × 20 inches.

For chimneys in residences or other buildings where stoves or hot-air heaters are used, or where a low rate of combustion is desired, the writer proposes this formula, which is a very satisfactory one.

$$(64) \quad K = 2A\sqrt{H},$$

where K = grate area in square feet,
 A = flue area in square feet,
 H = height of chimney or flue in feet.

Giving H the value 49, which is somewhere near the height of house chimneys, the following table has been calculated :

TABLE No. 29.

GRATE.		CHIMNEY.	
Diameter, feet.	Area <i>K</i> , square feet.	Area <i>A</i> , square feet.	Diameter, inches.
1.6	2.0	0.571	10.8
1.80	2.5	0.714	11.4
1.95	3.0	0.858	12.6
2.10	3.5	1.000	13.5
2.25	4.0	1.142	14.5
2.4	4.5	1.285	15.5
2.52	5.0	1.429	16.2
2.64	5.5	1.571	17.0
2.76	6.0	1.714	17.8
2.98	7.0	2.000	19.2
3.19	8.0	2.285	20.5
3.38	9.0	2.571	21.7
3.56	10.0	2.858	22.9
3.74	11.0	3.142	24.0
3.90	12.0	3.429	25.1

The J. L. Mott Iron Works, from data gained during a long experience and close study of the subject, recommend the following table and its accompanying chimney proportions as absolutely safe.

TABLE No. 30.

Size of house in cubic feet.	RADIATING SURFACE.		Size of chimney. Inside measure. Inches.
	Square feet of direct hot water.	Square feet of steam.	
12,000	350 to 450	250 to 300	8 × 8
15,000	450 to 550	300 to 350	8 × 12
18,000	550 to 650	350 to 450	8 × 12
24,000	850 to 1,000	500 to 600	8 × 12
30,000	1,000 to 1,200	600 to 700	12 × 12
36,000	1,200 to 1,600	700 to 900	12 × 12
42,000	1,600 to 2,000	900 to 1,200	12 × 12
60,000	2,000 to 3,000	1,200 to 1,600	12 × 16
80,000	2,500 to 4,000	1,500 to 2,000	12 × 16
100,000	3,000 to 4,500	1,800 to 2,300	16 × 16
150,000	3,500 to 5,000	2,000 to 2,600	16 × 16
200,000	4,000 to 6,000	3,000 to 4,000	16 × 20
300,000	5,000 to 8,000	4,000 to 5,000	16 × 20
400,000	8,000 to 12,000	5,000 to 6,500	20 × 20
500,000	10,000 to 14,000	6,000 to 8,000	20 × 24
700,000	13,000 to 18,000	7,500 to 9,500	24 × 24

No illustrations of house chimneys are given in this work, for the reason that, having determined the flue proportions by engineering methods, all that remains is to provide a neat exterior, which is purely architectural in its demands; but the designer should bear in mind two things: first, to be plain in the treatment of the chimney top; second, build it high enough above roofs and surrounding objects, that there will be no down drafts or wind eddies to contend with.

As in mill construction so in house construction there is no detail which plays so important a part in the comfort of the occupant as the chimney which gives the draft to the heating apparatus.

It is an appurtenance which receives but little consideration in many cases, the architect or engineer being very liable to copy some one else's proportions in preference to working out the problem again, having determined the general flue dimensions by the general rules.

House chimneys should be made as straight as possible, and if slight bends occur they should be of the same cross-sectional area as the straight part, and be made round in shape, as this shape gives much less frictional resistance than a square flue. An inside flue is much better from any engineering standpoint than one outside of the building exposed to the weather.

Ample area is especially desirable in a house chimney, that the flue may take care of the smoke of the oft kindled fire, and area must be sufficient to counteract minimum draft.

House chimneys are usually built of brick, 4 inches thick around the flue for small chimneys, and 8 to 12 inches for very large chimneys.

For house-heating a flue 8×12 or 8×8 is the smallest that should be built, not because that area is necessary, but to overcome roughness of construction and of cleaning. For large houses use not less than 12×16 , and for steam plants use the writer's formulas and tables for anthracite coal, and elsewhere in this volume.

All other conditions being equal, the draft of a chimney varies as the square root of the height, the difference of temperature within and without the flue, and the flue area.

The straighter and more true the flue the more powerful the draft will be, but there are cases where even the best constructed and designed chimneys may and do smoke.

Fred. Hodgson says: "Some causes of chimneys smoking are well known and avoidable, the trouble arising perhaps from positive ill construction, having a narrow part and angle bend, or a downward portion in their conduit, which their normal draft is not sufficient to overcome.

"Others smoke because they form the shortest channel by which the air can enter the house to supply the draft to a higher chimney.

"When there are two chimneys in one room, or in rooms adjacent to each other, and the doors and windows are closed in all other rooms, the shorter will have its draft inwardly to supply the other with a current."

Sometimes the best constructed and most carefully designed chimney, with regard to the building in which it is situated, will smoke in consequence of its exit being in the immediate neighborhood of walls, hills, or trees whose situation is such as to create at times strong eddies and cross-currents.

In most cases, however, the addition of a few feet or so to the height of a chimney-shaft, supposing it to be already above the ridge of the house which it ventilates, will prove more useful than any addition of those curiously contorted and usually non-pneumatic contrivances that are so often planted on the top of a smoking chimney to cure it of its "cussedness."

Apart from the questions of normal draft and of internal regularity of construction, is the effect of wind on draft of chimneys. This varies very much with the locality of the house. The action of the wind, although, of course, always determined by physical laws, is so subtle and so delicately affected by slight causes, that there are many cases in which it is impossible to foretell it.

What is more common than to have a chimney that has been built according to the rules relating to chimneys, and which answers its purpose perfectly well, except when the wind is in one particular point of the compass.

And why does it smoke?

To be able to reply to this question is to be able to cure the defect; but how often is the difficulty regarded as insuperable?

The celebrated philosopher Count Rumford paid great attention to the subject of smoky chimneys.

He says: "Those who will take the trouble to consider the motion and properties of elastic fluids, of air, smoke, and vapor, and to examine the laws of their motions, and the necessary consequences of their being rarefied by heat, will perceive that it would be as much a miracle if smoke should not rise in a chimney—all hinderances to its ascent being removed—as that water should refuse to run in a siphon or to descend in a river.

"The whole mystery, therefore, of curing smoky chimneys is comprised in this simple direction: find out and remove those local hinderances which forcibly prevent the smoke from following its natural tendency to go up the chimney, or rather, to speak more accurately, which prevent it being forced up by the pressure of the heavier air in the room."

It is on record that Count Rumford prescribed for and cured more than 500 chimneys that had been given up as incurable, and his services were in constant demand whenever he was disposed to render them.

In Southern Italy, the land of "Master Builders," all chimneys are built over with some sort of a roof, either arched or run up to an acute angle, and so no architect ever thinks for a moment of leaving a vertical flue open at the top to receive the tremendous downpour of rain, which occasionally occurs in that sunny land.

The covering of the chimney, whatever it may be, has a number of apertures in its sides for the escape of smoke, and these openings are so constructed that when the wind strikes against them it receives an upward tendency, as the bottom or lower portions of the aperture slant upward in the same manner as a louver board.

By this method of construction two objects are attained, the slant carries the wind upward and thereby increases the draft by suction, and it prevents the water from finding its way down the flue.

A number of mill and house chimneys have their draft improved, and that to a considerable degree, by placing a blue-stone slab or iron-plate cover above the top with abundant side openings.

Another common cause for smoky chimneys that defies remedy, is the rubber weather-strips on doors, and other draft preventives, which keep all air from entering a room.

Such inlets must be allowed to exist, or special air inlets provided if we wish our chimneys to draw; again, high trees break up the wind currents as they come near a chimney and thus interfere with the draft.

BUILDING A CHIMNEY.

Brick chimneys seldom receive the care in construction that so important a structure should have.

The best and hardest bricks are usually put in the outer walls of a house, and the soft bricks, or "bats," relegated to the chimney.

This is folly, as will be appreciated by any one with a knowledge of the subject.

Good brick may be used at the top, but it is not there that there is danger of the fire eating through, but within the building where the soft brick have been used.

Tile flue-lining is rapidly coming into use and rightfully, as it makes a decidedly more efficient chimney—being as near as can be perfectly tight, and it does not absorb as much heat as a brick lining.

In topping out a house chimney there is a great difference of opinion as to what is the best mortar; one says one part of lime, and four parts cement, with sand enough to work; another says use only Portland cement throughout the whole chimney. Chimneys of "ye olden times" were laid up in simple lime mortar, and when torn down were found to be very solidly adhering masses; but the fuel used was mostly wood, and while we criticise the mason of to-day for poor lime mortar, we must bear in mind that gases generated by the combustion of coal are the principal destructors of chimneys, decomposing and destroying the life of the mortar which is employed,

and causing soft brick to chip and flake, while the gases from burning wood have scarcely any effect on a well-built chimney.

Use only the best hard brick throughout the chimney entirely; and cement mortar, and be particular to fill the joints full.

The writer has a decided preference for a severely plain chimney top, avoiding all saw-tooth effects, although the top may be drawn out a little all around, say the thickness of a brick length greater in diameter.

On top of the brickwork place a stone coping fastened with dowels of melted lead, and on top, in rainy climates, put a flat, smooth stone, supported at each corner by small blocks of stone; always keeping the opening larger than the size of flue, so as not to smother the draft.

Make the flue inside lining, if of brick, straight and smooth, taking a little extra pains in this direction.

All chimneys should be inspected annually, they should not be permitted to get choked with soot, for two reasons: first, a sooty chimney will not draw well, and it is in constant danger of firing; second, a chimney soot-lined offers special inducements for lightning to strike it.

CHAPTER X

LIGHTNING PROTECTION

Of an octagonal chimney, 260 feet 9 inches high by 14 feet diameter of flue at Narragansett Electric Lighting Company, Providence, R. I. (*Engineering Record*, 1891, p. 41), the cast-iron cap is encircled with a copper ribbon 1 inch by $\frac{3}{16}$ thick, to which are connected by a rivet and soldered joint, eight brass upright sockets, one in the centre of each panel of the cap.

To these brass sockets castings are secured, by soldered joints, $1\frac{1}{2}$ -inch seamless drawn-copper tubing, which extends upward above the cap and conforms to the shape thereof, and after projecting 5 feet above the upper portion of the cap the tubes are each surmounted by a brass casting 28 inches long, tapering in section and having at its extremity a platinum point $1\frac{3}{8}$ inches long.

The encircling ribbon around the cap is connected to the ground ribbon by a brass casting thoroughly riveted and soldered thereto, which, as it runs down the chimney, is secured in position by brass clamps with bolts built into the brick-work as it progressed.

The lower end of the ribbon, which is $\frac{3}{16} \times 1$ inch copper, rolled in one piece, 285 feet long, terminates in a copper plate 30 inches wide by 60 inches long and $\frac{1}{16}$ inch thick, and is buried 4 feet below the natural level of the water in the soil on the premises.

The above plate is buried in a load of powdered coke, 18 inches being placed above, and 18 inches in thickness below the plate, and the whole filled with gravel.

For the protection of brick chimneys, a platinum point or tip is a most excellent one for the top of the rod, but its ex-



ILLUS. No. 40.
CHIMNEY STRUCK BY LIGHTNING, JULY 29, 1890.
From *Eng. Zeds., Graham.*



pense sometimes prevents its use; but for small chimneys, \$50 for such a tip, about $1\frac{1}{2}$ inch high, is well spent, in fact, it makes a superior tip.

Notwithstanding its extreme hardness, the writer has seen such a point after having been struck, bent over something like a hook, but back close on itself. Another advantage of this metal is that it always keeps bright.

Steel or iron chimneys are never protected by rods or otherwise, as the metal in the chimney and the bolts running down deep in the foundation are considered enough protection; the writer does not know of a single steel chimney struck by lightning which produced any bad result.

For lightning protection see also descriptions of other brick chimneys.

The following extracts are made from a paper, "Protection from Lightning," published by the United States Army Weather Bureau.

"Trees near to ditches or water-courses taken by the deluge of water from the higher to the lower ground were more often struck. The same applies to building lightning-rods.

"To prevent the discharge of the fluid the conductor should be surrounded by points, though it often happens that lightning often disregards metallic surfaces altogether.

"*Erection of Rods.*—Few questions have been so thoroughly discussed from practical as well as theoretical stand-points as that of the certainty of the protection offered by properly constructed lightning-rods.

"*Use a Good Iron or Copper Conductor.*—If the latter, one weighing about 6 ounces to the foot, and preferably in the form of tape. If iron is used, and it seems to be in every way as efficient as copper, have it in rod or tape form, and weighing about 35 ounces to the foot. 'A sheet of copper constitutes a conductive path for the discharge from a lightning stroke much less impeded by self-induction than the same quantity of copper in a more condensed form, whether tubular or solid.'"
(Sir William Thomson.)

"The nature of the locality will determine to a great degree the need of a rod. Places apart but a few miles will differ greatly in the relative frequency of flashes.

"The very best ground you can get is, after all, for some flashes but a very poor one ; therefore, do not imagine that you can overdo the matter in the making of a good ground. For a great many flashes an ordinary ground suffices, but the small resistance of $\frac{1}{10}$ ohm for an intense oscillatory flash may be dangerous. Bury the earth plates in damp earth or running water.

"If the conductor at any part of the course goes near water or gas mains, it is best to connect it to them. Wherever one metal ramification approaches another it is best to connect them metallically. The neighborhood of small bore fusible gas-pipes and indoor gas-pipes in general should be avoided." (Lodge.)

"The top of the rod should be plated or in some way protected from corrosion and rust.

"Independent grounds are preferable to water and gas mains.

"Clusters of points or groups of two or three along the ridge-rod are recommended.

"Chain or linked conductors are of little use.

"*Area of Protection.*—Very little faith is to be placed in the so-called area of protection. The committee that first gave authority to this belief considered that the area protected by any one rod was one with a radius equal to twice the height of the conductor from the ground. Many lightning-rod manufacturers consider that the rod protects an area of radius equal to the height. The truth is that buildings are struck sometimes within this very area, and we now hold there is no such thing as a definite protected area.

"*Upward Motion of Stroke.*—There is no reason to doubt that the discharge takes place sometimes from earth to cloud. That is to say, that while we now consider a lightning flash as something like the discharge of a condenser through its own dielectric, made up of excessively frequent alternations, say something like 300,000 times per second, the spark or core of incandescent air may seem to have had its beginning at the earth's surface. That is to say, the air-gap breaks down first at a point near the earth.

"*Indifference of Lightning to the Path of Least Resistance.*—Nearly all treatises upon lightning, up to within very recent

times, assumed that lightning always followed the path of least resistance. 'It is simply hopeless to pretend to be able,' says Lodge, 'to make the lightning conductor so much the easier path that all others are out of the question.' The path will depend largely upon the character of the flash.


"Any part of a building, if the flash be of a certain character, may be struck, whether there is a rod on the building or not. Fortunately, these are exceptional instances. The great majority of flashes in our latitudes are not so intense but that a good lightning-rod, well earthed, makes the most natural path for the flash. We have many instances, however (not to be confounded with cases of defective rods), where edifices seemingly well protected, have been struck below the rods.

"Paradox of paradoxes, a building may be seriously damaged by lightning *without having been struck at all*. Take the famous Hotel de Ville of Brussels. This building was so well protected that scientific men pronounced it the best protected building in the world against lightning. Yet it was damaged by fire caused by a small induced spark near escaping gas. During the thunder-storm, some one flash started 'surging' in a piece of metal not connected in any way with the protective train of metal. The building probably did not receive even a side flash. This is, therefore, a new source of danger from within, and but emphasizes the necessity of connecting metal with the rod system.

"Lightning does sometimes strike twice in the same place. Whoever studies the effects of lightning's action, especially severe cases, is almost tempted to remark that there is often but little left for the lightning to strike again. No good reason is known why a place that has once been struck may not be struck again. There are many cases on record supporting the assertion.

"It is not judicious to stand under trees during thunder-storms, in the doorway of barns, close to cattle, or near chimneys and fireplaces. On the other hand, there is not much sense in going to bed or trying to insulate one's self in feather beds. Small articles of steel, also, do not have the power to *attract* lightning, as it is popularly put, or determine the path of discharge.

"Unnecessary Alarm."—Just in advance of thunder-storms, whether because of the varying electrical potential of the air, or of the changing conditions of temperature, humidity, and pressure, and failure of the nervous organization to respond quickly, or to whatever cause it may be due, it cannot be denied that there is much suffering from depression, etc., at these times. It is, perhaps, possible that these sufferings may be alleviated. Apart from this, many people suffer greatly

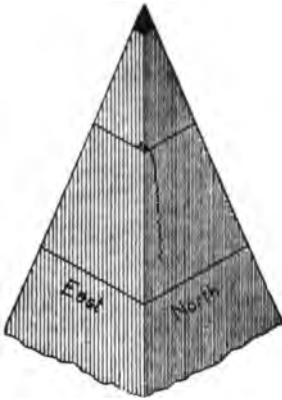

ALUMINIUM TIP OF WASHINGTON MONUMENT.

Aluminium tip weighing 100 ounces. Nearly 9 inches high, $5\frac{1}{4}$ inches square at base. Height from ground, 555 feet (169 metres).

Struck April 5, 1885, without damage. Struck June 5, 1885—Crack on north face just under top stone, extending through the block in a line nearly parallel to northeast corner.

from *alarm* during the prevalence of thunder-storms, somewhat unnecessarily, we think. Grant even that the lightning is going to strike close in your vicinity. There are many flashes that are of less intensity than we imagine, discharges that the human body could withstand without permanent serious effects. Voltaire's caustic witticism 'that there are some great lords which it does not do to approach too closely, and lightning is one of these,' needs a little revision in these days of high potential oscillatory currents. Indeed, the other saying, 'Heaven has more thunders to alarm than thunderbolts to punish,' has just so much more point to it, as it is nearer the truth. *One who lives to see the lightning flash* need not concern himself much about the possibility of personal injury from that flash.

"On June 5, 1885, the Washington Monument, at Washington, D. C., at that time the highest edifice in the world, was struck by lightning, resulting in no damage. On June 5, 1885, it was again struck, leaving a crack; a commission appointed to investigate and recommend additional protection did so with the following results and procedure: Four $\frac{1}{4}$ -inch copper rods were fastened by a band to the aluminium terminal and led down the corners to the base

of the pyramidion, and then through the masonry to the columns.

"As these exterior rods are each over 60 feet long, they are also connected at two intermediate points of their lengths with the iron columns by means of copper rods $\frac{1}{4}$ and $\frac{1}{4}$ inch in diameter, respectively, furnishing 16 rods in all, connecting the exterior system of conductors with the interior conducting columns. Where the exterior rods upon the corners cross the 11 highest horizontal joints of the masonry of the pyramidion they are connected to each other all around by other copper rods sunk into those joints. All of these exterior rods, couplings, and fittings are gold plated, and are studded at every 5 feet of their lengths with copper points 3 inches in length, gold plated and tipped with platinum. There are 200 of these points in all."

Eight years have now passed since the alterations were made and the monument stands uninjured. Unquestionably, standing as it does, 555 feet high, in the centre of flat, well-watered ground, it constitutes a most dangerous *exposure* for lightning flashes. No better illustration of the value of lightning conductors can be asked.

CHAPTER XI

GENERAL INFORMATION

TWENTY cubic feet = 16 bushels of sand, 4 cubic feet = 32 struck bushels of quicksand, will make $22\frac{1}{2}$ cubic feet of mortar, and will lay $1,000\ 2 \times 4 \times 8\frac{1}{4}$ -inch bricks, with $\frac{3}{8}$ to $\frac{1}{2}$ -inch joints.

A good bricklayer will in a day of ten hours lay 1,500 brick if provided with a laborer to keep him supplied with materials, but in chimney-work the number of bricks laid will depend on design of chimney and elevation above ground of scaffold, from which they are laid.

John C. Trautwine, Esq., furnishes the following directions for cement mortar:

A barrel of cement, 300 pounds, and two barrels of sand (six bushels or $7\frac{1}{2}$ cubic feet) mixed with about half a barrel of water, will make about 8 cubic feet of mortar sufficient for

192 square feet of mortar, joint $\frac{1}{2}$ inch thick;

288 square feet of mortar, joint $\frac{3}{8}$ inch thick;

384 square feet of mortar, joint $\frac{1}{4}$ inch thick;

768 square feet of mortar, joint $\frac{1}{8}$ inch thick;

or, to lay 1 cubic yard, or 522 bricks of $8\frac{1}{4} \times 4 \times 2$ inches with joints $\frac{3}{8}$ inch thick, or a cubic yard of rubble stone-work. The quantity of sand may be increased to 3 or 4 measures for ordinary work.

Two barrels of cement and two barrels of sand will be sufficient to lay 1,000 bricks.

Five pounds of salt added to each 20 gallons of water used with cement, will prevent its freezing at a temperature of 10° below zero.

It quickens the hardening and does not materially reduce the ultimate strength.

SMOKE PREVENTION.

Colonel Dullier, of the Belgian Engineers, has designed an apparatus or device for the absorption of smoke which has been installed at the boiler-house of the South Kensington Museum, London, also at Glasgow, Scotland.

Tests of the latter showed in one case a reduction of the soot in the gases from $73\frac{1}{2}$ grains per 100 cubic feet before treatment to 2 grains after treatment; and in a second case, from 23.3 to 1.5 grains.*

The products of combustion before entering the chimney are taken up one leg of an inverted U-shaped flue, made of galvanized iron, being assisted in their upward course by a steam-jet.

The jet assists in the condensation of the tarry products, and saturates the dust with water vapor. In descending the second leg of the flue the products of combustion are brought in contact with a large number of upward inclined water sprays, which are intended to thoroughly wash the smoke, moistening all particles of dust.

The smoke and water next pass through a chamber containing a helical passage in which they are made to still further commingle, and after all this the gases are allowed to pass into the chimney proper, while the sulphurous wash-water is drained off.

The draft in the flue and chimney, measured with a water-gauge, is said to have shown no diminution after the erection of the apparatus.†

MISCELLANEOUS.

The first mention made of the use of coal as a fuel is in the records of the Abbey of Peterborough, in the year 850 A.D., where is found an entry for twelve cart-loads of "fossil fuel."

To fix bolts in stone-work, Dinger's *Polytechnic Journal* recommends a mixture of 3 parts of sulphur with 1 part Portland cement as superior to either individual constituent.

If cast-iron or bluestone is used for a chimney cap, iron clamps should not be used, according to J. L. Fitzgerald, as they will oxidize and burst the material.

* "Cassiers," December, 1897, p. 182.

† Engineering Record, xxix., p. 385.

BUILDING LAWS OF BOSTON, MASS.

Acts of 1892. That Portion Relating to Chimneys.

Section 68. No chimney shall be corbelled from a wall more than the thickness of the wall, nor be hung from a wall less than twelve inches thick, nor rest upon wood.

All chimneys shall be built of brick, stone, or other incombustible materials.

Brick chimneys shall have walls at least eight inches thick, unless terra-cotta flue linings are used, in which case four inches of brickwork may be omitted.

Other chimneys shall have walls eight inches thick, and in addition a lining of four inches of brickwork or a terra-cotta flue-lining.

The inside of all chimneys shall have struck joints. No wood furring shall be used against or around any chimneys, but the plastering shall be direct on the masonry or on metal lathing.

All chimneys shall be topped out at least four feet above the highest point of contact with the roof.

No nail shall be driven into the masonry of any chimney.

Section 69. Flues of ranges, boilers, and other similar flues, shall have the outside exposed to the height of the ceiling, or be plastered direct upon the bricks.

Section 70. All hearths shall be supported by trimmer arches of brick or stone; or be of single stones at least six inches thick, built into the chimney and supported by iron beams, one end of which shall be securely built into the masonry of a chimney or adjoining wall, or which shall otherwise rest upon incombustible supports.

The brick jambs of every fireplace, range, or grate opening shall be at least eight inches wide each, and the back of each shall be at least eight inches thick.

All hearths and trimmer arches shall be at least 12 inches longer on either side than the width of such openings, and at least 18 inches wide in front of the chimney-breast.

Brick over fireplaces and grate openings shall be supported by proper iron bars, or brick or stone arches.

Section 71. Every chimney in which soft coal or wood is

burned, shall be carried to a height sufficient to protect neighboring buildings from fire or smoke.

Section 72. No smoke-pipe shall project through any external wall or window.

No smoke-pipe shall pass through any wooden partition, without a soapstone ring of the thickness of the partition, with a ventilated air-space of not less than 4 inches around the pipe, nor shall be placed within 8 inches of any wood unless such wood is plastered and protected by a metal shield 2 inches distant from the wood, in which case the smoke-pipe shall not be less than 6 inches from the wood, etc.

TABLE No. 31.

PHYSICAL PROPERTIES OF MATERIALS OF MASONRY, ETC.

All stresses given in pounds per square inch.

Materials.	Ultimate crushing strength.	Transverse strength.	Modulus of elasticity.	Weight per cubic foot.
Brick, flatwise paving.....	{ Max. 20,800	8,100	4,000,000	150
Paving brick, Philadelphia specifications :	{ Min.. 4,880	1,350	2,000,000	
Red shale.....	{ 9,090	5,000		
	{ 18,000	6,000		
Yellow fire-clay.....	{ 8,000	5,800		
	{ 10,000	6,200		
Hard building.....	{ Max. 18,400	1,250	4,000,000	125
Soft building.....	{ Min.. 3,800	300	2,000,000	
Concretes, 1 month old, of following compositions : *				100
Cement mortar, 1 of natural cement, 2 of sand.....	250 to 500			109
Natural cement mortar and furnace slag.....	250 to 500			120
Natural cement mortar and sandstone.....	250 to 500			136
Natural cement mortar and limestone.....	250 to 500			142
Natural cement mortar and granite.....	250 to 500			142
Natural cement mortar and trap.....	250 to 500			147
Cement mortar, 1 of Portland cement, 2 of sand.....	250 to 500			134
Portland cement mortar and furnace slag.....	250 to 500			137
Portland cement mortar and sandstone.....	250 to 500			153
Portland cement mortar and limestone.....	250 to 500			159
Portland cement mortar and granite.....	250 to 500			159
Portland cement mortar and trap.....	250 to 500			164
Granite.....	{ Max. 24,450	2,700	13,000,000	164
	{ Min.. 12,000	900	1,620,000	
Limestone.....	{ Max. 22,300	2,500	8,000,000	158
	{ Min.. 7,000	150	336,000	
Marble.....	{ Max. 20,000	2,850	13,550,000	170
	{ Min.. 4,650	150	2,500,000	
Sandstone.....	{ Max. 18,750	2,350	2,315,000	139
	{ Min.. 4,100	350	270,000	
Slate.....			7,000,000	174
Trap.....	22,000			170

* Concretes after six months will be about four times, and at the end of one year will be about six to seven times as strong as at the end of the first month.

—Pencoyd Iron Works, 1898.

AIR.

The air is composed of nitrogen, 78.5 parts ; oxygen, 20.6 ; aqueous vapor, .86, and carbonic acid, .04 part. Air contains about 4 grains of moisture per cubic foot.

Air is increased in volume by elevation of temperature. An increased volume of a constant weight of air, of which the initial volume = 1 at 32° Fahr., heated to a given temperature under atmospheric pressure of 14.7 pounds per square inch, may be found by this rule :

$$(65) \text{ Increased volume of air} = \frac{\text{Given temperature} + 461}{32 + 461}.$$

If the temperature be taken at 62° Fahr., as in table on page 13, instead of 32°, the divisor is

$$62 + 461 = 523.$$

The weight of atmospheric air is .08072 pound at 32° Fahr.; under the pressure of one atmosphere at 62° Fahr., the weight is .076098.

INDEX

	PAGE
Accidents, Chimney.....	130
Adams, Chimney formulæ.....	16, 17
Air	154
" space in grates.....	28
Akron, Ohio, Street Railway & Illum. Co....	Brick Chimney.... 120
Aluminum tip of Washington Monument.....	148
Amoskeag Mills, Manchester, N. H.....	Brick Chimney...91, 119
Anchorage.....	Steel Chimneys.... 54
Anheuser-Busch Brewing Company	Illus. No. 6, opposite 63
Area of protection from lightning	146
Arnold Print Works, North Adams, Mass....	Steel Chimneys.... 71
Aspinook Company, Jewett City, Conn.....	Steel Chimney..... 71
Astoria, L. I., Steinway Electric Company.....	108
	Illus. No. 26, opposite 109
Baltimore, Md., City and Suburban Ry. Co..	Steel Chimney..... 69
Barbour Flax Spinning Co., Paterson, N. J.....	Brick Chimney,
	Illus. No. 29, opposite 116
Baseplates.....	Steel Chimneys.... 44
Bearing power of soils	31
Belleville, N. J.....	Brick Chimney,
	Illus. No. 30, opposite 121
Bonding	Brick Chimneys ... 82
Boston, Mass., East Boston Electric Railway Power Station	
	Steel Chimney..... 70
Boston, Mass., Building laws of, regarding chimneys.....	152
Bradford, England, Mitchel Bros	Brick Chimneys.... 119
" " Newland Mills.....	" " 120
Brick chimney as a tank tower.....	Illus. No. 33, opposite 127, 128
" chimneys, bonding ...	82
" " general notes	81
" " list of	117
" " material	81

	PAGE
Brick chimneys, material for 2000 H. P.	112
“ “ mortar	82
“ “ progress	81
“ “ rules for, Bassine	76
“ “ rules for proportions of	75
“ “ stability of	76
“ “ “ Rankine	76
“ “ three.....Illus. No. 2 opposite p. 31 and Illus. No. 17, opposite	89
“ “ weather	81
“ lining	Steel Chimneys 44
Brisbane, Queensland, Australia	Brick Chimney 120
Bristol, Conn., New Sessions Foundry	“ “ 118
Bronx Company	Steel “ 69
Brooklyn, N. Y., Manhattan Street Ry. Co. .	“ “ 69
“ “ Ridgewood Pumping Sta'n “ “	69
“ “ “ “ “ Illus. No. 4, opposite	58
Brook's Fire Clay Works, Huddersfield, Eng. Brick Chimney	119
Building a chimney	142
Building laws of Boston, Mass., regarding chimneys	152
Burden Iron Company, Troy, N. Y.	Steel Chimney..... 69
Cambria Iron Co., Johnstown, Pa.	110
“ “ “ “ “ Illus. No. 27, opposite	111
Carnegie Gas Company's Bagdad plant ...	Illus. No. 34, opposite 129
Cast-iron office-building chimneys	125
Cheney Bros.' Silk Mills, South Manchester, Conn. Illus. No. 24,	105
Chicago, Ill., City Railway Company	Brick Chimney..... 120
“ “ Elevated Railroad Company ..	Steel “ 73
“ “ Garfield Park Electric Light and Power Company,	Steel Chimney..... 68
“ “ Gottfried Brewing Company .. “ “	72
“ “ United Glass Company	“ “ 71
“ “ Refining Company's chimney	36
Chimney accidents	130
“ building a	142
“ draft	6
“ “ Peclet's and Rankine's hypotheses	6
“ “ DeVolson Wood	6
“ for houses, design of	136, 137, 139
“ formulae, Adams	16, 17
“ “ A. S. M. E.	17
“ “ Christie	21

	PAGE
Chimney, formulæ, Clark.....	16
" " Gale.....	15
" " Jones & Laughlin.....	17
" " Kent.....	17
" " Molesworth.....	17
" " Nystrom.....	17, 18
" for office buildings.....	124
" in multiple.....	129
Illus. No. 34, opposite	129
" performances.....	121
" struck by lightning.....	Illus. No. 40, opposite 144
" table, Gale.....	16
" " grate area.....	22, 23, 26
" " horse-power.....	23, 24
" " pounds of coal burned per hour.....	24, 26
" " water-heating surface in boilers.....	25
" top design.....	129
Christie chimney formulæ.....	21
City and Suburban Railway Company, Baltimore, Md.,	
Steel Chimney.....	69
Clark's Thread Works, Kearny, N. J.....	Brick Chimney 101
Clark, D. K., rule for strength of hollow tubes.....	47
Clarke, E., " " " " ".....	47
Clarke chimney formulæ.....	16
Cleveland, Ohio, Electric Illuminating Co., Steel Chimney.....	69
" " Rolling Mill.....	" " 70, 73
Combustion diagram.....	Plate I, opposite 19
Comparative cost.....	128
Compression of stones, tests at Watertown Arsenal.....	38
Concrete.....	33
" factory chimney.....	126
Consolidated Gas Co. of N. J., Long Branch.. Steel Chimney.....	71
Constable Hook, N. J., Pacific Coast Borax Co.....	Illus. No. 31, 126
Copper conductor for lightning.....	145
Cost, comparative.....	128
Creusot, France, wrought-iron chimney.....	60, 70
" " steel chimney, Schneider's.....	72
Crossley's, Halifax, England.....	Brick Chimney 119
Cylindrical beams, moments of resistance of thin hollow.....	46
Darwin & Mostyn.....	Iron Chimney 71
Denver, Col., Omaha & Grant S. & R. Works.....	104
Illus. No. 23, opposite	104

	PAGE
Design of chimneys for houses	139
Draft.....	6
" power—varying flue-lengths.....	134
" " —reduction of, by long flues.....	135
" powers of chimneys.....	13
Dublin, Ireland, United Tramways Company Steel Chimney.....	73
Duluth, Minn., Hartman General Electric Co. " "	70
Dundee Chemical Works, Passaic, N. J.....Brick "	118
East Boston, Mass., Electric Railway Power Station.Steel Chimney	70
East River Gas Co., Long Island City, N. Y..... " " .	71
Edinburgh, Scotland, Gas Light Company Brick " .	119
Edison Electric Illuminating Co., Paterson, N. J.....	89, 90
" " " " " " " Illus. No. 18,	89
" " " " " " " Illus. No. 19, opposite 90,	119
" " Light & Power Co., San Francisco, Cal.....	106
" Lighting Station, New York City.....Steel Chimney.....	73
Elevated Railroad Company, Chicago, Ill..... " "	73
Erection of lightning rods.....	145
Etna Iron Works, Ironton, Ohio Steel Chimney.....	70
Expansion of stones, tests, Watertown Arsenal	37
Fairbairn's experiments	47
Fall River Iron Company.....Brick Chimney.....	118
Flues	134
" draft-power of varying lengths	134
" for horizontal boilers	Illus. No. 39, 135
" " " " " " " Illus. No. 38, opposite	134
" " vertical " " " " " Illus. No. 37,	133
" sizes of, for house heating.....	137, 138
Force or intensity of draft	11
Foundations, Chicago Refining Company chimney.....	36
" Maryland Steel Company chimney.....	36
" McCormack Reaper Works "	39
" of self-supporting steel chimney, stability of.....	53
Frankfort-on-Main, Germany, Municipal Lighting Plant,	
Brick Chimney. ...	119
Freiburg, Saxony.....Brick Chimney.....	86
Illus. No. 15	87
Friction in tubes, Clemens Herschel.....	50
Gale chimney formula.....	15
" " table.....	16

	PAGE
Garfield Park Electric Light and Power Company, Chicago, Ill., Illus. No. 10,	68
Gases, velocity of.....	29
General notes, brick chimneys.....	81
Glasgow, Scotland, Townsend..... Brick Chimneys...	119
Gottfried Brewing Company, Chicago, Ill.... Steel Chimney.....	72
Grate area, table.....	22, 23, 26
Grates, air-space in.....	28
Grosvenordale (Conn.) Company..... Brick Chimney...	120
Guggenheim Smelting Co., Perth Amboy, N. J., Illus. No. 7, opp.	64
Guyed steel chimneys, rule for guys.....	41
" " " weights, etc.....	41
" " chimney—48 inches by 125 feet high.....	59
Guys for steel chimneys.....	40, 41
Halifax, England, Crossley's..... Brick Chimney...	119
Hartford Steel Railway Co.'s steel chimney, description.....	48, 69
" " " " " " Illus. No. 3, opposite	48
Hartman General Electric Co., Duluth, Minn. Steel Chimney.....	70
Height of chimneys for various fuels.....	28
Height of water column due to unbalanced pressure in chimney.	12
Heights of chimney and corresponding heads.....	10
Historical notes.....	1
Hollow tubes, E. Clarke's rule.....	47
" " D. K. Clark's rule.....	47
Holyoke (Mass.) Machine Company..... Brick Chimney.....	93
Hornsley, England, refuse destructor chimney.....	83
Horse-power—chimney tables.....	23, 24
House-heating, chimneys and flues for.....	136
Huddersfield, Eng., Brook's Fire Clay Wks. Brick Chimney....	119
Indifference of lightning to the path of least resistance.....	146
Intensity of draft, force or.....	11
Introductory.....	1
Ironton, Ohio, Etna Iron Works..... Steel Chimney.....	70
Ivorydale, Ohio, details of brick chimney..... Illus. No. 26,	109
Jersey City, N. J., Penn. Railroad Co..... Steel Chimney....	69
Jewett City, Conn., Aspinook Company..... " " 	71
Johnstown, Pa., Cambria Iron Company..... 110, Illus. No. 27,	111
Kansas City, Mo., Metropolitan Street Ry. Co. Steel Chimney.....	73
Kearny, N. J., Clark's Thread Works.....	101
Kent, chimney formulæ.....	17

	PAGE
Kineshmia, Russia.....	Steel Chimney 72
Knoxville, Tenn.....	Brick Chimney.... 117
Lawrence, Mass., Lower Pacific Mills.....	Brick Chimney 119
“ “ Pacific Mills.....	“ “ 94
“ “ Washington Mills.....	“ “ 119
Lightning, chimney struck by.....	Illus. No. 40, opposite 144
“ protection of Narragansett Elec. Light Co.'s chimney	144
“ rods, erection of.....	145
Long Branch, N. J., Consolidated Gas Co....	Steel Chimneys.... 71
Long Island City, N. Y., East River Gas Co..	“ “ 71
Loose soil, chimney on.	39
Lowell, Mass., Merrimack Mfg. Co.....	Brick Chimney...91, 118
“ “ Tremont and Suffolk Mills... “ “	119
Lower Pacific Mills, Lawrence, Mass.....	“ “ 119
McCormack's Reaper Works.....	Brick Chimney...39, 120
Manchester, N. H., Amoskeag Mfg. Co.....	“ “ ...91, 119
“ “ pumping station.....	“ “
	Illus. No. 12, opposite 83
Manhattan St. Ry. Co., Brooklyn, N. Y.....	Steel Chimney..... 69
Maryland Steel Company's chimney foundation.....	36
“ “ Company, Sparrow's Point, Md.....	66, 70
“ “ “ “ “ “.....	Illus. No. 9, 67
Masonry materials, proportions for estimating.....	150
Material for 2,000 H. P. brick chimney.....	112
Materials of masonry, physical properties of.....	153
Mechernich Lead Mining Company.....	Brick Chimney 117
Merrimack Mfg. Co., Lowell, Mass.....	“ “ ...91, 118
Metropolitan St. Ry. Co., Kansas City, Mo..	Steel “ 73
“ “ power house ch. N.Y.C.	Brick “ ..113, 114
Middlesborough, England.....	Steel “ 72
Miscellaneous.....	151
Mitchel Bros., Bradford, England.....	Brick “ 119
Molesworth chimney formulæ.....	17
Moments of resistance of thin hollow cylindrical beams.....	46
Monolithic factory chimney.....	126
Montreal, Can., Street Railway Company....	Brick Chimney 117
Mortar, brick chimneys.....	82
Moving brick chimneys.....	125
Multiple, chimneys in.....	Illus. No. 34, opposite p. 129.... 129
Municipal lighting plant, Frankfort-on-Main, Germany,	
	Brick Chimney 119

	PAGE
Narragansett Electric Lighting Company, Providence, R. I.	95, 96, 97
New Chester (Pa.) Water Co	Brick Chimney.... 120
Newland's Mills, Bradford, England.....	" " 120
New York City, Edison Lighting Station....	Steel " 73
" " " Met. St. Ry., power house...	Brick " ..113, 114
North Adams, Mass., Arnold Print Works....	Steel " 71
Nystrom chimney formulæ.....	17, 18
Office building chimneys	124, 125
Omaha & Grant S. & R. Works, Denver, Col.	104
	Illus. No. 23, opposite 104
Ormsby Textile Co., Waterford, N. Y.....	130
	Illus. No. 35, opposite 131
" " " " " " " " " " " "	Illus. No. 36, opposite 132
Pacific Coast Borax Co., Constable Hook, N. J....	Illus. No. 31, 126
" Mills, Lawrence, Mass	Brick Chimney 94
Passaic, N. J., Dundee Chemical Works	" " 118
" (") Print Works	" " 118
Paterson, N. J., Barbour Flax Spinning Co.	" "
	Illus. No. 29, opposite 116
" "	Brick Chimneys ... 107
" " Edison.....	Brick Chimneys.89, 90, 119, 120
" " " " " " " " " " " "	Brick Chimney
	Illus. Nos. 18 & 19...89, 90
Path of least resistance, indifference of lightning.....	146
Pennsylvania Railroad Co., Jersey City, N. J.	Steel Chimney..... 69
Performances, chimney	121
Perth Amboy, N. J., Guggenheim Smelting Co.	Ill. No. 7, opposite 64
Philadelphia (Pa.) Engineering Works practice.	47
" " pumping station.....	Brick Chimney.... 85
	Illus. No. 14, opposite 85
" " style self-sustaining steel chimneys.	Illus. No. 8, 65
" " Queen Lane Pump Station.	Brick Chimney...85, 120
	Illus. No. 13, opposite 85
Physical properties of materials of masonry.....	153
Piers	34
Piers, tests at Watertown Arsenal	35
Piling	31
Port Dundee, Glasgow, Scotland	Brick Chimney 119
Potomac Light & Power Co., Washington, D.C.	Steel Chimney..... 69
Pounds of coal burned per hour—chimney table	24, 26
Prevention of smoke.....	150

	PAGE
Sparrow's Point, Md., Maryland Steel Co.'s. Steel Chimney.	66, 67, 70
Stability of a chimney.....	51
" " brick chimneys.....	76
" " steel chimneys.....	53
Steel chimneys, anchorage.....	54
" " base-plates.....	44
" " brick lining.....	44
" " description of a number of.....	69, 74
" " Edison Lighting Station.....	73
Steel wire rope, properties of.....	41
Steinway Electric Co., Astoria, L. I.	108
Illus. No. 26, opposite	108
Stockholm, N. J., Iron Furnaces.	Illus. No. 32, opposite 127
Stone and brick work, sizes and safe loads.....	35
Straightening a chimney.....	129, 130
" " 	Illus. No. 35, opposite 131
" " " 	No. 36, opposite 132
Straight Line Engine Works, Syracuse, N. Y. Steel Chimney.....	72
Syracuse, N. Y., Straight Line Engine Works. Steel Chimney.....	72
Tearing down or razing a chimney.....	130
Tennant & Co., Glasgow, Scotland.....	Brick Chimney 119
Three brick chimneys.....	Illus. No. 2, opposite 31
" " " 	Illus. No. 17, opposite 89
Toledo (Ohio) Traction Co.....	Steel Chimney 72
Top design.....	129
Townsend, Glasgow, Scotland.....	Brick " 119
Tremont & Suffolk Mills, Lowell, Mass.....	Brick Chimney 119
Troy, N. Y., Burden Iron Co.....	Steel " 69
Tubes, friction in.....	50
Tweedvale Manufacturing Co.....	Brick Chimney 120
Illus. No. 16,	88
Union Depot Ry. Co., St. Louis. Mo.	103
Illus. No. 22, opposite	103
United Glass Co., Chicago, Ill.....	Steel Chimney 71
" Tramways Co., Dublin, Ireland.....	" " 73
Unnecessary alarm regarding lightning.....	148
Upward motion of stroke of lightning.....	146
Varying flue lengths, draft-power.....	134
Velocity of gases.....	29
Volume, density and pressure of air at various temperatures.....	13

	PAGE
Washington Mills, Lawrence, Mass	Brick Chimney 119
“ (D. C.) Monument, aluminum tip	148
“ “ Potomac Light and Power Company,	
Steel Chimney	69
Waterford, N. Y., Ormsby Textile Co.	Illus. Nos. 33 and 34, 130
Water-heating surface in boilers, chimney table	25
Water-tank supported upon a brick chimney	Illus. No. 30 . . . 127, 128
Weather, brick chimneys, speed of building, etc.	81
Weights of circular boiler heads	42
West Cumberland Hematite Iron Works	Brick Chimney 119
Westinghouse Electric Co., Wilmerding, Pa. Steel Chimney	69
Wilmerding, Pa., Westinghouse Air Brake Co.	Illus. No. 5 61
“ “ “ Electric Co. Steel Chimney	69
Wind pressure	29
“ “ St. Louis tornado.	30
Wrought iron chimney, novel one at Creusot, France	60

*Catalogue of the Scientific Publications
of D. Van Nostrand Company, 23 Murray
Street and 27 Warren Street, New York.*

- ADAMS, J. W.** Sewers and Drains for Populous Districts. Embracing Rules and Formulas for the dimensions and construction of works of Sanitary Engineers. Fifth edition. 8vo, cloth.....\$2.50
- ABBOTT, A. V.** The Electrical Transmission of Energy. A Manual for the Design of Electrical Circuits. Fully illustrated. 8vo, cloth.....\$4 50
- ALEXANDER, J. H.** Universal Dictionary of Weights and Measures, Ancient and Modern, reduced to the Standards of the United States of America. New edition, enlarged. 8vo, cloth, \$3.50
- **S. A. Broke Down: What Should I Do?** A Ready Reference and Key to Locomotive Engineers and Firemen, Round House Machinists, Conductors, Train Hands and Inspectors. With 5 folding plates. 12mo, cloth.....\$1.50
- ALLEN, C. F.** Tables for Earthwork Computation. 8vo, cloth.....\$1.50
- ANDERSON, J. W.** The Prospector's Handbook; A Guide for the Prospector and Traveller in search of Metal-bearing or other Valuable Minerals. Sixth edition, thoroughly revised and much enlarged. 8vo, cloth.....\$1.50
- ANDERSON, WILLIAM.** On the Conversion of Heat into Work. A Practical Handbook on Heat-Engines. Third edition. Illustrated. 12mo, cloth.....\$2.25
- ARNOLD, Dr.** Ammonia and Ammonium Compounds. A Practical Manual for Manufacturers, Chemists, Gas Engineers and Dyesetters. 12mo, cloth.....\$2.00
- ARNOLD, E.** Armature Windings of Direct Current Dynamos. Extension and Application of a General Winding Rule. Translated from the original German by Francis B. DeGress, M. E. With numerous illustrations.....(In press.)
- ATKINSON, PHILIP.** The Elements of Electric Lighting, including Electric Generation, Measurement, Storage, and Distribution. Eighth edition. Illustrated. 12mo, cloth.....\$1.50
- **The Elements of Dynamic Electricity and Magnetism.** Second edition. 120 illustrations. 12mo, cloth.....\$2.00

- ATKINSON, PHILIP.** *The Electric Transformation of Power and its Application by the Electric Motor, including Electric Railway Construction.* Illustrated. 12mo, cloth.....\$2.00
- **Elements of Static Electricity,** with full description of the Holtz and Topler Machines, and their mode of operating. Illustrated. 12mo, cloth.....\$1.50
- AUCHINCLOSS, W. S.** *Link and Valve Motions Simplified.* Illustrated with 29 woodcuts and 20 lithographic plates, together with a Travel Scale, and numerous useful tables. Thirteenth edition. Revised. 8vo, cloth.....\$2.00
- AXON, W. E. A.** *The Mechanic's Friend.* A Collection of Receipts and Practical Suggestions relating to Aquaria, Bronzing, Cements, Drawing, Dyes, Electricity, Gilding, Glass-working, Glues, Horology, Lacquers, Locomotives, Magnetism, Metal-working, Modelling, Photography, Pyrotechny, Railways, Solders, Steam-Engine, Telegraphy, Taxidermy, Varnishes, Waterproofing, and Miscellaneous Tools, Instruments, Machines, and Processes connected with the Chemical and Mechanic Arts. With numerous diagrams and woodcuts. Fancy cloth.....\$1.50
- BACON, F. W.** *A Treatise on the Richards Steam-Engine Indicator,* with directions for its use. By Charles T. Porter. Revised, with notes and large additions as developed by American practice; with an appendix containing useful formulæ and rules for engineers. Illustrated. Fourth edition. 12mo, cloth.....\$1.00
- BADT, F. B.** *Dynamo Tenders Hand-Book.* With 140 illustrations. Second edition. 18mo, cloth.....\$1.00
- **Bell Hangers' Hand-Book.** With 97 illustrations. 18mo, cloth.....\$1.00
- **Incandescent Wiring Hand-Book.** With 35 illustrations and five tables. 18mo, cloth.....\$1.00
- **Electric Transmission Hand-Book.** With 22 illustrations and 27 Tables. 18mo, cloth.....\$1.00
- BALCH, COL. GEO. T.** *Methods of Teaching Patriotism in the Public Schools.* 8vo, cloth.....\$1.00
- BALE, M. P.** *Pumps and Pumping.* A Hand Book for Pump Users. 12mo, cloth.....\$1.00
- BARBA, J.** *The Use of Steel for Constructive Purposes.* Method of Working, Applying, and Testing Plates and Bars. With a Preface by A. L. Holley, C.E. 12mo, cloth.....\$1.50
- BARNARD, F. A. P.** *Report on Machinery and Processes of the Industrial Arts and Apparatus of the Exact Sciences at the Paris Universal Exposition, 1867.* 152 illustrations and 8 folding plates. 8vo, cloth.....\$5.00
- BEAUMONT, ROBERT.** *Color in Woven Design.* With 32 colored Plates and numerous original illustrations. Large, 12mo.....\$7.50

- BECKWITH, ARTHUR.** Pottery. Observations on the Materials and Manufacture of Terra-Cotta, Stoneware, Fire-Brick, Porcelain, Earthenware, Brick, Majolica, and Encaustic Tiles. 8vo, paper. 2d edition..... .60
- BERNTHSEN, A.** A Text-Book of Organic Chemistry. Translated by George M'Gowan, Ph.D. Second English edition. Revised and extended by author and translator. Illustrated. 12mo, cloth..... \$2.50
- BIGGS, C. H. W.** First Principles of Electrical Engineering. Being an attempt to provide an Elementary Book for those intending to enter the profession of Electrical Engineering. Second edition. 12mo., cloth. Illustrated.....\$1.00
- BLAKE, W. P.** Report upon the Precious Metals. Being Statistical Notices of the principal Gold and Silver producing regions of the world, represented at the Paris Universal Exposition. 8vo, cloth.....\$2.00
- Ceramic Art. A Report on Pottery, Porcelain, Tiles, Terra-Cotta, and Brick. 8vo, cloth.....\$2.00
- BLAKESLEY, T. H.** Alternating Currents of Electricity. For the use of Students and Engineers. Third edition, enlarged. 12mo, cloth.....\$1.50
- BLYTH, A. WYNTER, M.R.C.S., F.C.S.** Foods: their Composition and Analysis. A Manual for the use of Analytical Chemists, with an Introductory Essay on the History of Adulterations, with numerous tables and illustrations. Fourth edition. Crown 8vo, cloth. \$7.50
- Poisons: their Effects and Detection. A Manual for the use of Analytical Chemists and Experts, with an Introductory Essay on the growth of Modern Toxicology. Third edition. Revised and enlarged. Crown 8vo, cloth.....\$7.50
- BODMER, G. R.** Hydraulic Motors; Turbines and Pressure Engines, for the use of Engineers, Manufacturers, and Students. Second edition, revised and enlarged. With 204 illustrations. 12mo, cloth.....\$5.00
- BOILEAU, J. T.** A New and Complete Set of Traverse Tables, Showing the Difference of Latitude and Departure of every minute of the Quadrant and to five places of decimals. 8vo, cloth. \$5.00
- BOTTONE, S. R.** Electrical Instrument Making for Amateurs. A Practical Handbook. With 48 illustrations. Revised Fifth Edition. 12mo, cloth..... .50
- Electric Bells, and all about them. A Practical Book for Practical Men. With more than 100 illustrations. 12mo, cloth. Fourth Edition. Revised and Enlarged..... .50
- The Dynamo: How Made and How Used. A Book for Amateurs. Eighth edition. 12mo, cloth.....\$1.00
- Electro Motors: How Made and How Used. A Hand Book for Amateurs and Practical Men. Second edition. 12mo, cloth..... .50

- BONNEY, G. E. The Electro-Platers' Hand Book.**
A Manual for Amateurs and Young Students on Electro-Metallurgy.
60 Illustrations. 12mo, cloth.....\$1.20
- BOW, R. H. A Treatise on Bracing.** With its application to Bridges and other Structures of Wood or Iron. 156 illustrations. 8vo, cloth.....\$1.50
- BOWSER, Prof. E. A. An Elementary Treatise on Analytic Geometry.** Embracing Plane Geometry, and an Introduction to Geometry of three Dimensions. 12mo, cloth. Nineteenth edition.....\$1.75
- **An Elementary Treatise on the Differential and Integral Calculus.** With numerous examples. 12mo, cloth. Fifteenth edition.....\$2.25
- **An Elementary Treatise on Analytic Mechanics.** With numerous examples. 12mo, cloth. Ninth edition.....\$3.00
- **An Elementary Treatise on Hydro-Mechanics.** With numerous examples. 12mo, cloth. Fourth edition.....\$2.50
- **Academic Algebra** Second edition, 12mo, cloth...\$1.25
- **College Algebra.** Fourth edition. 12mo, cloth.....\$1.75
- **Elements of Plane and Solid Geometry.** 12mo, cloth. Second edition.....\$1.40
- BOWIE, AUG. J., Jun., M. E. A Practical Treatise on Hydraulic Mining in California.** With Description of the Use and Construction of Ditches, Flumes, Wrought-iron Pipes and Dams; Flow of Water on Heavy Grades, and its Applicability, under High Pressure, to Mining. Fifth edition. Small quarto, cloth. Illustrated.....\$5.00
- BURGH, N. P. Modern Marine Engineering, applied to Paddle and Screw Propulsion.** Consisting of 36 colored plates, 259 practical woodcut illustrations, and 403 pages of descriptive matter. The whole being an exposition of the present practice of James Watt & Co., J. & G. Rennie, R. Napier & Sons, and other celebrated firms. Thick 4to vol., half morocco.....\$10.00
- BURT, W. A. Key to the Solar Compass, and Surveyor's Companion.** Comprising all the rules necessary for use in the field; also description of the Linear Surveys and Public Land System of the United States, Notes on the Barometer, Suggestions for an Outfit for a Survey of Four Months, etc. Fifth edition. Pocket-book form, tuck.....\$2.50
- CALDWELL, Prof. GEO. C., and BRENNEMAN, Prof. A. A. Manual of Introductory Chemical Practice.** For the use of Students in Colleges and Normal and High Schools. Fourth edition, revised and corrected. 8vo, cloth. Illustrated.....\$1.50

- CAMPIN, FRANCIS.** On the Construction of Iron Roofs. A Theoretical and Practical Treatise, with wood-cuts and Plates of Roofs recently executed. 8vo, cloth.....\$2.00
- CARTER, E. T.** Motive Power and Gearing for Electrical Machinery. A Treatise on the Theory and Practice of the Mechanical Equipment of Power Stations for Electric supply and for Electric Traction. 8vo., cloth, Illustrated.....\$5.00
- CARY, A. A.** Boiler Waters and their Purification(In Press)
- CHAUVENET, Prof. W.** New Method of Correcting Lunar Distances, and Improved Method of Finding the Error and Rate of a Chronometer, by Equal Altitudes. 8vo, cloth.....\$2 00
- CHURCH, JOHN A.** Notes of a Metallurgical Journey in Europe. 8vo, cloth.....\$2.00
- CLARK, D. KINNEAR, C.E.** A Manual of Rules, Tables and Data for Mechanical Engineers. Based on the most recent investigations. Illustrated with numerous diagrams. 1,012 pages. 8vo, cloth, Sixth edition.....\$5.00
Half morocco\$7.50
- **Fuel; its Combustion and Economy, consisting of** abridgements of Treatise on the Combustion of Coal. By C. W. Williams; and the Economy of Fuel, by T. S. Prideaux. With extensive additions in recent practice in the Combustion and Economy of Fuel, Coal, Coke, Wood. Peat, Petroleum, etc. Fourth edition. 12mo, cloth.....\$1.50
- **The Mechanical Engineer's Pocket Book of** Tables, Formulæ, Rules and Data. A Handy Book of Reference for Daily Use in Engineering Practice 16mo., morocco. Second edition.....\$3.00
- **Tramways, their Construction and Working, embracing** a comprehensive history of the system, with accounts of the various modes of traction, a description of the varieties of rolling stock, and ample details of Cost and Working Expenses. *Second edition.* Re-written and greatly enlarged, with upwards of 400 illustrations. Thick 8vo, cloth.....\$9 00
- **The Steam Engine. A Treatise on Steam Engines and Boilers; comprising** the Principles and Practice of the Combustion of Fuel, the Economical Generation of Steam, the Construction of Steam Boilers, and the Principles, Construction and Performance of Steam Engines, Stationary, Portable, Locomotive and Marine, exemplified in Engines and Boilers of recent date. Illustrated by above 1,300 figures in the text, and a series of folding plates drawn to scale. 2 vols. 8vo, cl.....\$15.00
- CLARK, JACOB M.** A new System of Laying Out Railway Turn-outs instantly, by inspection from tables. 12mo, leatherette\$1.00

- CLAUSEN-THUE, W.** The A B C Universal Commercial Electric Telegraphic Code; specially adapted for the use of Financiers, Merchants, Ship-owners, Brokers, Agent, etc. Fourth edition. 8vo, cl.\$7.50
- CLAUSEN-THUE, W.** The A1 Universal Commercial Electric Telegraphic Code. Over 1240 pp. and nearly 90,000 variations. 8vo, cl.\$12.50
- CLEEMANN, THOS. M.** The Railroad Engineer's Practice. Being a Short but Complete Description of the Duties of the Young Engineer in the Preliminary and Location Surveys and in Construction. 4th ed., revised and enlarged. Illus. 12mo, cloth \$1.50
- CLERK, DUGALD.** Autocars or Horseless Vehicles. About 300 pp., 60 illustrations. (In Press.)
- CLEVENGER, S. R.** A Treatise on the Method of Government Surveying as prescribed by the U. S. Congress and Commissioner of the General Land Office, with complete Mathematical, Astronomical and Practical Instructions for the use of the United States Surveyors in the field. 16mo, morocco\$2.50
- COLBURN, ZERAH.** The Gas-Works of London. 12mo, boards.60
- COLLINS, JAS. E.** The private Book of Useful Alloys and Memoranda for Goldsmiths, Jewelers, etc. 18mo, cloth.... .50
- CORNWALL, prof. H. B.** Manual of Blow-pipe Analysis, Qualitative and Quantitative. With a Complete System of Descriptive Mineralogy. 8vo, cloth, with many illustrations....\$2.50
- CRAIG, B. F.** Weights and Measures. An account of the Decimal System, with Tables of Conversion for Commercial and Scientific Uses. Square 32mo, limp cloth.50
- CROCKER, F. B.** Electric Lighting. A Practical Exposition of the Art, for use of Engineers, Students, and others interested in the Installation or Operation of Electrical Plants. Second edition, revised. 8vo, cloth. Vol. 1. The Generating Plant.\$3.00
— Vol. 2. (In Press.)
- CROCKER, F. B., and S. S. WHEELER.** The Practical Management of Dynamos and Motors. Fourth edition, (seventh thousand) revised and enlarged, with a special chapter by H. A. Foster. 12mo, cloth, illustrated.\$1 00
- CUMMING, LINNÆUS, M.A.** Electricity treated Experimentally. For the use of Schools and Students. New edition. 12mo, cloth.\$1.50
- DAVIES, E. H.** Machinery for Metalliferous Mines. A Practical Treatise for Mining Engineers, Metallurgists and Manufacturers. With upwards of 300 illustrations. 8vo, cloth.\$5.00
- DAVIS, JOHN W., C.E.** Formulæ for the Calculation of Rail Road Excavation and Embankment, and for finding Average Haul. Second edition. Octavo, half roan.\$1.50

- DAVIS, J. WOODBRIDGE.** *Theoretical Astronomy.*
Dynamics of the Sun. 4to, paper.....\$3.00
- DERR, W. L.** *Block Signaling. A Practical Manual.*
Oblong, cloth.....(In Press)
- DIXON, D. B.** *The Machinist's and Steam Engineer's*
Practical Calculator. A Compilation of Useful Rules and Problems
arithmetically solved, together with General Information applicable
to Shop-Tools, Mill-Gearing, Pulleys and Shafts, Steam-Boilers and
Engines. Embracing valuable Tables and Instruction in Screwcutting,
Valve and Link Motion, etc. 16mo, full morocco, pocket form. \$2.00
- DODD, GEO.** *Dictionary of Manufactures, Mining,*
Machinery, and the Industrial Arts. 12mo, cloth.....\$1.50
- DORR, B. F.** *The Surveyor's Guide and Pocket Table*
Book. 18mo, morocco flaps. Third Edition.....\$2.00
- DRAPER, C. H.** *Heat and the Principles of Thermo-*
Dynamics. With many illustrations and numerical examples. 12mo,
cloth.....\$1.50
- DUBOIS, A. J.** *The New Method of Graphic Statics.*
With 60 illustrations. 8vo, cloth.....\$1.50
- EDDY, Prof. H. T.** *Researches in Graphical Statics.*
Embracing New Constructions in Graphical Statics, a New General
Method in Graphical Statics, and the Theory of Internal Stress in
Graphical Statics. 8vo, cloth.....\$1.50
- *Maximum Stresses under Concentrated Loads.*
Treated graphically. Illustrated. 8vo, cloth.....\$1.50
- EISSLER, M.** *The Metallurgy of Gold; a Practical*
Treatise on the Metallurgical Treatment of Gold-Bearing Ores, in-
cluding the Processes of Concentration and Chlorination, and the
Assaying, Melting and Refining of Gold. Fourth edition, revised and
greatly enlarged. 187 illustrations. 12mo, cl.....\$5.00
- EISSLER, M.** *The Metallurgy of Silver; a Practical*
treatise on the Amalgamation, Roasting and Lixivation of Silver Ores,
including the Assaying, Melting and Refining of Silver Bullion. 124
illustrations. Second edition, enlarged. 12mo, cloth.....\$4.00
- EISSLER, M.** *The Metallurgy of Argentiferous Lead;*
a Practical Treatise on the Smelting of Silver-Lead Ores and the Refin-
ing of Lead Bullion. Including Reports on Various Smelting
Establishments and Descriptions of Modern Smelting Furnaces and
Plants in Europe and America. With 183 illustrations. 8vo, cl.....\$5.00
- ELIOT, Prof. C. W., and STORER, Prof. F. H. A**
Compendious Manual of Qualitative Chemical Analysis. Revised
with the co-operation of the authors, by Prof. William R. Nichols.
Illustrated. Seventeenth edition, newly revised by Prof. W. B. Lind-
say. 12mo, cloth.....\$1.50
- ELLIOT, Maj. GEO. H., U. S. E.** *European Light-*
House Systems. Being a Report of a Tour of Inspection made in
1873. 51 engravings and 21 woodcuts. 8vo, cloth.....\$5.00

- ELLISON, LEWIS M.** *Practical Application of the Indicator.* With reference to the Adjustment of Valve Gear on all styles of Engines. Second edition, revised. 8vo, cloth, 100 illustrations.\$2.00
- ENDLICH, F. M.** *Manual of Qualitative Blow-Pipe Analysis and Determinative Mineralogy.* Illustrations and Colored Plate of Spectra. 8vo, cloth.\$4.00
- EVERETT, J. D.** *Elementary Text-Book of Physics.* Illustrated. Seventh edition. 12mo, cloth.\$1.40
- EWING, Prof. A. J.** *The Magnetic Induction in Iron and other metals.* 159 illustrations. 8vo, cloth.\$4.00
- FANNING, J. T.** *A Practical Treatise on Hydraulic and Water-Supply Engineering.* Relating to the Hydrology, Hydrodynamics, and Practical Construction of Water-Works in North America. 180 illustrations. 8vo, cloth. Thirteenth edition, revised, enlarged, and new tables and illustrations added. 650 pages.\$5.00
- FISH, J. C. L.** *Lettering of Working Drawings.* Thirteen plates, with descriptive text. Oblong, 9x12½, boards.\$1.00
- FISKE, Lieut. BRADLEY A., U.S.N.** *Electricity in Theory and Practice; or, The Elements of Electrical Engineering.* Eighth edition. 8vo, cloth.\$2.50
- FLEMING, Prof. J. A.** *The Alternate Current Transformer in Theory and Practice.* Vol. I—The Induction of Electric Currents; 611 pages. New edition. Illustrated. 8vo, cloth.\$5.00
— Vol. 2. *The Utilization of Induced Currents.* Illustrated. 8vo, cloth.\$5.00
- FLEMING, Prof. J. A.** *Electric Lamps and Electric Lighting.* Being a course of four lectures delivered at the Royal Institution, April-May, 1894. 8vo, cloth, fully illustrated.\$3.00
- FLEMING, Prof. J. A.** *Electrical Laboratory Notes and Forms, elementary and advanced.* 4to, cloth, illustrated.\$5.00
- FOLEY, (NELSON) and THOS. PRAY, Jr.** *The Mechanical Engineers' Reference Book for Machine and Boiler Construction, in two parts.* Part 1—General Engineering Data. Part 2—Boiler Construction. With fifty-one plates and numerous illustrations, specially drawn for this work. Folio, half mor.\$25.00
- FORNEY, MATTHIAS N.** *Catechism of the Locomotive.* Second edition, revised and enlarged. Forty-sixth thousand. 8vo, cloth.\$3.50
- FOSTER, Gen. J. G., U.S.A.** *Submarine Blasting in Boston Harbor, Massachusetts.* Removal of Tower and Corwin Rocks. Illustrated with 7 plates. 4to, cloth.\$3.50
- FOSTER, H. A.** *Electrical Engineers' Pocket Book.* 850 pages.In press

FRANCIS, Jas. B., C.E. Lowell Hydraulic Experiments. Being a selection from experiments on Hydraulic Motors, on the Flow of Water over Weirs, in open Canals of uniform rectangular section, and through submerged Orifices and diverging Tubes. Made at Lowell, Mass. Fourth edition, revised and enlarged, with many new experiments, and illustrated with 23 copper-plate engravings. 4to, cloth.....\$15.00

GEIPEL, WM. and KILGOUR, M. H. A Pocketbook of Electrical Engineering Formulæ. Illustrated. 18mo, mor..\$3.00
Large paper edition, wide margins. 8vo, morocco, gilt edges \$5.00

GERBER, NICHOLAS. Chemical and Physical Analysis of Milk, Condensed Milk and Infant's Milk-Food. 8vo, cloth.....\$1.25

GILLMORE, Gen. Q. A. Treatise on Limes, Hydraulic Cements, and Mortars. Papers on Practical Engineering, United States Engineer Department, No. 9, containing Reports of numerous Experiments conducted in New York City during the years 1858 to 1861, inclusive. With numerous illustrations. 8vo, cloth.....\$4.00

— **Practical Treatise on the Construction of Roads, Streets, and Pavements.** With 70 illustrations. 12mo, cloth, \$2.00

GILLMORE, Gen. Q. A. Report on Strength of the Building Stones in the United States, etc. 8vo, illustrated, cloth.\$1.00

GOODEVE, T. M. A Text-Book on the Steam-Engine. With a Supplement on Gas-Engines. Twelfth edition. Enlarged. 143 illustrations. 12mo, cloth.....\$2.00

GORDON, J. E. H. School Electricity. Illustrations. 12mo, cloth.....\$2.00

GORE, G., F. R. S. The Art of Electrolytic Separation of Metals, etc. (Theoretical and Practical.) Illustrated. 8vo, cloth.....\$3.50

— **Electro Chemistry Inorganic.** 3d edition. 8vo, cloth.\$ 80

GRIFFITHS, A. B., Ph.D. A Treatise on Manures, or the Philosophy of Manuring. A Practical Hand-Book for the Agriculturist, Manufacturer, and Student. 12mo, cloth.....\$3.00

GURDEN, RICHARD LLOYD. Traverse Tables: computed to 4 places Decimals for every ° of angle up to 100 of Distance. For the use of Surveyors and Engineers. New edition. Folio, half mo.....\$7.50

GUY, ARTHUR F. Electric Light and Power, giving the Result of Practical Experience in Central-Station Work. 8vo, cloth. Illustrated\$2 50

- HAEDER, HERMAN, C. E.** **A Handbook on the Steam Engine.** With especial reference to small and medium sized engines. English edition, re-edited by the author from the second German edition, and translated with considerable additions and alterations by H. H. P. Powles. 12mo, cloth. Nearly 1100 illus. ..\$3.00
- HALSEY, F. A.** **Slide Valve Gears, an Explanation of the action and Construction of Plain and Cut-off Slide Valves.** Illustrated. 12mo, cloth. Third edition\$1.50
- HAMILTON, W. G.** **Useful Information for Railway Men.** Tenth edition, revised and enlarged. 562 pages, pocket form. Morocco, gilt.....\$2.00
- HANCOCK, HERBERT.** **Text-Book of Mechanics and Hydrostatics,** with over 500 diagrams. 8vo, cloth\$1 75
- HARRISON, W. B.** **The Mechanics' Tool Book.** With Practical Rules and Suggestions for use of Machinists, Iron-Workers, and others. Illustrated with 44 engravings. 12mo, cloth.....\$1.50
- HASKINS, C. H.** **The Galvanometer and its Uses.** A Manual for Electricians and Students. Fourth edition. 12mo, cloth.....\$1.50
- HAWKINS, C. C., and WALLIS, F.** **The Dynamo; its Theory, Design and Manufacture.** 190 illustrations, 12mo, cloth,\$3.00
- HEAP, Major D. P., U. S. A.** **Electrical Appliances of the Present Day.** Report of the Paris Electrical Exposition of 1881. 250 illustrations. 8vo, cloth.....\$2.00
- HEAVSIDE, OLIVER:** **Electromagnetic Theory.** Vol. 1. 8vo, cloth.....\$5.00
- HENRICI, OLAUS.** **Skeleton Structures, Applied to the Building of Steel and Iron Bridges.** Illustrated.....\$1.50
- HERRMANN, Gustav.** **The Graphical Statics of Mechanism.** A Guide for the Use of Machinists, Architects, and Engineers; and also a Text-book for Technical Schools. Translated and annotated by A. P. Smith, M. E. 12mo, cloth, 7 folding plates. Second edition.....\$2.00
- HEWSON, WM.** **Principles and Practice of embanking Lands from River Floods, as applied to the Levees of the Mississippi.** 8vo, cloth.....\$2.00
- HOBBS, W. R. P.** **The Arithmetic of Electrical Measurements,** with numerous examples. Fully Worked. 12mo, cloth, .50
- HOFFMAN, H. D.** **The Metallurgy of Lead and the Desilverization of Base Bullion.** 275 Illustrations. 8vo, cloth,\$6.00

- HOLLEY, ALEXANDER L. Railway Practice.** American and European Railway practice in the Economical Generation of Steam, including the Materials and Construction of Coal-burning Boilers, Combustion, the Variable Blast, Vaporization, Circulation, Superheating, Supplying and Heating Feed Water, etc., and the Adaptation of Wood and Coke-burning Engines to Coal-burning; and in Permanent Way, including Road-bed, Sleepers, Rails, Joint Fastenings, Street Railways, etc., With 77 lithographed plates. Folio, cloth.....\$12.00
- HOLMES, A. BROMLEY. The Electric Light Popularly Explained.** Fifth edition. Illustrated. 12mo, paper.... .40
- HOSPITALIER, E. Polyphased Alternating Currents.** Illustrated. 8vo, cloth.....\$1.40
- HOWARD, C. R. Earthwork Mensuration on the Basis of the Prismoidal Formulæ.** Containing Simple and Labor-saving Method of obtaining Prismoidal Contents directly from End Areas. Illustrated by Examples and accompanied by Plain Rules for Practical Uses. Illustrated. 8vo, cloth.....\$1.50
- HOWE, HENRY M. The Metallurgy of Steel. Vol. I.** Third edition, revised and enlarged. 4to, cloth.....\$10.00
- HUMBER, WILLIAM, C. E. A Handy Book for the Calculation of Strains in Girders, and Similar Structures, and their Strength; Consisting of Formulæ and Corresponding Diagrams, with numerous details for practical application, etc.** Fourth edition. 12mo, cloth.....\$2.50
- HUTTON, W. S. Steam Boiler Construction. A Practical Hand Book for Engineers, Boiler Makers and Steam Users.** With upwards of 300 illustrations. Second edition. 8vo, cloth, \$7.00
- HUTTON, W. S. Practical Engineer's Hand-Book,** comprising a treatise on Modern Engines and Boilers, Marine, Locomotive and Stationary. Fourth edition. Carefully revised, with additions. With upwards of 570 illustrations. 8vo, cloth,\$7 00
- **The Works' Manager's Hand-Book of Modern Rules, Tables, and Data for Civil and Mechanical Engineers, Millwrights and Boiler-makers, etc., etc.** With upwards of 150 illustrations. Fifth edition. Carefully revised, with additions. 8vo, cloth,\$6 00
- ISHERWOOD, B. F. Engineering Precedents for Steam Machinery.** Arranged in the most practical and useful manner for Engineers. With illustrations. 2 vols. in 1. 8vo, cloth.....\$2.50
- JAMIESON, ANDREW, C.E. A Text-Book on Steam and Steam-Engines.** Specially arranged for the use of Science and Art, City and Guilds of London Institute, and other Engineering Students. Tenth edition. Illustrated. 12mo, cloth.....\$3.00

- JAMIESON, ANDREW, C. E.** **Elementary Manual** on Steam and the Steam Engine. Specially arranged for the use of First-Year Science and Art, City and Guilds of London Institute, and other Elementary Engineering Students. Third edition. 12mo, cloth\$1.40
- JANNETTAZ, EDWARD.** **A Guide to the Determination of Rocks:** being an Introduction to Lithology. Translated from the French by G. W. Plympton, Professor of Physical Science at Brooklyn Polytechnic Institute. 12mo, cloth.....\$1.50
- JOHNSTON, Prof. J. F. W., and CAMERON, Sir Chas.** **Elements of Agricultural Chemistry and Geology.** Seventeenth edition. 12mo, cloth.....\$2.60
- JOYNSON, F. H.** **The Metals used in Construction.** Iron, Steel, Bessemer Metal, etc. Illustrated. 12mo, cloth.... .75
- **Designing and Construction of Machine Gearing.** Illustrated. 8vo, cloth\$2.00
- KANSAS CITY BRIDGE, THE** With an Account of the Regimen of the Missouri River and a Description of the Methods used for Founding in that River. By O. Chanute, Chief Engineer, and George Morrison, Assistant Engineer. Illustrated with 5 lithographic views and 12 plates of plans. 4to, cloth.....\$6.00
- KAPP, GIBBERT, C.E.** **Electric Transmission of Energy** and its Transformation, Subdivision, and Distribution. A Practical hand-book. Fourth edition. Revised. 12mo, cloth.....\$3.50
- **Dynamos, Alternators and Transformers.** 138 Illustrations. 12mo, cloth.....\$4.00
- KEMPE, H. R.** **The Electrical Engineer's Pocket Book** of Modern Rules, Formulæ, Tables and Data. Illustrated. 32mo. Mor. gilt.....\$1.75
- KENNELLY, A. E.** **Theoretical Elements of Electro-Dynamic Machinery.** 8vo, cloth\$1.50
- KILGOUR, M. H., SWAN, H., and BIGGS, C. H. W.** **Electrical Distribution, its Theory and Practice.** 174 Illustrations. 12mo, cloth\$4.00
- KING, W. H.** **Lessons and Practical Notes on Steam.** The Steam-Engine, Propellers, etc., for Young Marine Engineers, Students, and others. Revised by Chief Engineer J. W. King, United States Navy. Nineteenth edition, enlarged. 8vo, cloth.....\$2.00
- KINGDON, J. A.** **Applied Magnetism.** An introduction to the Design of Electromagnetic Apparatus. 8vo, cloth...\$3.00
- KIRKALDY, Wm. G.** **Illustrations of David Kirkaldy's System of Mechanical Testing,** as Originated and Carried On by him during a Quarter of a Century. Comprising a Large Selection of Tabulated Results, showing the Strength and other Properties of Materials used in Construction, with Explanatory Text and Historical Sketch. Numerous engravings and 25 lithographed plates. 4to, cloth.....\$20.00

- KIRKWOOD, JAS. P.** Report on the Filtration of River Waters for the supply of Cities, as practised in Europe, made to the Board of Water Commissioners of the city of St. Louis. Illustrated by 30 double-plate engravings. 4to, cloth.\$7.50
- KUNZ, GEO. F.** Gems and Precious Stones of North America. A Popular Description of Their Occurrence, Value, History, Archæology, and of the Collections in which They Exist; also a Chapter on Pearls and on Remarkable Foreign Gems owned in the United States. Illustrated with eight Colored Plates and numerous minor Engravings. Second edition, with appendix. 4to, cloth.\$10.00
- LARRABEE, C. S.** Cipher and Secret Letter and Telegraphic Code, with Hog's Improvements. The most perfect Secret Code ever invented or discovered. Impossible to read without the key. 18mo, cloth.60
- LAZELLE, H. M.** One Law in Nature. A New Corpuscular Theory comprehending Unity of Force, Identity of Matter, and its Multiple Atom Constitution, etc. 12mo, cloth. .\$.150
- LEITZE, ERNST.** Modern Heliographic Processes. A Manual of Instruction in the Art of Reproducing Drawings, Engravings, etc., by the action of Light. With 32 woodcuts and ten specimens of Heliograms. 8vo, cloth. Second edition.\$3.00
- LOCKE, ALFRED G. and CHARLES G.** A Practical Treatise on the Manufacture of Sulphuric Acid. With 77 Constructive Plates drawn to Scale Measurements, and other Illustrations. Royal 8vo, cloth.\$15.00
- LOCKWOOD, THOS. D.** Electricity, Magnetism, and Electro-Telegraphy. A Practical Guide for Students, Operators, and Inspectors. 8vo, cloth. Third edition.\$2.50
- LOCKWOOD, THOS. D.** Electrical Measurement and the Galvometer; its Construction and Uses. Second edition. 32 illustrations. 12mo, cloth.\$1.50
- LODGE, OLIVER J.** Elementary Mechanics, including Hydrostatics and Pneumatics. Revised edition. 12mo, cloth, \$1.50
- LORING, A. E.** A Hand-Book of the Electro-Magnetic Telegraph. Paper boards.50
Cloth.75
Morocco.\$1.00
- LUNGE, GEO.** A Theoretical and Practical Treatise on the Manufacture of Sulphuric Acid and Alkali with the Collateral Branches. Vol. I. Sulphuric Acid. Second edition, revised and enlarged. 342 illustrations. 8vo, cloth.\$15.00
Vol. II. 8vo, cloth.\$16.80
Vol. III. 8vo, cloth. New edition, 1896.\$15.00
- and **HUNTER, F.** The Alkali Maker's Pocket Book. Tables and Analytical Methods for Manufacturers of Sulphuric Acid, Nitric Acid, Soda, Potash and Ammonia. Second edition. 12mo, cloth.\$3.00

- MACCORD, Prof. C. W.** **A Practical Treatise on the Slide-Valve by Eccentrics**, examining by methods the action of the Eccentric upon the Slide-Valve, and explaining the practical processes of laying out the movements, adapting the Valve for its various duties in the Steam-Engine. Second edition. Illustrated. 4to, cloth\$2.50
- MAGUIRE, WM. R.** **Domestic Sanitary Drainage and Plumbing Lectures on Practical Sanitation.** 332 illustrations. 8vo\$4.00
- MAVER, WM.** **American Telegraphy: Systems, Apparatus, Operation.** 450 illustrations. 8vo, cloth.....\$3.50
- MAYER, PROF. A. M.** **Lecture Notes on Physics.** 8vo, cloth.....\$ 0.00
- McCULLOCH, Prof. R. S.** **Elementary Treatise on the Mechanical Theory of Heat, and its application to Air and Steam Engines.** 8vo, cloth.....\$3.50
- McNEILL, BEDFORD.** **McNeill's Code.** Arranged to meet the requirements of Mining, Metallurgical and Civil Engineers, Directors of Mining, Smelting and other Companies, Bankers, Stock and Share Brokers, Solicitors, Accountants, Financiers, and General Merchants. Safety and Secrecy. 8vo, cloth\$7.50
- MERRILL, Col. WM. E., U.S.A.** **Iron Truss Bridges for Railroads.** The method of calculating strains in Trusses, with a careful comparison of the most prominent Trusses, in reference to economy in combination, etc. Illustrated. 4to, cloth. 4th ed., \$5.00
- METAL TURNING. By a Foreman Pattern Maker.** Illustrated with 81 engravings. 12mo, cloth.....\$1.50
- MINIFIE, WM.** **Mechanical Drawing. A Textbook of Geometrical Drawing for the use of Mechanics and Schools**, in which the Definitions and Rules of Geometry are familiarly explained; the Practical Problems are arranged from the most simple to the more complex, and in their description technicalities are avoided as much as possible. With illustrations for Drawing Plans, Sections, and Elevations of Railways and Machinery; an Introduction to Isometrical Drawing, and an Essay on Linear Perspective and Shadows. Illustrated with over 200 diagrams engraved on steel. Ninth thousand. With an appendix on the Theory and Application of Colors. 8vo, cloth..\$4.00
- MINIFIE, WM.** **Geometrical Drawing. Abridged from the octavo edition, for the use of schools.** Illustrated with 48 steel plates. Ninth edition. 12mo, cloth.....\$2.00
- MODERN METEOROLOGY. A Series of Six Lectures**, delivered under the auspices of the Meteorological Society in 1870. Illustrated. 12mo, cloth.....\$1.50

MOREING, C. A., and NEAL, THOMAS. **Telegraphic Mining Code** Alphabetically arranged. Second edition. 8vo, cloth.....\$8.40

MORRIS, E. **Easy Rules for the Measurement of Earth-**
works by means of the Prismoidal Formula. 8vo, cloth, illus'd. \$1.50

MOSES, ALFRED J., and PARSONS, C. L. **Elements of Mineralogy, Crystallography and Blowpipe Analysis from a practical standpoint.** 8vo, cloth, 336 illustrations.....\$2.00

MULLIN, JOSEPH P., M.E. **Modern Moulding and Pattern-Making.** A Practical Treatise upon Pattern-Shop and Foundry Work : embracing the Moulding of Pulleys, Spur Gears, Worm Gears, Balance-Wheels, Stationary Engine and Locomotive Cylinders, Globe Valves, Tool Work, Mining Machinery, Screw Propellers, Pattern-Shop Machinery, and the latest improvements in English and American Cupolas ; together with a large collection of original and carefully selected Rules and Tables for every-day use in the Drawing Office, Pattern-Shop and Foundry. 12mo, cloth, illustrated....\$2.50

MUNRO, JOHN, C.E., and JAMIESON, ANDREW, C.E. **A Pocketbook of Electrical Rules and Tables for the use of Electricians and Engineers.** Twelfth edition, revised and enlarged. With numerous diagrams. Pocket size. Leather.....\$2.50

MURPHY, J. G., M.E. **Practical Mining. A Field Manual for Mining Engineers.** With Hints for Investors in Mining Properties. 16mo, morocco tucks.....\$1.50

NAQUET, A. **Legal Chemistry. A Guide to the Detection of Poisons, Falsification of Writings, Adulteration of Alimentary and Pharmaceutical Substances, Analysis of Ashes, and examination of Hair, Coins, Arms, and Stains, as applied to Chemical Jurisprudence, for the use of Chemists, Physicians, Lawyers, Pharmacists and Experts.** Translated, with additions, including a list of books and memoirs on Toxicology, etc., from the French, by J. P. Battershall, Ph.D., with a preface by C. F. Chandler, Ph.D., M.D., LL.D. 12mo, cloth..\$2.00

NASMITH, JOSEPH, **The Student's Cotton Spinning.** Third edition, revised and enlarged. 8vo, cloth, 622 pages, 250 illustrations.....\$2.50

NEWALL, JOHN W. **Plain Practical Directions for Drawing, Sizing and Cutting Bevel-Gears, showing how the Teeth may be cut in a Plain Milling Machine or Gear Cutter so as to give them a correct shape from end to end ; and showing how to get out all particulars for the Workshop without making any Drawings. Including a Full Set of Tables of Reference. Folding Plates.** 8vo, cloth.....\$3.00

- NEWLANDS, JAMES.** *The Carpenters' and Joiners' Assistant*: being a Comprehensive Treatise on the Selection, Preparation and Strength of Materials, and the Mechanical Principles of Framing, with their application in Carpentry, Joinery, and Hand-Railing; also, a Complete Treatise on Sines; and an illustrated Glossary of Terms used in Architecture and Building. Illustrated. Folio, half mor.\$15.00
- NIPHER, FRANCIS E., A.M.** *Theory of Magnetic Measurements*, with an appendix on the Method of Least Squares. 12mo, cloth.....\$1.00
- NOAD, HENRY M.** *The Students' Text Book of Electricity*. A new edition, carefully revised. With an Introduction and additional chapters by W. H. Preece. With 471 illustrations. 12mo, cloth.....\$4.00
- NUGENT, E.** *Treatise on Optics; or, Light and Sight* theoretically and practically treated, with the application to Fine Art and Industrial Pursuits. With 103 illustrations. 12mo, cloth...\$1.50
- OSBORN, FRANK C.** *Tables of Moments of Inertia, and Squares of Radii of Gyration*; Supplemented by others on the Ultimate and Safe Strength of Wrought Iron Columns, Safe Strength of Timber Beams, and Constants for readily obtaining the Shearing Stresses, Reactions, and Bending Moments in Swing Bridges. 12mo, leather.....\$3.00
- OSTERBERG, MAX.** *Synopsis of Current Electrical Literature*, compiled from Technical Journals and Magazines during 1895. 8vo, cloth.....\$1.00
- PAGE, DAVID.** *The Earth's Crust, A Handy Outline of Geology*. 16mo, cloth..... .75
- PALAZ, A., ScD.** *A Treatise on Industrial Photometry*, with special application to Electric Lighting. Authorized translation from the French by George W. Patterson, Jr. Second edition, revised. 8vo, cloth. Illustrated.....\$4.00
- PARSHALL, H. F., and HOBART, H. M.** *Armature Windings of Electric Machines*. With 140 full page plates, 65 tables, and 165 pages of descriptive letter-press. 4to, cloth.....\$7 50
- PARSHALL, H. F.** *Electrical Equipment of Tramways*.....(In the Press)
- PEIRCE, B.** *System of Analytic Mechanics*. 4to, cloth.....\$10.00
- *Linear Associative Algebra*. New edition with addenda and notes by C. L. Pierce. 4to, cloth.....\$4.00
- PETERS, Dr. EDWARD M.** *Modern American Methods of Copper Smelting*. Numerous illustrations. Seventh edition, revised and enlarged. 8vo, cloth.....\$5.00

PHILLIPS, JOSHUA. Engineering Chemistry. A

Practical Treatise for the use of Analytical Chemists, Engineers, Iron Masters, Iron Founders, students and others. Comprising methods of Analysis and Valuation of the principal materials used in Engineering works, with numerous Analysis, Examples and Suggestions. 314 Illus. Second edition, revised and enlarged. 8vo, cloth...\$4.00

PLANE TABLE, The. Its Uses in Topographical

Surveying. From the Papers of the United States Coast Survey. Illustrated. 8vo, cloth.....\$2.00
 "This work gives a description of the Plane Table employed at the United States Coast Survey office, and the manner of using it."

PLANTE, GASTON. The Storage of Electrical Energy,

and Researches in the Effects created by Currents, combining Quantity with High Tension. Translated from the French by Paul B. Elwell. 89 illustrations. 8vo.....\$4.00

PLATTNER. Manual of Qualitative and Quantitative

Analysis with the Blow-Pipe. From the last German edition, revised and enlarged, by Prof. Th. Richter, of the Royal Saxon Mining Academy. Translated by Prof. H. B. Cornwall, assisted by John H. Caswell. Illustrated with 87 woodcuts and one lithographic plate. Seventh edition, revised. 560 pages. 8vo, cloth.....\$3.00

PLYMPTON, Prof GEO. W. The Blow-Pipe. A

Guide to its use in the Determination of Salts and Minerals. Compiled from various sources. 12mo, cloth.....\$1.50

— The Aneroid Barometer: its Construction and Use.

Compiled from several sources. Fourth edition. 16mo, boards illustrated......50
 Morocco,\$1.00

POCKET LOGARITHMS, to Four Places of Decimals,

including Logarithms of Numbers, and Logarithmic Sines and Tangents to Single Minutes. To which is added a Table of Natural Sines, Tangents, and Co-Tangents. 16mo, boards......50

POOLE, JOSEPH. The Practical Telephone Hand-

Book and Guide to the Telephonic Exchange. 227 illustrations. 12mo, cloth.....\$1.00

POPE, F. L. Modern Practice of the Electric Tele-

graph. A Technical Hand-Book for Electricians, Managers and Operators. Fourteenth edition, rewritten and enlarged, and fully illustrated. 8vo, cloth.....\$1.50

POWLES, H. H. Steam Boilers.....(In the Press)**PRAY, Jr., THOMAS. Twenty Years with the In-**

dicator; being a Practical Text-Book for the Engineer or the Student, with no complex Formulæ. Illustrated. 8vo, cloth.....\$2.50

- PRAY, Jr., THOMAS.** *Steam Tables and Engine Constants.* Compiled from Regnault, Rankine and Dixon directly, making use of the exact records. 8vo, cloth.....\$2.00
- PRACTICAL IRON FOUNDING.** By the author of "Pattern Making," &c., &c. Illustrated with over one hundred engravings. 12mo, Cloth.....\$1.50
- PREECE, W. H., and STUBBS, A. T.** *Manual of Telephony.* Illustrations and plates. 12mo, cloth.....\$4.50
- PREMIER CODE**.....(In the Press)
- PRESCOTT, Prof. A. B.** *Organic Analysis. A Manual of the Descriptive and Analytical Chemistry of certain Carbon Compounds in Common Use; a Guide in the Qualitative and Quantitative Analysis of Organic Materials in Commercial and Pharmaceutical Assays, in the estimation of Impurities under Authorized Standards, and in Forensic Examinations for Poisons, with Directions for Elementary Organic Analysis.* Third edition. 8vo, cloth\$5.00
- *Outlines of Proximate Organic Analysis, for the Identification, Separation, and Quantitative Determination of the more commonly occurring Organic Compounds.* 4th ed. 12mo, cl. \$1.75
- *First Book in Qualitative Chemistry.* Eighth edition. 12mo, cloth.....\$1.50
- and **OTIS COE JOHNSON.** *Qualitative Chemical Analysis. A Guide in the Practical Study of Chemistry and in the work of Analysis.* Fourth fully revised edition. With Descriptive Chemistry extended throughout.....\$3.50
- PRITCHARD, O. G.** *The Manufacture of Electric Light Carbons.* Illustrated. 8vo, paper......60
- PULSIFER, W. H.** *Notes for a History of Lead.* 8vo, cloth, gilt tops.....\$4.00
- PYNCHON, Prof. T. R.** *Introduction to Chemical Physics, designed for the use of Academies, Colleges, and High Schools.* Illustrated with numerous engravings, and containing copious experiments with directions for preparing them. New edition, revised and enlarged, and illustrated by 269 illustrations on wood. Crown 8vo, cloth.....\$3.00
- RAFTER, GEO. W. and M. N. BAKER.** *Sewage Disposal in the United States.* Illustrations and folding plates. Second edition. 8vo., Cloth.....\$6.00
- RAM, GILBERT S.** *The Incandescent Lamp and its Manufacture.* 8vo., cloth.....\$3.00
- RANDALL, J. E.** *A Practical Treatise on the Incandescent Lamp.* Illustrated. 16mo, cloth......50

RANDALL, P. M. Quartz Operator's Hand-book.

New edition, revised and enlarged, fully illustrated. 12mo, cl., \$2.00

RANKINE, W. J. MACQUORN, C.E., LL.D., F. R. S.

Applied Mechanics. Comprising the Principles of Statics and Cinematics, and Theory of Structures, Mechanism, and Machines. With numerous diagrams. Fourteenth edition. Thoroughly revised by W. J. Millar. Crown 8vo, cloth.....\$5.00

— **Civil Engineering.** Comprising Engineering Surveys, Earthwork, Foundations, Masonry, Carpentry, Metal-Work, Roads, Railways, Canals, River, Water-Works, Harbors, etc. With numerous tables and illustrations. Eighteenth edition. Thoroughly revised by W. J. Millar. Crown, 8vo, cloth.....\$6.50

— **Machinery and Millwork.** Comprising the Geometry, Motions, Work, Strength, Construction, and Objects of Machines, etc. Illustrated with nearly 300 woodcuts. Sixth edition. Thoroughly revised by W. J. Millar. Crown 8vo, cloth.....\$5.00

— **The Steam-Engine and Other Prime Movers.** With diagram of the Mechanical Properties of Steam, folding plates, numerous tables and illustrations. Thirteenth edition. Thoroughly revised by W. J. Millar. Crown, 8vo, cloth.....\$5.00

— **Useful Rules and Tables for Engineers and Others.** With appendix, tables, tests, and formulæ for the use of Electrical Engineers. Comprising Submarine Electrical Engineering, Electric Lighting, and Transmission of Power. By Andrew Jamieson, C.E., F.R.S.E. Seventh edition. Thoroughly revised by W. J. Millar. Crown 8vo, cloth.....\$4.00

— **A Mechanical Text Book.** By Prof. Macquorn Rankine and E. F. Bamber, C. E. With numerous illustrations. Fourth edition. Crown, 8vo, cloth.....\$3.50

RECKENZAUN, A. Electric Traction on Railways and Tramways. 213 Illustrations, 12mo, cloth.....\$4.00

REED'S ENGINEERS' HAND-BOOK, to the Local Marine Board Examinations for Certificates of Competency as First and Second Class Engineers. By W. H. Thorn. With the answers to the Elementary Questions. Illustrated by 297 diagrams and 36 large plates. 15th edition, revised and enlarged. 8vo, cloth.....\$4.50

— **Key to the Fifteenth Edition of Reed's Engineers' Hand-book to the Board of Trade Examinations for First and Second Class Engineers and containing the working of all the questions given in the examination papers.** By W. H. Thorn. 8vo., cloth..... 3.00

REINHART, CHAS. W. Lettering for Draftsmen, Engineers and Students. A Practical System of Free-hand Lettering for Working Drawings. Second edition, revised. Oblong boards \$1.00

RICE, Prof. J. M., and JOHNSON, Prof. W. W. On a New Method of obtaining the Differential of Functions, with especial reference to the Newtonian Conception of Rates or Velocities. 12mo, paper..... .50

- RIPPER, WILLIAM.** *A Course of Instruction in Machine Drawing and Design for Technical Schools and Engineer Students.* With 52 plates and numerous explanatory engravings. Folio, cloth.....\$6.00
- ROEBLING, J. A.** *Long and Short Span Railway Bridges.* Illustrated with large copperplate engravings of plans and views. Imperial folio, cloth.....\$25.00
- ROGERS, Prof. H. D.** *The Geology of Pennsylvania.* A Government Survey, with a General View of the Geology of the United States, essays on the Coal Formation and its Fossils, and a description of the Coal Fields of North America and Great Britain. Illustrated with plates and engravings in the text. 3 vols, 4to, cloth, with portfolio of maps.....\$15.00
- ROSE, JOSHUA, M.E.** *The Pattern-Makers' Assistant.* Embracing Lathe Work, Branch Work, Core Work, Sweep Work, and Practical Gear Constructions, the Preparation and Use of Tools, together with a large collection of useful and valuable Tables. Seventh edition. Illustrated with 250 engravings. 8vo, cloth.....\$2.50
- **Key to Engines and Engine-Running.** *A Practical Treatise upon the Management of Steam Engines and Boilers for the Use of Those who Desire to Pass an Examination to Take Charge of an Engine or Boiler.* With numerous illustrations, and Instructions Upon Engineers' Calculations, Indicators, Diagrams, Engine Adjustments, and other Valuable Information necessary for Engineers and Firemen. 12mo, cloth.....\$3.00
- SABINE, ROBERT.** *History and Progress of the Electric Telegraph.* With descriptions of some of the apparatus. Second edition, with additions. 12mo, cloth.....\$1.25
- SAELTZER, ALEX.** *Treatise on Acoustics in connection with Ventilation.* 12mo, cloth.....\$1.00
- SALOMONS, Sir DAVID, M.A.** *Electric-Light Installations.* A Practical Handbook. Seventh edition, revised and enlarged with numerous illustrations. Vol. I., The management of Accumulators. 12mo, cloth.....\$1.50
Vol. II., Apparatus, 296 illustrations. 12mo., cloth.....\$2.25
Vol. III., Applications, 12mo., cloth.....\$1.50
- SAUNNIER, CLAUDIUS.** *Watchmaker's Handbook.* A Workshop Companion for those engaged in Watchmaking and allied Mechanical Arts. Translated by J. Trippin and E. Rigg. Second edition, revised and appendix. 12mo, cloth.....\$3.50
- SCHELLEN, Dr. H.** *Magneto-Electric and Dynamo-Electric Machines: their Construction and Practical Application to Electric Lighting, and the Transmission of Power.* Translated from the third German edition by N. S. Keith and Percy Neymann, Ph.D. With very large additions and notes relating to American Machines, by N. S. Keith. Vol. 1., with 353 illustrations. Second edition, \$5.00

SCHUMANN, F. A Manual of Heating and Ventilation in its Practical Application, for the use of Engineers and Architects. Embracing a series of Tables and Formulæ for dimensions of heating, flow and return pipes for steam and hot-water boilers, flues, etc. 12mo, illustrated, full roan.....\$1.50

— **Formulas and Tables for Architects and Engineers** in calculating the strains and capacity of structures in Iron and Wood. 12mo, morocco, tucks.....\$1.50

SCIENCE SERIES, The Van Nostrand. [See List, p. 28]

SCRIBNER, J. M. Engineers' and Mechanics' Companion. Comprising United States Weights and Measures. Mensuration of Surfaces and Solids, Tables of Squares and Cubes, Square and Cube Roots, Circumference and Areas of Circles, the Mechanical Powers, Centres of Gravity, Gravitation of Bodies, Pendulums, Specific Gravity of Bodies, Strength, Weight, and Crush of Materials, Water-Wheels, Hydrostatics, Hydraulics, Statics, Centres of Percussion and Gyration, Friction Heat, Tables of the Weight of Metals, Scantling, etc., Steam and the Steam-Engine. Twentieth edition, revised. 16mo, full morocco.....\$1.50

SEATON, A. E. A Manual of Marine Engineering.

Comprising the Designing, Construction and Working of Marine Machinery. With numerous tables and illustrations reduced from Working Drawings. Thirteenth edition. Revised throughout, with an additional chapter on Water Tube Boilers. 8vo, cloth.....\$6.00

— **and ROUNTHWAITE, H. M. A Pocketbook of Marine Engineering Rules and Tables.** For the use of Marine Engineers and Naval Architects, Designers, Draughtsmen, Superintendents, and all engaged in the design and construction of Marine Machinery, Naval and Mercantile. Pocket size. Leather, with diagrams.....\$3.00

SHIELDS, J. E. Notes on Engineering Construction.

Embracing Discussions of the Principles involved, and Descriptions of the Material employed in Tunnelling, Bridging, Canal and Road Building, etc. 12mo, cloth.....\$1.50

SHREVE, S. H. A Treatise on the Strength of Bridges

and Roofs. Comprising the determination of Algebraic formulas for strains in Horizontal, Inclined or Rafter, Triangular, Bowstring, Lenticular, and other Trusses, from fixed and moving loads, with practical applications, and examples, for the use of Students and Engineers. 87 woodcut illustrations. Fourth edition. 8vo, cloth.....\$3.50

SHUNK, W. F. The Field Engineer. A Handy Book

of practice in the Survey, Location, and Truck-work of Railroads, containing a large collection of Rules and Tables, original and selected, applicable to both the Standard and Narrow Gauge, and prepared with special reference to the wants of the young Engineer. Tenth edition. Revised and Enlarged. 12mo, morocco, tucks.....\$2.50

- SIMMS, F. W.** **A Treatise on the Principles and Practice of Levelling.** Showing its application to purposes of Railway Engineering, and the Construction of Roads, etc. Revised and corrected, with the addition of Mr. Laws' Practical Examples for setting out Railway Curves. Illustrated. 8vo, cloth,.....\$2.50
- **Practical Tunnelling.** Fourth edition, revised and greatly extended. With additional chapters illustrating recent practice by D. Kinnear Clark. With 36 plates and and other illustrations. Imperial 8vo, cloth. 1896.....\$12.00
- SLATER, J. W.** **Sewage Treatment, Purification, and Utilization.** A Practical Manual for the Use of Corporations, Local Boards, Medical Officers of Health, Inspectors of Nuisances, Chemists, Manufacturers, Riparian Owners, Engineers, and Rate-payers. 12mo, cloth.....\$2.25
- SMITH, ISAAC W., C.E.** **The Theory of Deflections and of Latitudes and Departures.** With special applications to Curvilinear Surveys, for Alignments of Railway Tracks. Illustrated. 16mo, morocco, tucks.....\$3.00
- **GUSTAVUS W.** **Notes on Life Insurance. Theoretical and Practical.** Third edition. Revised and Enlarged. 8vo, cloth.....\$2.00
- SNELL, ALBION T.** **Electric Motive Power: The Transmission and Distribution of Electric Power by Continuous and Alternate Currents.** With a Section on the Applications of Electricity to Mining Work. 8vo., cloth, illustrated.....\$4.00
- STAHL, A. W., and WOODS, A. T.** **Elementary Mechanism.** A Text-Book for Students of Mechanical Engineering. Fourth edition. Enlarged. 12mo, cloth.....\$2.00
- STALEY, CADY, and PIERSON, GEO. S.** **The Separate System of Sewerage: its Theory and Construction.** 8vo, cloth. With maps, plates and illustrations. Second edition....\$3.00
- STEVENSON, DAVID, F.R.S.N.** **The Principles and Practice of Canal and River Engineering.** Revised by his sons David Alan Stevenson, B. Sc., F.R.S.E., and Charles Alexander Stevenson, B. Sc., F.R.S.E., Civil Engineer. Third edition, with 17 plates. 8vo, cloth.....\$10.00
- **The Design and Construction of Harbors.** A Treatise on Maritime Engineering. Third edition, with 24 plates. 8vo, cloth.....\$9.00
- STEWART, R. W.** **A Text Book of Light.** Adapted to the Requirements of the Intermediate Science and Preliminary Scientific Examinations of the University of London, and also for General Use. Numerous Diagrams and Examples. 12mo, cloth, \$1.00
- **A Text Book of Heat.** Illustrated. 8vo, cloth....\$1.00

- STEWART, R. W.** *A Text-Book of Magnetism and Electricity.* 160 Illustrations and Numerous Examples. 12mo, cloth.....\$1.00
- STILES, AMOS.** *Tables for Field Engineers.* Designed for use in the field. Tables containing all the functions of a one degree curve, from which a corresponding one can be found for any required degree. Also, Tables of Natural Sines and Tangents. 12mo, morocco, tucks.....\$2.00
- STILLMAN, PAUL.** *Steam-Engine Indicator and the Improved Manometer Steam and Vacuum Gauges; their Utility and Application.* New edition. 12mo, flexible cloth.....\$1.00
- STONE, General ROY.** *New Roads and Road Laws in the United States.* 200 pages, with numerous illustrations. 12mo, cloth.....\$1.00
- STONE, B. D.** *The Theory of Stresses in Girders and Similar Structures.* With observations on the application of Theory to Practice, and Tables of Strength, and other properties of Materials. New revised edition, with numerous additions on Graphic Statics, Pillars, Steel, Wind Pressure, Oscillating Stresses, Working Loads, Riveting, Strength and Tests of Materials. 8vo, 777 pages, 143 illustrations, and 5 folding plates.....\$12.50
- STUART, B.** *How to become a Successful Engineer.* Being Hints to Youths intending to adopt the Profession. Sixth edition. 12mo, boards......50
- **C. B., C. E.** *Lives and Works of Civil and Military Engineers of America.* With 10 steel-plate engravings. 8vo, cloth.....\$5.00
- SWEET, S. H.** *Special Report on Coal, showing its Distribution, Classification, and Costs delivered over different routes to various points in the State of New York and the principal cities on the Atlantic Coast.* With maps. 8vo, cloth.....\$3.00
- SWINTON, ALAN A. CAMPBELL.** *The Elementary Principle of Electric Lighting.* Illustrated. 12mo, cloth......60
- TAYLOR, A. J. WALLIS.** *Sugar Machinery.* A Descriptive Treatise, Devoted to the Machinery and Apparatus used in the Manufacture of Cane and Beet Sugars. 12mo, cl., ill.....\$2.00
- TEMPLETON, WM.** *The Practical Mechanic's Workshop Companion.* Comprising a great variety of the most useful rules and formulæ in Mechanical Science, with numerous tables of practical data and calculated results facilitating mechanical operations. Revised and enlarged by W. S. Hutton. 12mo, morocco.....\$2.00
- THOM, CHAS., and WILLIS H. JONES.** *Telegraphic Connections: embracing Recent Methods in Quadruplex Telegraphy.* Oblong, 8vo, cloth. 20 full page plates, some colored.....\$1.50

- THOMPSON, EDWARD P., M.E.** **How to Make In-**
ventions; or, Inventing as a Science and an Art. A Practical Guide
for Inventors. Second edition. 8vo, boards.....\$1.00
- **Roentgen Rays and Phenomena of the Anode and**
Cathode. Principles, Applications and Theories. For Students,
Teachers, Physicians, Photographers, Electricians and others.
Assisted by Louis M. Pignolet, N. D. C. Hodges, and Ludwig
Gutmann, E. E. With a Chapter on Generalizations, Arguments,
Theories, Kindred Radiations and Phenomena. By Professor Wm.
Anthony, formerly of Cornell University, Past Pres. American Inst.
Electrical Engineers. Royal 8vo, cloth. 50 Diagrams, 40 Half tones.
Price.....\$1.50
- Toothed Gearing. A Practical Hand-Book for Offices**
and Workshops. By a Foreman Patternmaker. 184 Illustrations.
12mo, cloth.....\$2.25
- TREVERT, EDWARD.** **How to build Dynamo-Electric**
Machinery, embracing Theory Designing and the construction of Dy-
namos and Motors. With appendices on Field Magnet and Armature
Winding, Management of Dynamos and Motors, and Useful Tables of
Wire Gauges. Illustrated. 8vo, cloth.....\$2.50
- TREVERT, EDWARD.** **Electricity and its Recent**
Applications. A practical Treatise for Students and Amateurs, with
an Illustrated Dictionary of Electrical Terms and Phrases. Illus-
trated. 12mo, cloth.....\$2.00
- TUCKER, Dr. J. H.** **A Manual of Sugar Analysis, in-**
cluding the Applications in General of Analytical Methods to the
Sugar Industry. With an Introduction on the Chemistry of Can^e
Sugar, Dextrose, Levulose, and Milk Sugar. 8vo, cloth, illus-
trated.....\$3.50
- TUMLIRZ, DR. O.** **Potential and its Application to**
the Explanation of Electric Phenomena, Popularly Treated. Trans-
lated from the German by D. Robertson. Ill. 12mo, cloth....\$1.25
- TUNNER, P. A.** **Treatise on Roll-Turning for the**
Manufacture of Iron. Translated and adapted by John B. Pearse, of
the Pennsylvania Steel Works, with numerous engravings, woodcuts.
8vo, cloth, with folio atlas of plates.....\$10.00
- URQUHART, J. W.** **Electric Light Fitting. Embod-**
ing Practical Notes on Installation Management. A Hand-book for
Working Electrical Engineers—with numerous illustrations. 12mo,
cloth.....\$2.00
- **Electro-Plating. A Practical Hand Book on the**
Deposition of Copper, Silver, Nickel, Gold, Brass, Aluminium, Plat-
inum, etc. Second edition. 12mo.....\$2.00
- **Electro-Typing. A Practical Manual forming a**
New and Systematic Guide to the Reproduction and Multiplication
of Printing Surfaces, etc. 12mo.....\$2.00

- URQUHART, J. W. Dynamo Construction: a Practical Hand-Book for the Use of Engineer Constructors and Electricians in Charge, embracing Frame Work Building, Field Magnet and Armature Winding and Grouping, Compounding, etc.. with Examples of Leading English, American and Continental Dynamos and Motors, with numerous illustrations.** 12mo, cloth.....\$3.00
- **Electric Ship Lighting. A Hand-Book on the Practical Fitting and Running of Ship's Electrical Plant. For the Use of Ship Owners and Builders, Marine Electricians and Sea Going Engineers in Charge.** Numerous illustrations. 12mo, cloth.....\$3.00
- UNIVERSAL (The) TELEGRAPH CIPHER CODE.**
Arranged for General Correspondence. 12mo, cloth.....\$1.00
- VAN HEURCK, Dr. HENRI. The Microscope, Its Construction and Management, including Technique, Photo-Micrography and the Past and Future of the Microscope.** English edition re-edited and augmented by the Author from the fourth French edition, and translated by Wynne E. Baxter, F.R.M.S. 3 Plates and upwards of 250 Illustrations. Imperial 8vo, cloth.....\$7.00
- VAN NOSTRAND'S Engineering Magazine.** Complete sets, 1869 to 1886 inclusive
Complete sets, in 35 vols., in cloth.....\$60.00
Complete sets, in 35 vols., in half morocco.....\$100.00
- VAN WAGENEN, T. F. Manual of Hydraulic Mining.**
For the Use of the Practical Miner. Revised and enlarged edition. 18mo, cloth.....\$1.00
- WALKER, W. H. Screw Propulsion. Notes on Screw Propulsion, its Rise and History.** 8vo, cloth..... .75
- **SYDNEY F. Electrical Engineering in Our Homes and Workshops.** A Practical Treatise on Auxiliary Electrical Apparatus. Third edition revised, with numerous illustrations. \$2.00
- WANKLYN, J. A. A Practical Treatise on the Examination of Milk and its Derivatives, Cream, Butter, and Cheese.** 12mo, cloth.....\$1.00
- **Water Analysis. A Practical Treatise on the Examination of Potable Water.** Tenth edition. 12mo, cloth.....\$2.00
- WARD, J. H. Steam for the Million. A Popular Treatise on Steam, and its application to the Useful Arts, especially to Navigation.** 8vo, cloth.....\$1.00
- WARING, GEO. E., Jr. Sewerage and Land Drainage.** Large Quarto Volume. Illustrated with wood-cuts in the text, and full-page and folding plates. Cloth. Third edition.....\$6.00
- **Modern Methods of Sewage Disposal for Towns, Public Institutions and Isolated Houses.** Second edition, revised and enlarged. 260 pages. Illustrated. cloth.....\$2.00

WARING, GEO. E., Jr. **How to Drain a House.** Practical Information for Household-ers. New and enlarged edition. 12mo, cloth.....\$1.25

WATT, ALEXANDER. **Electro-Deposition.** A Practical Treatise on the Electrolysis of Gold, Silver, Copper, Nickel, and other Metals, with Descriptions of Voltaic Batteries, Magneto and Dynamo-Electric Machines, Thermopiles, and of the Materials and Processes used in every Department of the Art, and several chapters on Electro-Metallurgy. With numerous illustrations. Third edition, revised and corrected. Crown 8vo, 568 pages.....\$3.50

— **Electro-Metallurgy Practically Treated.** Tenth edition, considerably enlarged. 12mo, cloth.....\$1.00

— **The Art of Soap-Making.** A Practical Handbook of the Manufacture of Hard and Soft Soaps, Toilet Soaps, &c. Including many New Processes, and a Chapter on the Recovery of Glycerine from Waste Leys. With illustrations. Fourth edition, revised and enlarged. 8vo.....\$3.00

— **The Art of Leather Manufacture.** Being a Practical Handbook, in which the Operations of Tanning, Currying, and Leather Dressing are Fully Described, and the Principles of Tanning Explained, and many Recent Processes Introduced. With numerous illustrations. Second edition. 8vo, cloth.....\$4.00

WEALE, JOHN. **A Dictionary of Terms Used in** Architecture, Building, Engineering, Mining, Metallurgy, Archaeology, the Fine Arts, etc., with explanatory observations connected with applied Science and Art. Fifth edition, revised and corrected. 12mo, cloth.....\$2.50

Weale's Rudimentary Scientific Series, [see list, p. 33.]

WEBB, HERBERT LAWS. **A Practical Guide to** the Testing of Insulated Wires and Cables. Illustrated. 12mo, cloth.....\$1.00

— **The Telephone Hand Book.** 128 illustrations. 146 pages. 16mo., cloth.....\$1.00

WEEKES, R. W. **The Design of Alternate Current** Transformers. Illustrated. 12mo, cloth.....\$1.00

WEISBACH, JULIUS. **A Manual of Theoretical** Mechanics. Eighth American edition. Translated from the fourth augmented and improved German edition, with an Introduction to the Calculus by Eckley B. Coxe, A.M., Mining Engineer. 1,100 pages, and 902 woodcut illustrations. 8vo, cloth.....\$10.00
Sheep.....\$11.00

WESTON, EDMUND B. **Tables Showing Loss of** Head Due to Friction of Water in Pipes. 12mo, cloth.....\$1.50

- WEYMOUTH, F. MARTEN.** **Drum Armatures and Commutators.** (Theory and Practice.) A complete Treatise on the Theory and Construction of Drum Winding, and of commutators for closed-coil armatures, together with a full resume of some of the principal points involved in their design, and an exposition of armature re-actions and sparking. 8vo, cloth\$3.00
- WEYRAUCH, J. J.** **Strength and Calculations of Dimensions of Iron and Steel Construction,** with reference to the Latest Experiments. 12mo, cloth, plates\$1.00
- WHIPPLE, S., C.E.** **An Elementary and Practical Treatise on Bridge Building.** 8vo, cloth\$4.00
- WILKINSON, H. D.** **Submarine Cable-Laying, Repairing and Testing.** 8vo, cloth\$4.00
- WILLIAMSON, R. S.** **On the Use of the Barometer on Surveys and Reconnoissances.** Part I. Meteorology in its Connection with Hypsometry. Part II. Barometric Hypsometry. With Illustrative tables and engravings. 4to, cloth\$15.00
- WILLIAMSON, R. S.** **Practical Tables in Meteorology and Hypsometry,** in connection with the use of the Barometer. 4to, cloth\$2.50
- WILSON, GEO.** **Inorganic Chemistry, with New Notation.** Revised and enlarged by H. G. Madan. New edition. 12mo, cloth\$2.00
- WOODBURY, D. V.** **Treatise on the Various Elements of Stability in the Well-Proportioned Arch.** 8vo, half morocco..\$4.00
- WRIGHT, T.W. Prof.** **A Treatise on the Adjustment of Observations.** With applications to Geodetic Work, and other Measures of Precision. 8vo, cloth\$4.00
- **Elements of Mechanics; including Kinematics, Kinetics and Statics.** With application., 8vo, cloth\$2.50
- WYATT, JAMES.** **The Phosphates of America.** Where and How They Occur; How They are Mined; and What They Cost. With Practical Treatises on the Manufacture of Sulphuric Acid, Acid Phosphates, Phosphoric Acid and Concentrated Superphosphates and Selected Methods of Chemical Analysis. 20 Full Page Plates and numerous Illustrations. 8vo, cloth\$4.00
- WYNKOOP, RICHARD.** **Vessels and Voyages, as Regulated by Federal Statutes and Treasury Instructions and Decisions.** 8vo, cloth\$2.00

Catalogue of the Van Nostrand Science Series.

THEY are put up in a uniform, neat, and attractive form. 18mo, boards. Price 50 cents per volume. The subjects are of an eminently scientific character, and embrace a wide range of topics, and are amply illustrated when the subject demands.

- No. 1. CHIMNEYS FOR FURNACES AND STEAM-BOILERS.** By R. Armstrong, C.E. Third American edition, revised and partly rewritten, with an appendix on Theory of Chimney Draught, by F. E. Idell, M.E.
- No. 2. STEAM-BOILER EXPLOSIONS.** By Zerah Colburn. New edition, revised by Prof. R. H. Thurston.
- No. 3. PRACTICAL DESIGNING OF RETAINING-WALLS.** By Arthur Jacob, A.B. Second edition, revised, with additions by Prof. W. Cain.
- No. 4. PROPORTIONS OF PINS USED IN BRIDGES.** Second edition, with appendix. By Charles E. Bender, C.E.
- No. 5. VENTILATION OF BUILDINGS.** By W. F. Butler. Second edition, re-edited and enlarged by James L. Greenleaf, C.E.
- No. 6. ON THE DESIGNING AND CONSTRUCTION OF STORAGE RESERVOIRS.** By Arthur Jacob, A.B. Second edition, revised, with additions by E. Sherman Gould.
- No. 7. SURCHARGED AND DIFFERENT FORMS OF RETAINING-WALLS.** By James S. Tate, C.E.
- No. 8. A TREATISE ON THE COMPOUND ENGINE.** By John Turnbull, jun. Second edition, revised by Prof. S. W. Robinson.
- No. 9. A TREATISE ON FUEL.** By Arthur V. Abbott, C.E. Founded on the original treatise of C. William Siemens, D.C.L.
- No. 10. COMPOUND ENGINES.** Translated from the French of A. Mallet. Second edition, revised, with Results of American Practice, by Richard H. Buel, C.E.
- No. 11. THEORY OF ARCHES.** By Prof. W. Allan.
- No. 12. A THEORY OF VOUSOIR ARCHES.** By Prof. W. E. Cain. Second edition, revised and enlarged. Illustrated.
- No. 13. GASES MET WITH IN COAL-MINES.** By J. J. Atkinson. Third edition, revised and enlarged by Edward H. Williams, jun.

D. VAN NOSTRAND COMPANY'S

- No. 14. FRICTION OF AIR IN MINES.** By J. J. Atkinson.
- No. 15. SKEW ARCHES.** By Prof. E. W. Hyde, C.E. Illustrated.
- No. 16. A GRAPHIC METHOD FOR SOLVING CERTAIN ALGEBRAIC EQUATIONS.** By Prof. George L. Vose.
- No. 17. WATER AND WATER-SUPPLY.** By Prof. W. H. Corfield of the University College, London.
- No. 18. SEWERAGE AND SEWAGE PURIFICATION.** By M. N. Baker, Assoc. Ed. *Engineering News*.
- No. 19. STRENGTH OF BEAMS UNDER TRANSVERSE LOADS.** By Prof. W. Allan, author of "Theory of Arches."
- No. 20. BRIDGE AND TUNNEL CENTRES.** By John B. McMaster, C.E.
- No. 21. SAFETY VALVES.** By Richard H. Buel, C.E. Second edition.
- No. 22. HIGH MASONRY DAMS.** By John B. McMaster, C.E.
- No. 23. THE FATIGUE OF METALS UNDER REPEATED STRAINS.** With Various Tables of Results and Experiments. From the German of Prof. Ludwig Spangenberg, with a Preface by S. H. Shreve, A.M.
- No. 24. A PRACTICAL TREATISE ON THE TEETH OF WHEELS.** By Prof. S. W. Robinson. Second edition, revised.
- No. 25. ON THE THEORY AND CALCULATION OF CONTINUOUS BRIDGES.** By Mansfield Merriman, Ph.D.
- No. 26. PRACTICAL TREATISE ON THE PROPERTIES OF CONTINUOUS BRIDGES.** By Charles Bender, C.E.
- No. 27. ON BOILER INCRUSTATION AND CORROSION**
By F. J. Rowan. New edition, revised and partly rewritten by F. E. Idell, M. E.
- No. 28. TRANSMISSION OF POWER BY WIRE ROPES**
By Albert W. Stahl, U.S.N. Second edition.
- No. 29. STEAM INJECTORS.** Translated from the French of M. Leon Pochet.
- No. 30. TERRESTRIAL MAGNETISM, AND THE MAGNETISM OF IRON VESSELS.** By Prof. Fairman Rogers.
- No. 31. THE SANITARY CONDITION OF DWELLING-HOUSES IN TOWN AND COUNTRY.** By George E. Waring, jun.
- No. 32. CABLE-MAKING FOR SUSPENSION BRIDGES.** By W. Hildenbrand, C.E.
- No. 33. MECHANICS OF VENTILATION.** By George W. Rafter, C.E. New edition (1895), revised by author.
- No. 34. FOUNDATIONS.** By Prof. Jules Gaudard, C.E. Translated from the French.
- No. 35. THE ANEROID BAROMETER: ITS CONSTRUCTION AND USE.** Compiled by George W. Plympton. Fourth edition.
- No. 36. MATTER AND MOTION.** By J. Clerk Maxwell, M.A. Second American edition.

SCIENCE SERIES.

- No. 37. GEOGRAPHICAL SURVEYING: ITS USES, METHODS, AND RESULTS.** By Frank De Yeaux Carpenter, C.E.
- No. 38. MAXIMUM STRESSES IN FRAMED BRIDGES.** By Prof. William Cain, A.M., C.E.
- No. 39. A HANDBOOK OF THE ELECTRO-MAGNETIC TELEGRAPH.** By A. E. Loring.
- No. 40. TRANSMISSION OF POWER BY COMPRESSED AIR.** By Robert Zahner, M.E. Second edition.
- No. 41. STRENGTH OF MATERIALS.** By William Kent, C.E.
- No. 42. VOUSSOIR ARCHES APPLIED TO STONE BRIDGES, TUNNELS, CULVERTS, AND DOMES.** By Prof. William Cain.
- No. 43. WAVE AND VORTEX MOTION.** By Dr. Thomas Craig of Johns Hopkins University.
- No. 44. TURBINE WHEELS.** By Prof. W. P. Trowbridge, Columbia College. Second edition.
- No. 45. THERMODYNAMICS.** By Prof. H. T. Eddy, University of Cincinnati.
- No. 46. ICE-MAKING MACHINES.** New edition, revised and enlarged by Prof. J. E. Denton. From the French of M. Le Doux.
- No. 47. LINKAGES; THE DIFFERENT FORMS AND USES OF ARTICULATED LINKS.** By J. D. C. de Roos.
- No. 48. THEORY OF SOLID AND BRACED ARCHES.** By William Cain, C.E.
- No. 49. ON THE MOTION OF A SOLID IN A FLUID.** By Thomas Craig, Ph.D.
- No. 50. DWELLING-HOUSES: THEIR SANITARY CONSTRUCTION AND ARRANGEMENTS.** By Prof. W. H. Corfield.
- No. 51. THE TELESCOPE: ITS CONSTRUCTION, ETC.** By Thomas Nolan.
- No. 52. IMAGINARY QUANTITIES.** Translated from the French of M. Argand. By Prof. Hardy.
- No. 53. INDUCTION COILS: HOW MADE AND HOW USED.** Fifth edition.
- No. 54. KINEMATICS OF MACHINERY.** By Prof. Kennedy. With an introduction by Prof. R. H. Thurston.
- No. 55. SEWER GASES: THEIR NATURE AND ORIGIN.** By A. de Varona.
- No. 56. THE ACTUAL LATERAL PRESSURE OF EARTH-WORK.** By Benjamin Baker, M. Inst. C.E.
- No. 57. INCANDESCENT ELECTRIC LIGHTING.** A Practical Description of the Edison System. By L. H. Latimer, to which is added the Design and Operation of Incandescent Stations, by C. J. Field, and the Maximum Efficiency of Incandescent Lamps, by John W. Howell.
- No. 58. THE VENTILATION OF COAL-MINES.** By W. Fairley, M.E., F.S.S.

D. VAN NOSTRAND COMPANY'S

- No. 59. RAILROAD ECONOMICS; OR, NOTES, WITH COMMENTS.** By S. W. Robinson, C.E.
- No. 60. STRENGTH OF WROUGHT-IRON BRIDGE MEMBERS.** By S. W. Robinson, C.E.
- No. 61. POTABLE WATER AND THE DIFFERENT METHODS OF DETECTING IMPURITIES.** By Charles W. Folkard.
- No. 62. THE THEORY OF THE GAS-ENGINE.** By Dugald Clerk.
Second edition. With additional matter. Edited by F. E. Idell, M.E.
- No. 63. HOUSE DRAINAGE AND SANITARY PLUMBING.**
By W. P. Gerhard. Sixth edition, revised.
- No. 64. ELECTRO-MAGNETS.** By Th. du Moncel. 2d revised edition.
- No. 65. POCKET LOGARITHMS TO FOUR PLACES OF DECIMALS.**
- No. 66. DYNAMO-ELECTRIC MACHINERY.** By S. P. Thompson.
With notes by F. L. Pope. Third edition.
- No. 67. HYDRAULIC TABLES BASED ON "KUTTER'S FORMULA."** By P. J. Flynn.
- No. 68. STEAM-HEATING.** By Robert Briggs. Second edition, revised,
with additions by A. R. Wolff.
- No. 69. CHEMICAL PROBLEMS.** By Prof. J. C. Foye. Second
edition, revised and enlarged.
- No. 70. EXPLOSIVES AND EXPLOSIVE COMPOUNDS.** By
M. Bertholet.
- No. 71. DYNAMIC ELECTRICITY.** By John Hopkinson, J. A.
Schoolbred, and R. E. Day.
- No. 72. TOPOGRAPHICAL SURVEYING.** By George J. Specht,
Prof. A. S. Hardy, John B. McMaster, and H. F. Walling.
- No. 73. SYMBOLIC ALGEBRA; OR, THE ALGEBRA OF
ALGEBRAIC NUMBERS.** By Prof. W. Cain.
- No. 74. TESTING MACHINES: THEIR HISTORY, CON-
STRUCTION, AND USE.** By Arthur V. Abbot.
- No. 75. RECENT PROGRESS IN DYNAMO-ELECTRIC MA-
CHINES.** Being a Supplement to Dynamo-Electric Machinery. By
Prof. Sylvanus P. Thompson.
- No. 76. MODERN REPRODUCTIVE GRAPHIC PROCESSES.**
By Lieut. James S. Pettit, U.S.A.
- No. 77. STADIA SURVEYING.** The Theory of Stadia Measurements.
By Arthur Winslow.
- No. 78. THE STEAM-ENGINE INDICATOR, AND ITS USE**
By W. B. Le Van.
- No. 79. THE FIGURE OF THE EARTH.** By Frank C. Roberts, C.E.
- No. 80. HEALTHY FOUNDATIONS FOR HOUSES.** By Glenn
Brown.